

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269



Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P759976

Luminaire Tested: LD6D10D010-EU6DR150210IC9035-6LBS1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P759976  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D10D010-EU6DR150210IC9035-6LBS1MW  
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 15° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 1108.1 lumens  
Efficiency: N/A  
Efficacy: 94.7 lumens/watt  
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23  
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')  
CIE Type: Direct

Input Watts (W): 11.7  
Input Voltage (V): NR  
Input Current (Ain): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P759976  
CATALOG NUMBER: LD6D10D010-EU6DR150210IC9035-6LBS1MW

### Luminous Intensity Polar Plot

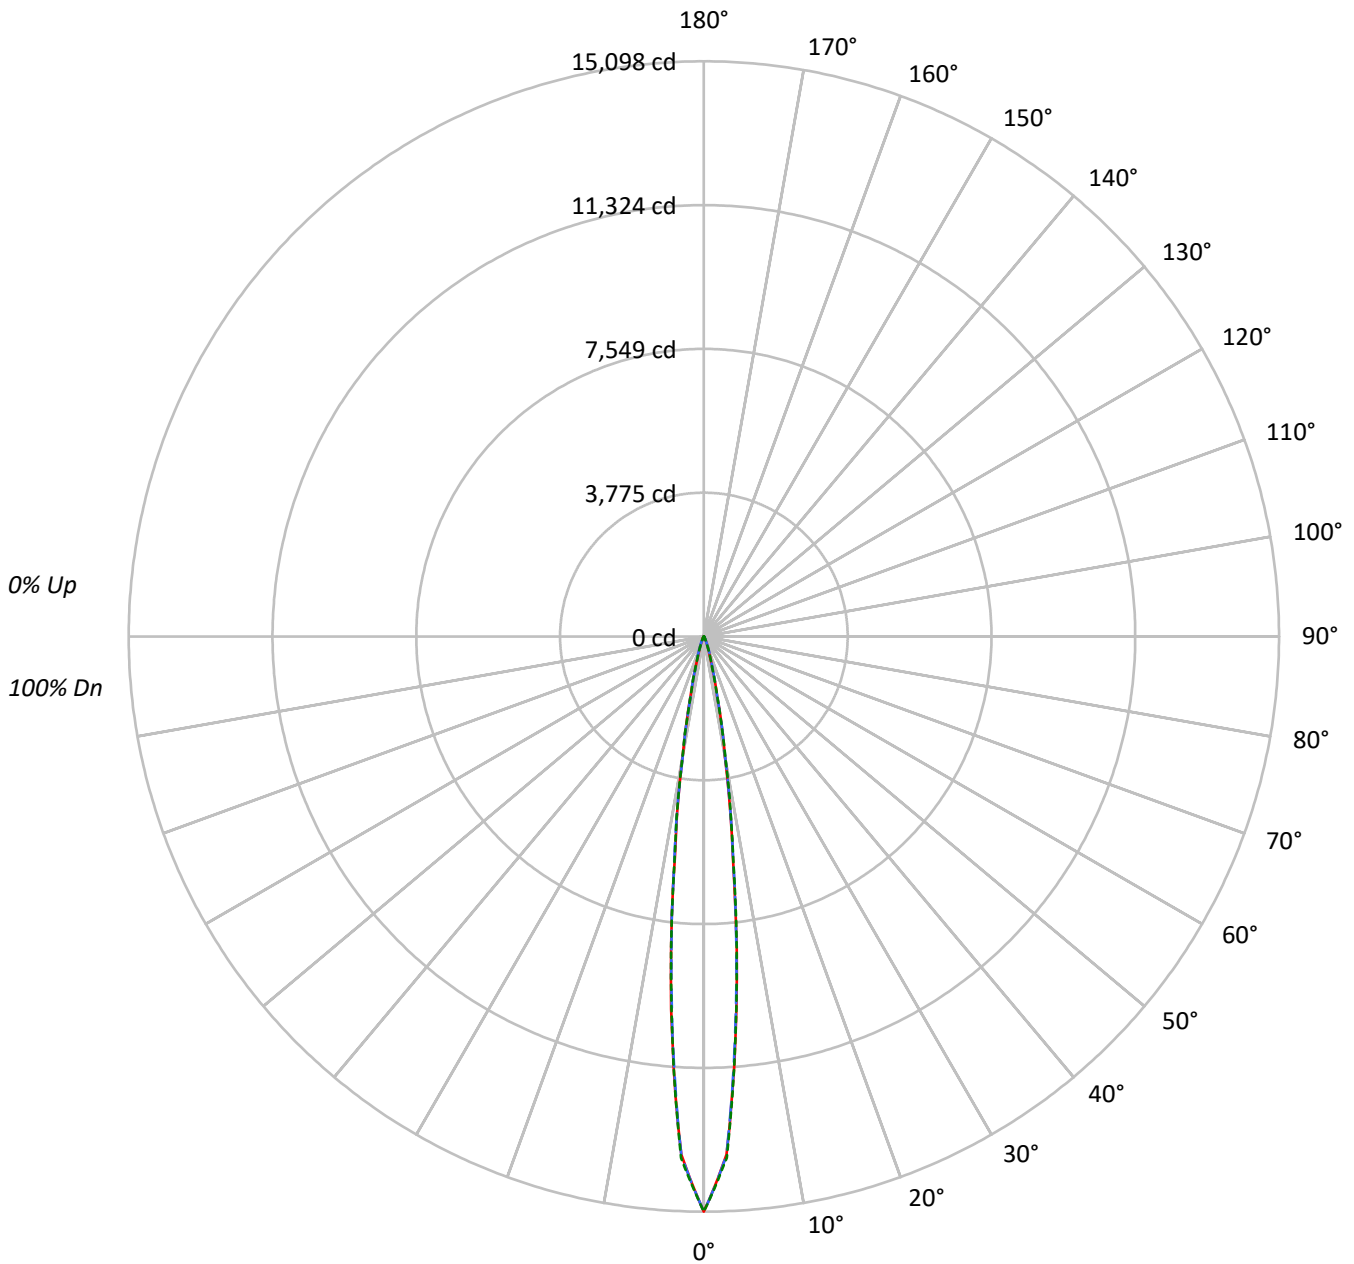



TEST NUMBER: P759976

CATALOG NUMBER: LD6D10D010-EU6DR150210IC9035-6LBS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	1698804	1698804	1698804
5°	998301	985374	993168
10°	297950	300031	304621
15°	74115	75557	73220
20°	22174	25676	22640
25°	7813	9956	7915
30°	2868	3782	2920
35°	1438	1627	1394
40°	909	1001	909
45°	672	714	672
50°	535	535	535
55°	445	445	445
60°	358	358	358
65°	271	271	271
70°	234	234	234
75°	144	144	197
80°	102	102	102
85°	50	50	50

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 714 cd/sqm



TEST NUMBER: P759976

CATALOG NUMBER: LD6D10D010-EU6DR150210IC9035-6LBS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	718.7	64.9
10°-20°	295.6	26.7
20°-30°	58.7	5.3
30°-40°	14.7	1.3
40°-50°	7.7	0.7
50°-60°	5.7	0.5
60°-70°	4.0	0.4
70°-80°	2.3	0.2
80°-90°	0.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1073.0	96.8
0°-40°	1087.7	98.2
0°-60°	1101.1	99.4
0°-90°	1108.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1108.1	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	15098	15098	15098	15098	15098	
5°	9823	9722	9696	9763	9772	717
15°	853	869	870	854	843	293
25°	100	114	128	113	102	53
35°	20	21	22	21	19	13
45°	10	10	10	10	10	8
55°	6	6	6	6	6	6
65°	4	4	4	4	4	4
75°	2	2	2	2	3	2
85°	1	1	1	1	1	1
90°	0	0	0	0	0	



TEST NUMBER: P759976

CATALOG NUMBER: LD6D10D010-EU6DR150210IC9035-6LBS1MW

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	15097.8	15097.8	15097.8	15097.8	15097.8
2.5°	13618.8	13630.4	13634.8	13648.2	13698.1
5°	9823.0	9722.0	9695.8	9762.9	9772.5
7.5°	5818.8	5839.2	5914.0	5930.6	5870.5
10°	3193.2	3219.4	3215.5	3238.5	3264.7
12.5°	1633.0	1612.6	1606.2	1632.4	1595.9
15°	853.3	869.2	869.9	854.5	843.0
17.5°	458.9	477.4	508.1	483.2	444.8
20°	271.0	287.6	313.8	293.4	276.7
22.5°	167.5	180.9	199.4	183.4	170.0
25°	100.3	113.8	127.8	113.1	101.6
27.5°	59.4	70.9	79.9	70.3	58.8
30°	38.3	44.7	50.5	44.1	39.0
32.5°	26.8	29.4	32.0	29.4	26.8
35°	19.8	21.1	22.4	21.1	19.2
37.5°	15.3	16.6	17.3	16.0	14.7
40°	12.8	13.4	14.1	13.4	12.8
42.5°	10.9	11.5	11.5	11.5	10.9
45°	9.6	9.6	10.2	9.6	9.6
47.5°	8.3	8.3	8.9	8.3	8.3
50°	7.7	7.7	7.7	7.7	7.7
52.5°	7.0	7.0	7.0	7.0	7.0
55°	6.4	6.4	6.4	6.4	6.4
57.5°	5.8	5.8	5.8	5.8	5.8
60°	5.1	5.1	5.1	5.1	5.1
62.5°	4.5	4.5	4.5	4.5	4.5
65°	3.8	3.8	3.8	3.8	3.8
67.5°	3.8	3.8	3.8	3.8	3.8
70°	3.2	3.2	3.2	3.2	3.2
72.5°	2.6	2.6	2.6	2.6	2.6
75°	1.9	1.9	1.9	1.9	2.6
77.5°	1.9	1.9	1.9	1.9	1.9
80°	1.3	1.3	1.3	1.3	1.3
82.5°	1.3	1.3	1.3	1.3	1.3
85°	0.6	0.6	0.6	0.6	0.6
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report







— 0°-180°    - - 45°-225°    - - - - 90°-270°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)