

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P760829

Luminaire Tested: LD6D10D010-EU6DR700210IC9035-6LBDP1LI

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P760829
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D10D010-EU6DR700210IC9035-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1163.0 lumens
Efficiency: N/A
Efficacy: 99.4 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P760829

CATALOG NUMBER: LD6D10D010-EU6DR700210IC9035-6LBDP1LI

Luminous Intensity Polar Plot

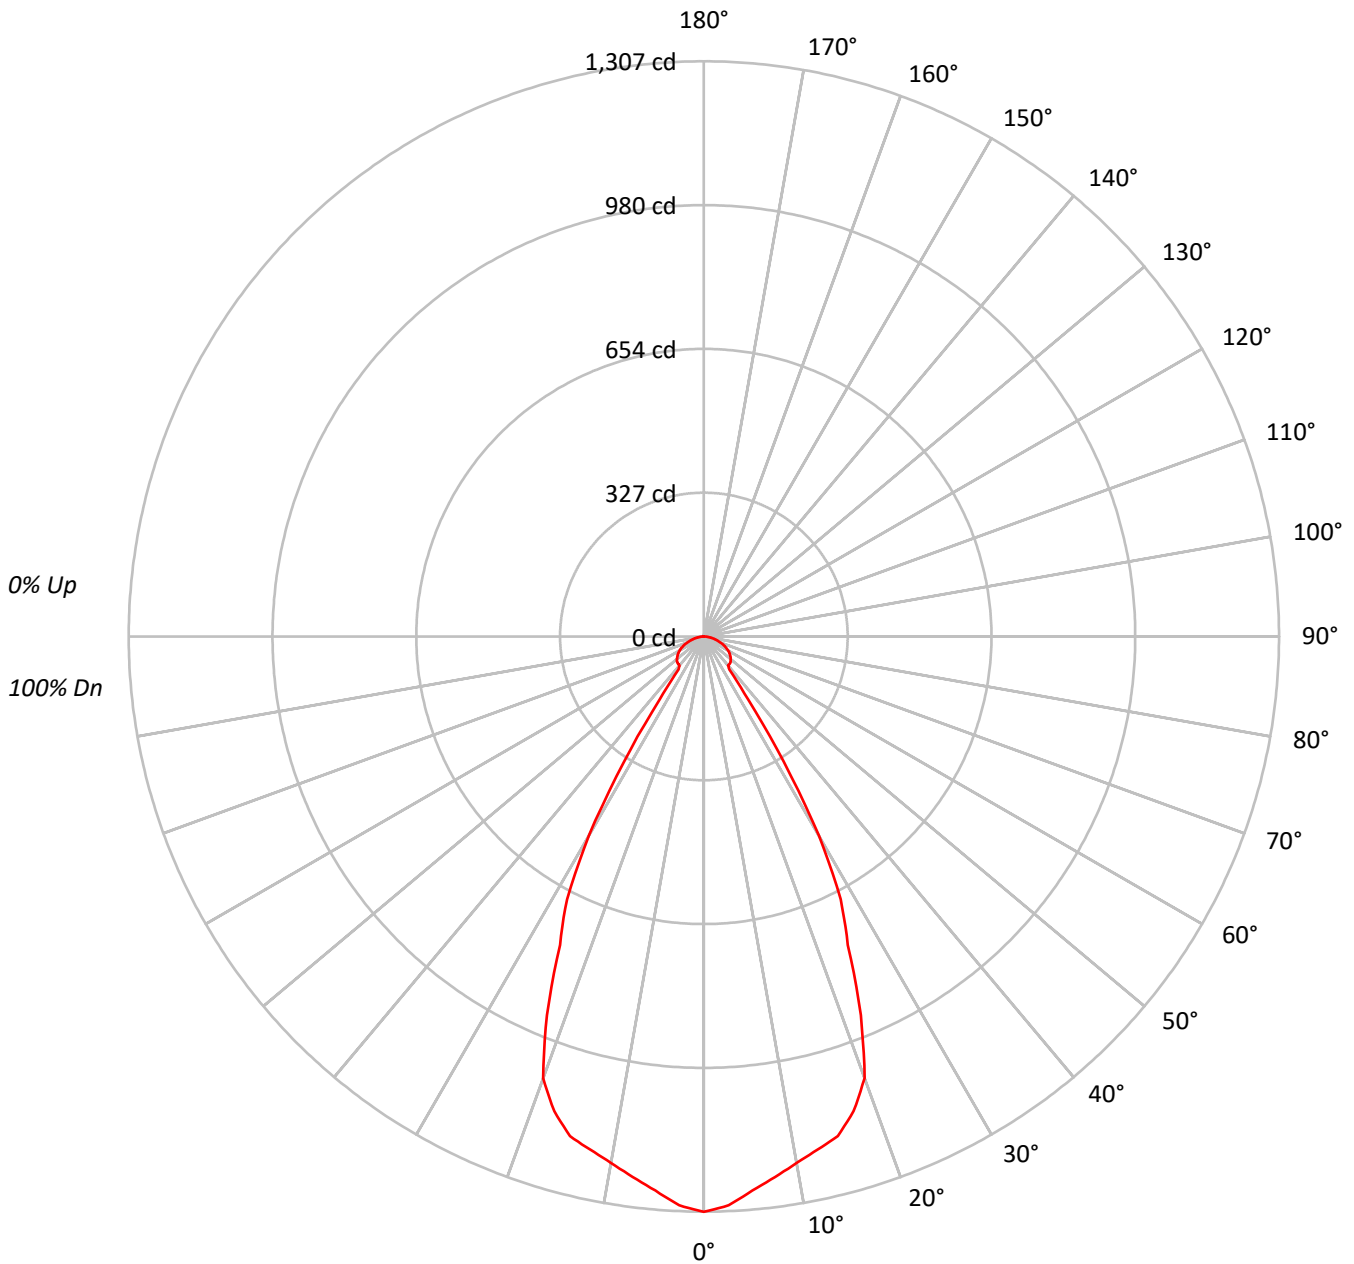



TEST NUMBER: P760829

CATALOG NUMBER: LD6D10D010-EU6DR700210IC9035-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91																			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83																			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76																			
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70																			
5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65																			
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61																			
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57																			
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53																			
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50																			
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	142848
5°	138611
10°	134744
15°	132978
20°	124168
25°	93286
30°	65946
35°	23369
40°	12280
45°	13088
50°	13547
55°	13811
60°	13876
65°	13599
70°	12842
75°	11862
80°	10571
85°	8525

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 57.5°
 Luminance: 13889 cd/sqm



TEST NUMBER: P760829

CATALOG NUMBER: LD6D10D010-EU6DR700210IC9035-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	119.2	10.2
10°-20°	327.0	28.1
20°-30°	360.1	31.0
30°-40°	137.6	11.8
40°-50°	65.0	5.6
50°-60°	64.6	5.6
60°-70°	51.7	4.4
70°-80°	29.7	2.6
80°-90°	8.1	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	806.3	69.3
0°-40°	943.9	81.2
0°-60°	1073.4	92.3
0°-90°	1163.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1163.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1307	
5°	1264	119
15°	1176	327
25°	774	360
35°	175	138
45°	85	65
55°	72	65
65°	53	52
75°	28	30
85°	7	8
90°	0	



TEST NUMBER: P760829

CATALOG NUMBER: LD6D10D010-EU6DR700210IC9035-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1307.4
2.5°	1293.8
5°	1263.8
7.5°	1238.7
10°	1214.5
12.5°	1194.0
15°	1175.6
17.5°	1131.1
20°	1067.9
22.5°	931.7
25°	773.8
27.5°	673.6
30°	522.7
32.5°	337.6
35°	175.2
37.5°	94.6
40°	86.1
42.5°	85.5
45°	84.7
47.5°	82.8
50°	79.7
52.5°	76.2
55°	72.5
57.5°	68.3
60°	63.5
62.5°	58.2
65°	52.6
67.5°	46.4
70°	40.2
72.5°	34.0
75°	28.1
77.5°	22.2
80°	16.8
82.5°	11.8
85°	6.8
87.5°	2.7
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)