

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P760769

Luminaire Tested: LD6D10D010-EU6DR650210IC9040-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P760769
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D10D010-EU6DR650210IC9040-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 988.2 lumens
Efficiency: N/A
Efficacy: 84.5 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P760769
CATALOG NUMBER: LD6D10D010-EU6DR650210IC9040-6LBS1MW

Luminous Intensity Polar Plot

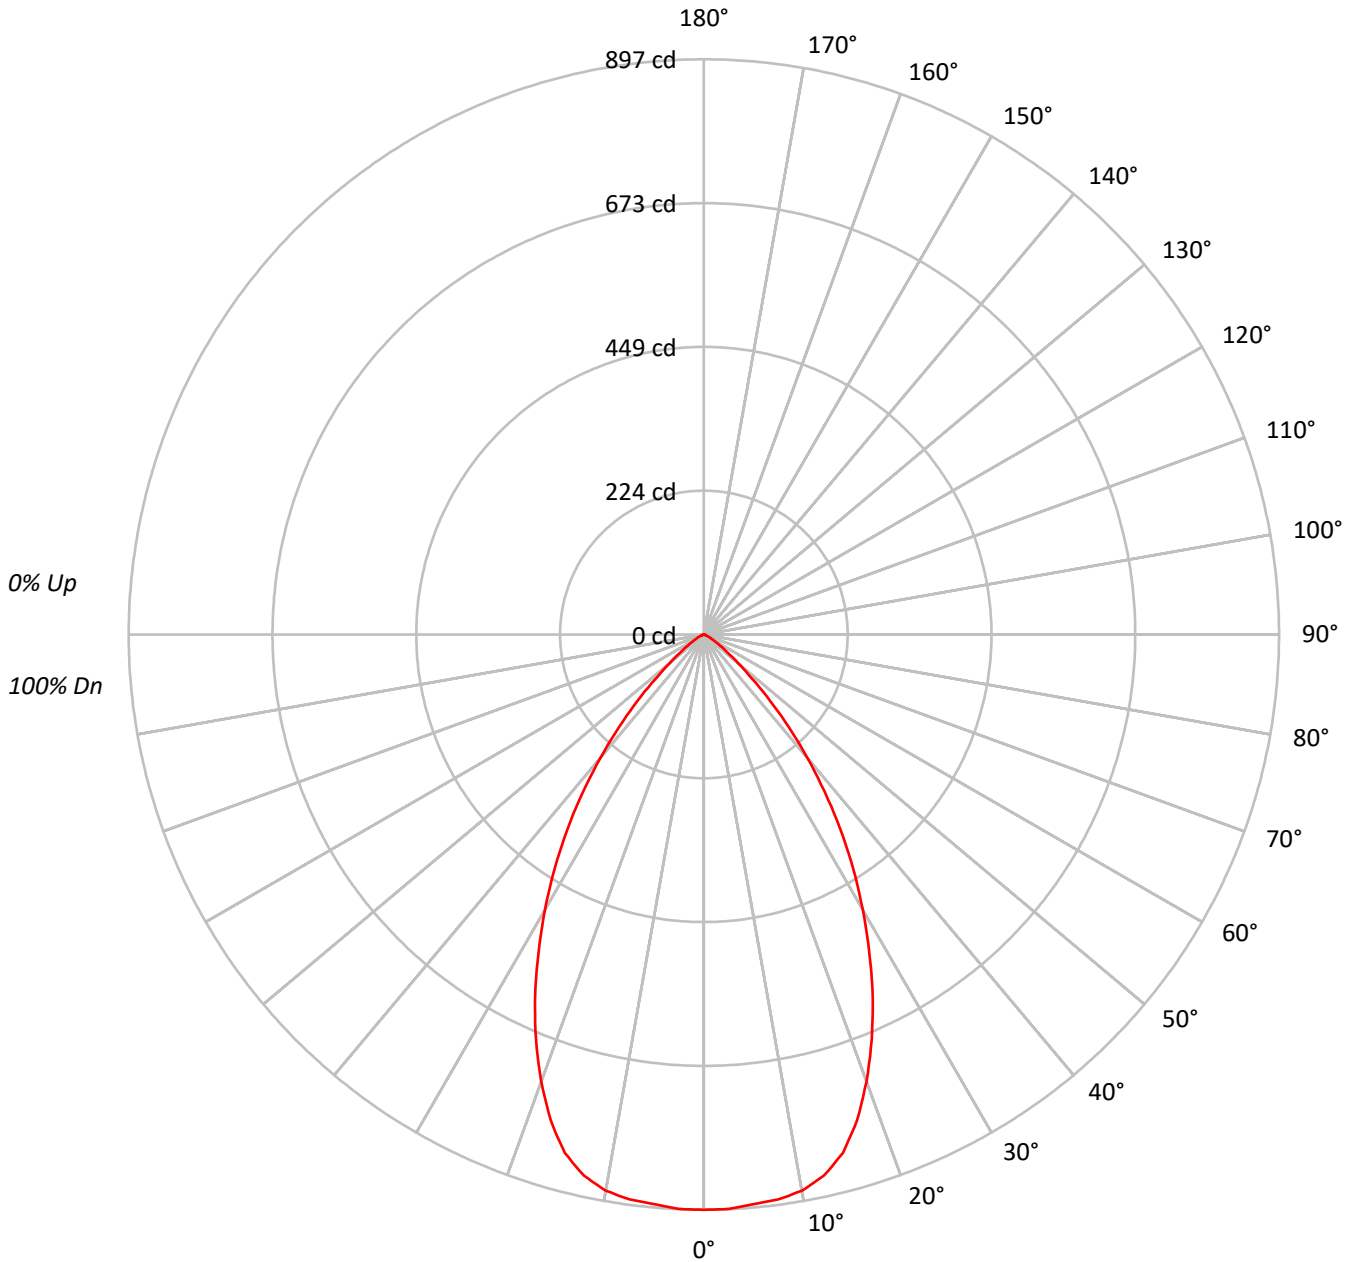



TEST NUMBER: P760769

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9040-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61			61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	52406
5°	52272
10°	52230
15°	50615
20°	46086
25°	40154
30°	33403
35°	26466
40°	19106
45°	12067
50°	6288
55°	3340
60°	1752
65°	967
70°	393
75°	451
80°	303
85°	268

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 12067 cd/sqm



TEST NUMBER: P760769

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9040-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	84.9	8.6
10°-20°	232.4	23.5
20°-30°	284.0	28.7
30°-40°	230.5	23.3
40°-50°	114.8	11.6
50°-60°	32.0	3.2
60°-70°	7.3	0.7
70°-80°	1.9	0.2
80°-90°	0.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	601.3	60.8
0°-40°	831.7	84.2
0°-60°	978.6	99.0
0°-90°	988.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	988.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	897	
5°	892	85
15°	837	232
25°	623	284
35°	371	230
45°	146	115
55°	33	32
65°	7	7
75°	2	2
85°	0	1
90°	0	



TEST NUMBER: P760769

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9040-6LBS1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	897.3
2.5°	896.6
5°	891.6
7.5°	888.7
10°	880.7
12.5°	864.4
15°	837.1
17.5°	794.7
20°	741.5
22.5°	683.9
25°	623.1
27.5°	558.2
30°	495.3
32.5°	433.2
35°	371.2
37.5°	309.3
40°	250.6
42.5°	195.4
45°	146.1
47.5°	101.8
50°	69.2
52.5°	47.7
55°	32.8
57.5°	22.2
60°	15.0
62.5°	10.4
65°	7.0
67.5°	3.6
70°	2.3
72.5°	2.2
75°	2.0
77.5°	1.3
80°	0.9
82.5°	0.7
85°	0.4
87.5°	0.3
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)