

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P757734

Luminaire Tested: LD6D02D010-EU6DR650210IC9050-6LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P757734
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D02D010-EU6DR650210IC9050-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 340.5 lumens
Efficiency: N/A
Efficacy: 66.8 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 5.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P757734

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9050-6LBDP1H

Luminous Intensity Polar Plot

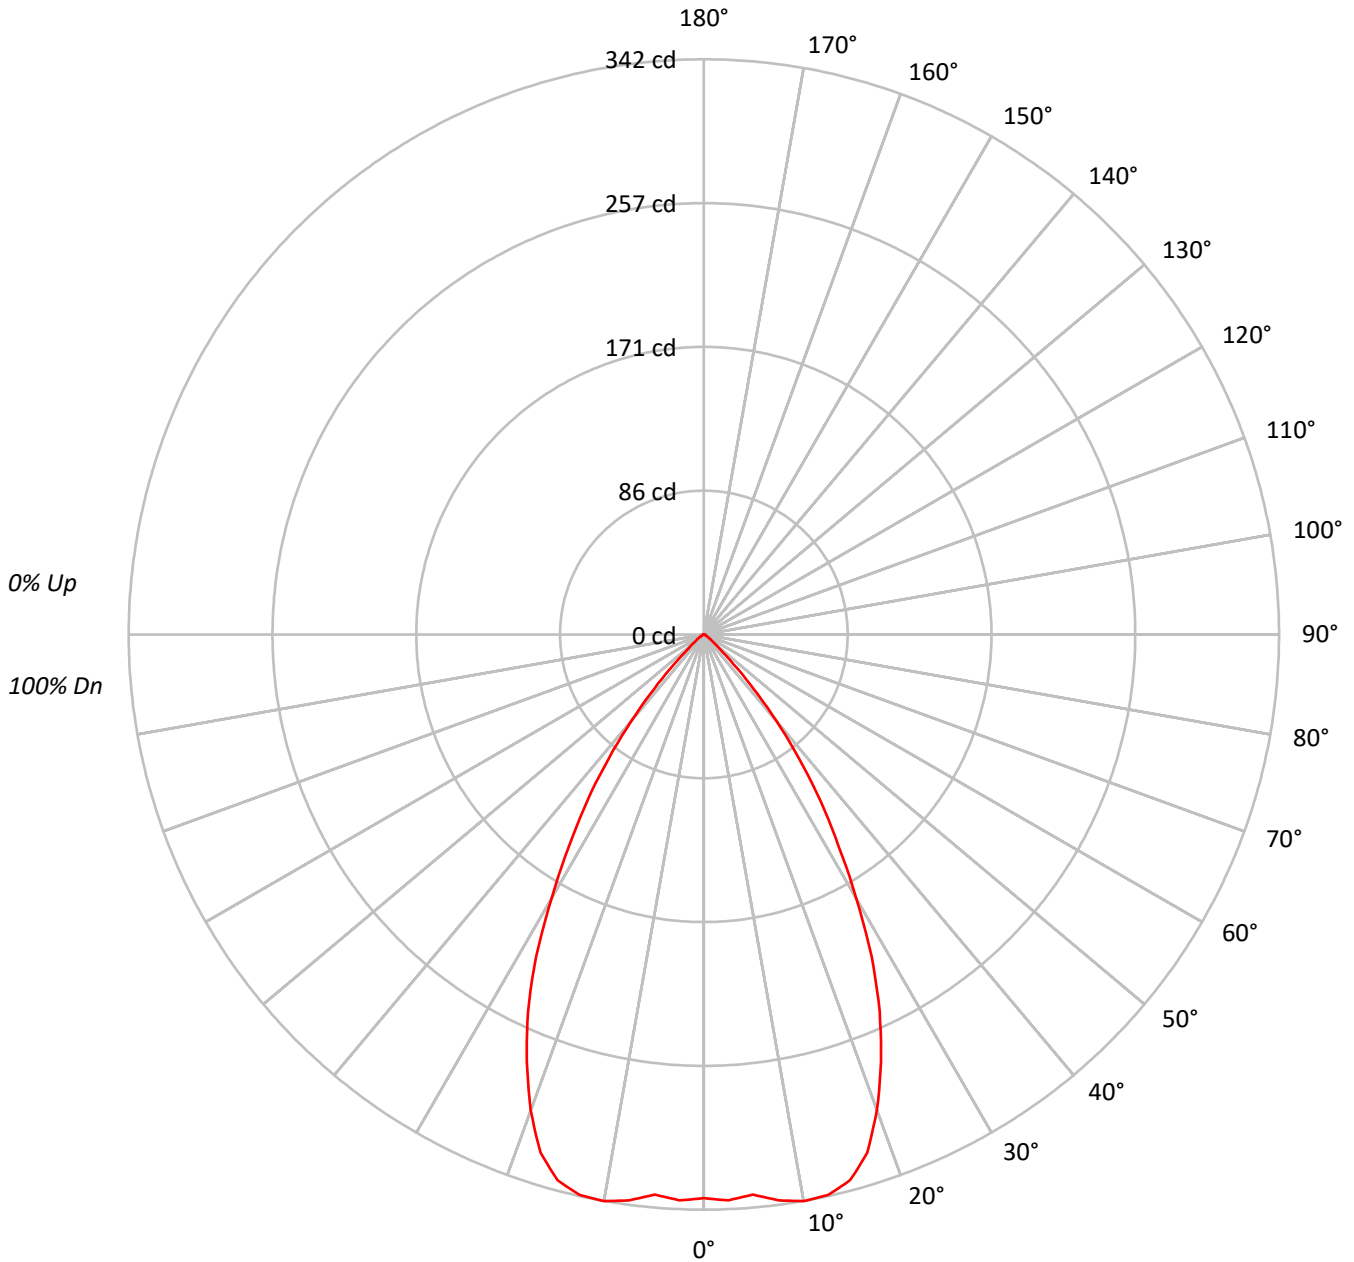



TEST NUMBER: P757734

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9050-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	36624
5°	36665
10°	37955
15°	38007
20°	34998
25°	29813
30°	22823
35°	16126
40°	9513
45°	3863
50°	1411
55°	781
60°	459
65°	259
70°	256
75°	211
80°	189
85°	125

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 3863 cd/sqm



TEST NUMBER: P757734

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9050-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	32.3	9.5
10°-20°	93.1	27.3
20°-30°	111.7	32.8
30°-40°	75.1	22.0
40°-50°	22.5	6.6
50°-60°	4.0	1.2
60°-70°	1.1	0.3
70°-80°	0.5	0.2
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	237.1	69.6
0°-40°	312.2	91.7
0°-60°	338.6	99.5
0°-90°	340.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	340.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	335	
5°	334	32
15°	336	93
25°	247	112
35°	121	75
45°	25	22
55°	4	4
65°	1	1
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P757734

CATALOG NUMBER: LD6D02D010-EU6DR650210IC9050-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	335.2
2.5°	336.7
5°	334.3
7.5°	339.3
10°	342.1
12.5°	341.4
15°	336.0
17.5°	323.0
20°	301.0
22.5°	275.1
25°	247.3
27.5°	216.1
30°	180.9
32.5°	149.1
35°	120.9
37.5°	93.0
40°	66.7
42.5°	43.6
45°	25.0
47.5°	13.2
50°	8.3
52.5°	5.7
55°	4.1
57.5°	3.0
60°	2.1
62.5°	1.3
65°	1.0
67.5°	0.9
70°	0.8
72.5°	0.6
75°	0.5
77.5°	0.4
80°	0.3
82.5°	0.2
85°	0.1
87.5°	0.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)