

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P762947

Luminaire Tested: LD6D25D010-EU6DR2015309024-6LBS1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P762947  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D25D010-EU6DR2015309024-6LBS1MW  
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 20° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2621.4 lumens  
Efficiency: N/A  
Efficacy: 104.4 lumens/watt  
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 25.1  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P762947

CATALOG NUMBER: LD6D25D010-EU6DR2015309024-6LBS1MW

### Luminous Intensity Polar Plot

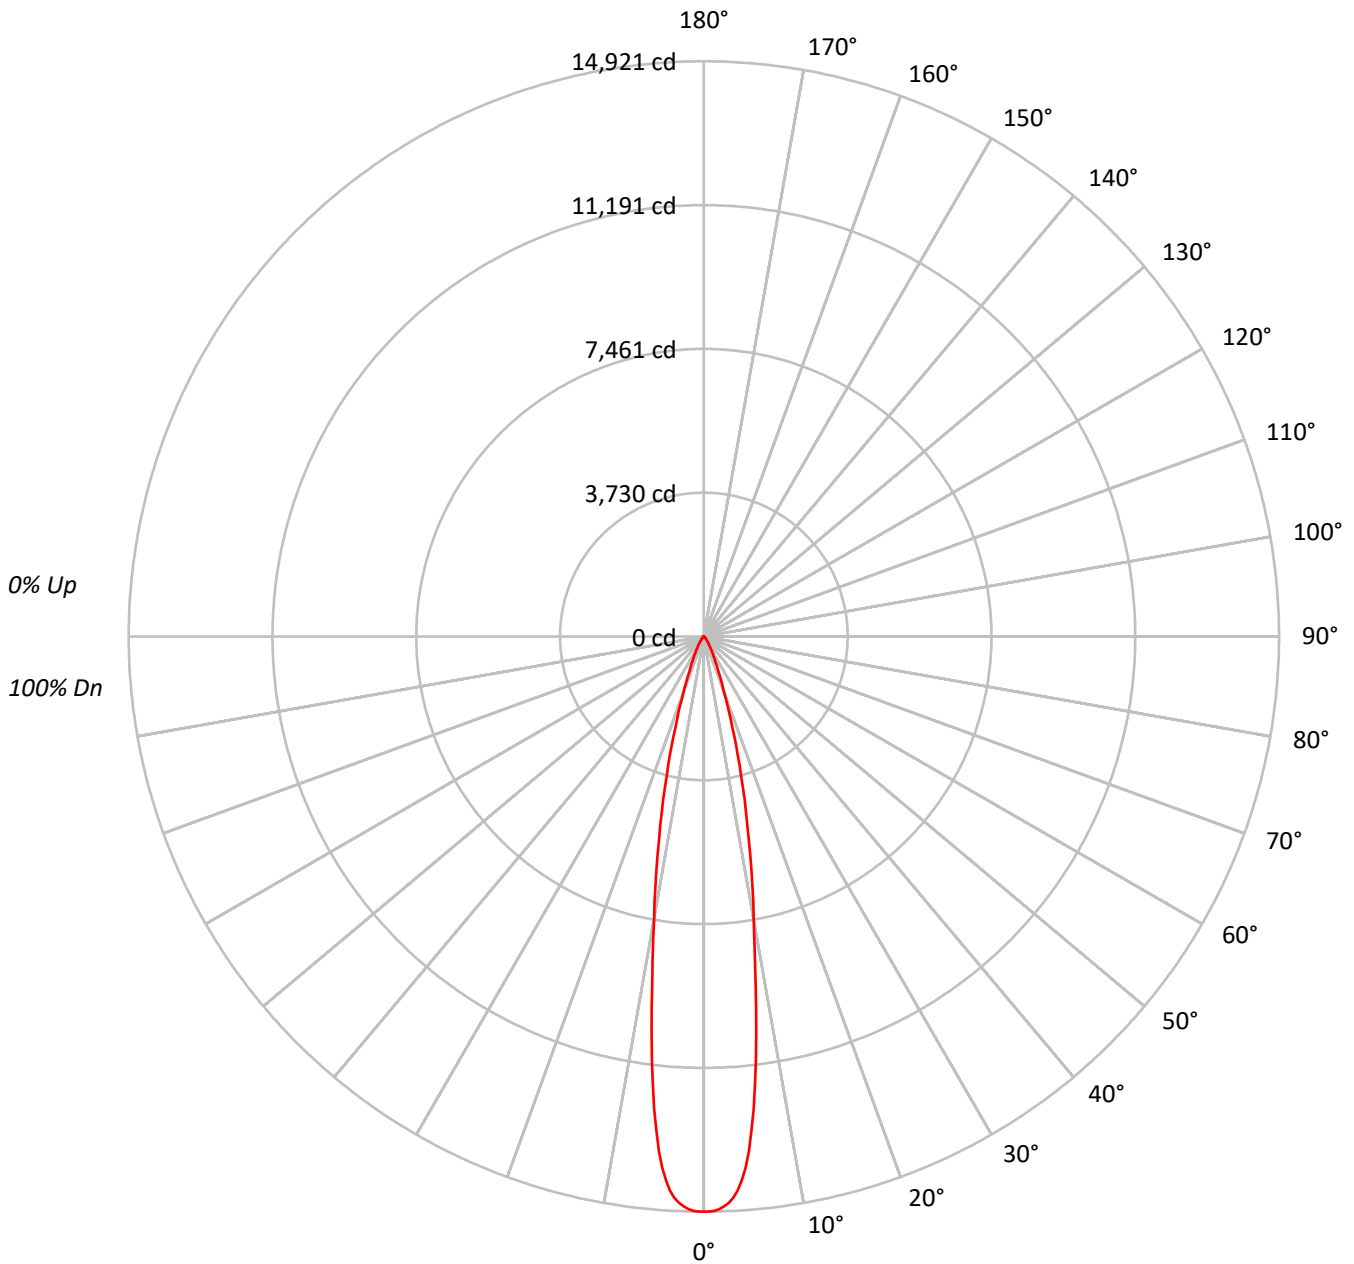



TEST NUMBER: P762947

CATALOG NUMBER: LD6D25D010-EU6DR2015309024-6LBS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	100	99	98	98	96	95	94													
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	98	96	95	98	96	95	94													
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	98	96	95	98	96	95	94													
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	93	91	89	93	91	89	88													
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	91	88	86	91	88	86	85													
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	88	86	84	88	86	84	83													
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	86	84	82	86	84	82	81													
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	84	82	80	84	82	80	79													
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	82	80	78	82	80	78	77													
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	81	78	76	81	78	76	75													

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1630236
5°	1470773
10°	825485
15°	419612
20°	177653
25°	82014
30°	43413
35°	23395
40°	12509
45°	7386
50°	4283
55°	2286
60°	1442
65°	1034
70°	415
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 7386 cd/sqm



TEST NUMBER: P762947

CATALOG NUMBER: LD6D25D010-EU6DR2015309024-6LBS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1062.3	40.5
10°-20°	1046.0	39.9
20°-30°	341.7	13.0
30°-40°	116.3	4.4
40°-50°	39.1	1.5
50°-60°	11.8	0.4
60°-70°	3.9	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2450.1	93.5
0°-40°	2566.4	97.9
0°-60°	2617.3	99.8
0°-90°	2621.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2621.4	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	14921	
5°	13410	###
15°	3710	1046
25°	680	342
35°	175	116
45°	48	39
55°	12	12
65°	4	4
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P762947

CATALOG NUMBER: LD6D25D010-EU6DR2015309024-6LBS1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	14920.6
0.5°	14920.6
1°	14902.0
1.5°	14864.8
2°	14797.0
2.5°	14706.7
3°	14579.1
3.5°	14401.1
4°	14136.7
4.5°	13815.2
5°	13409.9
5.5°	12877.1
6°	12331.1
6.5°	11705.3
7°	11092.8
7.5°	10375.3
8°	9734.9
8.5°	9090.5
9°	8495.3
9.5°	7949.2
10°	7440.4
12.5°	5342.4
15°	3709.6
17.5°	2423.4
20°	1527.9
22.5°	989.8
25°	680.3
27.5°	478.3
30°	344.1
32.5°	247.1
35°	175.4
37.5°	122.2
40°	87.7
42.5°	63.8
45°	47.8
47.5°	37.2
50°	25.2
52.5°	15.9
55°	12.0
57.5°	9.3
60°	6.6
62.5°	5.3
65°	4.0



TEST NUMBER: P762947  
CATALOG NUMBER: LD6D25D010-EU6DR2015309024-6LBS1MW

**CANDELA DISTRIBUTION (continued):**

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





67.5°		2.7
70°		1.3

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)