

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P762993

Luminaire Tested: LD6D25D010-EU6DR2015309040-6LBDP1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P762993
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D25D010-EU6DR2015309040-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3259.8 lumens
Efficiency: N/A
Efficacy: 129.9 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P762993

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBDP1H

Luminous Intensity Polar Plot

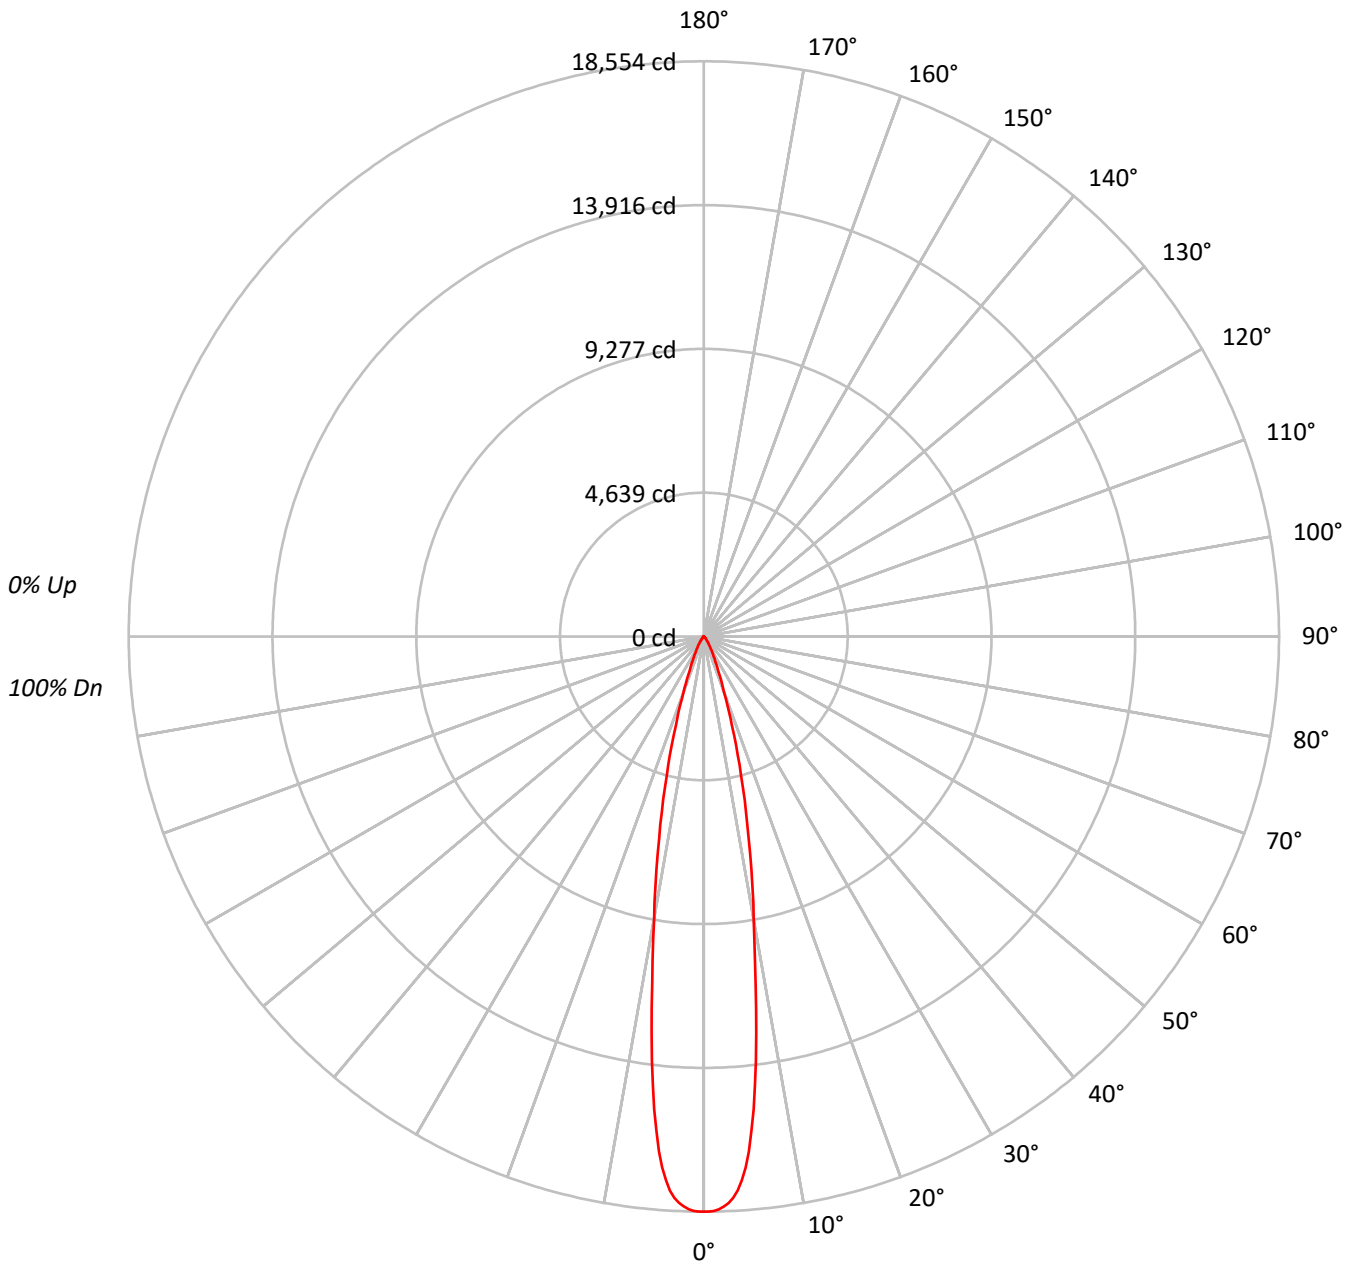



TEST NUMBER: P762993

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	100	99	98	97	98	96	95	94												
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	98	96	95	94	93	92	91	94												
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	98	96	95	94	93	92	91	94												
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	98	96	95	94	93	92	91	88												
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	98	96	95	94	93	92	91	85												
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	98	96	95	94	93	92	91	83												
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	98	96	95	94	93	92	91	81												
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	98	96	95	94	93	92	91	79												
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	98	96	95	94	93	92	91	77												
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	98	96	95	94	93	92	91	75												

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2027191
5°	1828904
10°	1026486
15°	521777
20°	220918
25°	101978
30°	53985
35°	29091
40°	15547
45°	9194
50°	5337
55°	2838
60°	1814
65°	1293
70°	543
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9194 cd/sqm



TEST NUMBER: P762993

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1321.0	40.5
10°-20°	1300.8	39.9
20°-30°	424.9	13.0
30°-40°	144.7	4.4
40°-50°	48.7	1.5
50°-60°	14.7	0.4
60°-70°	4.9	0.2
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3046.7	93.5
0°-40°	3191.4	97.9
0°-60°	3254.7	99.8
0°-90°	3259.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3259.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	18554	
5°	16675	###
15°	4613	1301
25°	846	425
35°	218	145
45°	60	49
55°	15	15
65°	5	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P762993

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	18553.7
0.5°	18553.7
1°	18530.5
1.5°	18484.3
2°	18400.0
2.5°	18287.7
3°	18129.1
3.5°	17907.7
4°	17578.9
4.5°	17179.1
5°	16675.2
5.5°	16012.7
6°	15333.6
6.5°	14555.5
7°	13793.8
7.5°	12901.7
8°	12105.3
8.5°	11304.0
9°	10563.9
9.5°	9884.8
10°	9252.1
12.5°	6643.3
15°	4612.8
17.5°	3013.5
20°	1900.0
22.5°	1230.9
25°	845.9
27.5°	594.8
30°	427.9
32.5°	307.3
35°	218.1
37.5°	152.0
40°	109.0
42.5°	79.3
45°	59.5
47.5°	46.3
50°	31.4
52.5°	19.8
55°	14.9
57.5°	11.6
60°	8.3
62.5°	6.6
65°	5.0



TEST NUMBER: P762993
CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBDP1H

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





67.5°		3.3
70°		1.7

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)