

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P762994

Luminaire Tested: LD6D25D010-EU6DR2015309040-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P762994
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D25D010-EU6DR2015309040-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3422.8 lumens
Efficiency: N/A
Efficacy: 136.4 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 25.1
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P762994

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBDP1LI

Luminous Intensity Polar Plot

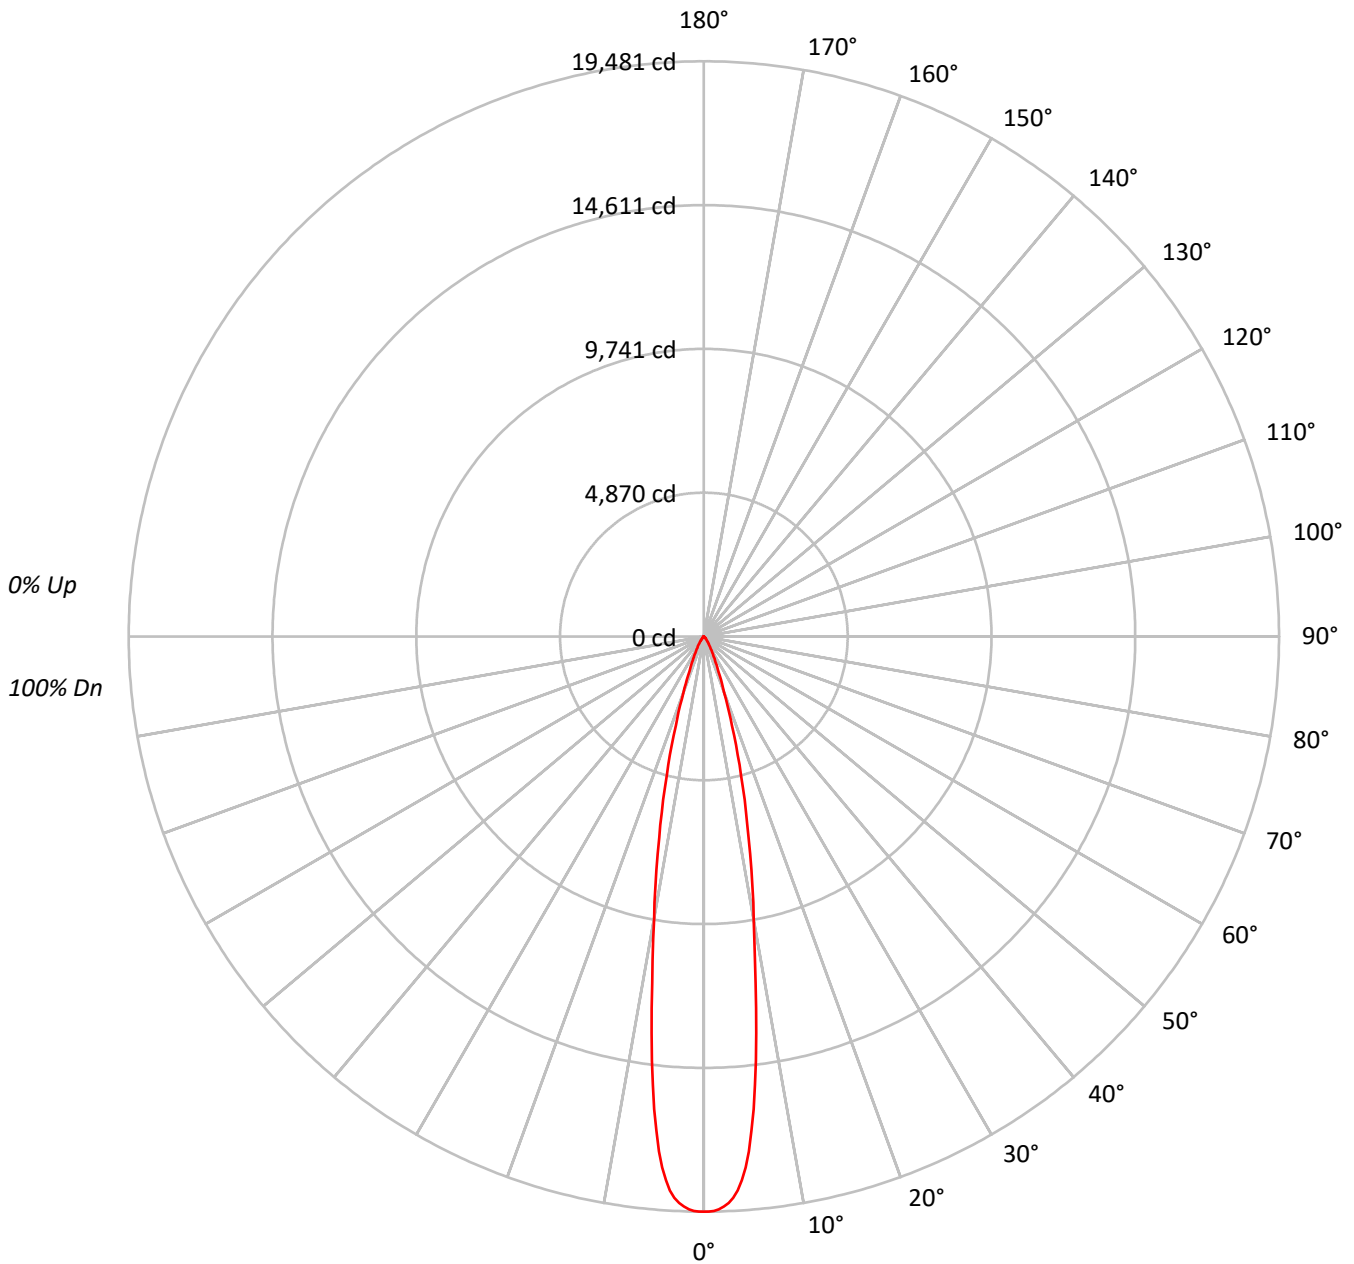



TEST NUMBER: P762994

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2128552
5°	1920343
10°	1077810
15°	547873
20°	231964
25°	107078
30°	56685
35°	30545
40°	16331
45°	9657
50°	5609
55°	2972
60°	1901
65°	1344
70°	543
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9657 cd/sqm



TEST NUMBER: P762994

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1387.0	40.5
10°-20°	1365.8	39.9
20°-30°	446.2	13.0
30°-40°	151.9	4.4
40°-50°	51.1	1.5
50°-60°	15.4	0.4
60°-70°	5.1	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3199.0	93.5
0°-40°	3350.9	97.9
0°-60°	3417.4	99.8
0°-90°	3422.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3422.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	19481	
5°	17509	###
15°	4844	1366
25°	888	446
35°	229	152
45°	62	51
55°	16	15
65°	5	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P762994

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	19481.4
0.5°	19481.4
1°	19457.1
1.5°	19408.5
2°	19320.0
2.5°	19202.1
3°	19035.5
3.5°	18803.1
4°	18457.9
4.5°	18038.0
5°	17508.9
5.5°	16813.3
6°	16100.3
6.5°	15283.2
7°	14483.5
7.5°	13546.7
8°	12710.6
8.5°	11869.2
9°	11092.1
9.5°	10379.1
10°	9714.7
12.5°	6975.5
15°	4843.5
17.5°	3164.2
20°	1995.0
22.5°	1292.4
25°	888.2
27.5°	624.5
30°	449.3
32.5°	322.7
35°	229.0
37.5°	159.6
40°	114.5
42.5°	83.3
45°	62.5
47.5°	48.6
50°	33.0
52.5°	20.8
55°	15.6
57.5°	12.1
60°	8.7
62.5°	6.9
65°	5.2



TEST NUMBER: P762994
CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBDP1LI

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





67.5°		3.5
70°		1.7

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)