

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P762999

Luminaire Tested: LD6D25D010-EU6DR2015309040-6LBS1MW

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P762999  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D25D010-EU6DR2015309040-6LBS1MW  
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 20° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 3259.8 lumens  
Efficiency: N/A  
Efficacy: 129.9 lumens/watt  
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 25.1  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P762999

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBS1MW

### Luminous Intensity Polar Plot

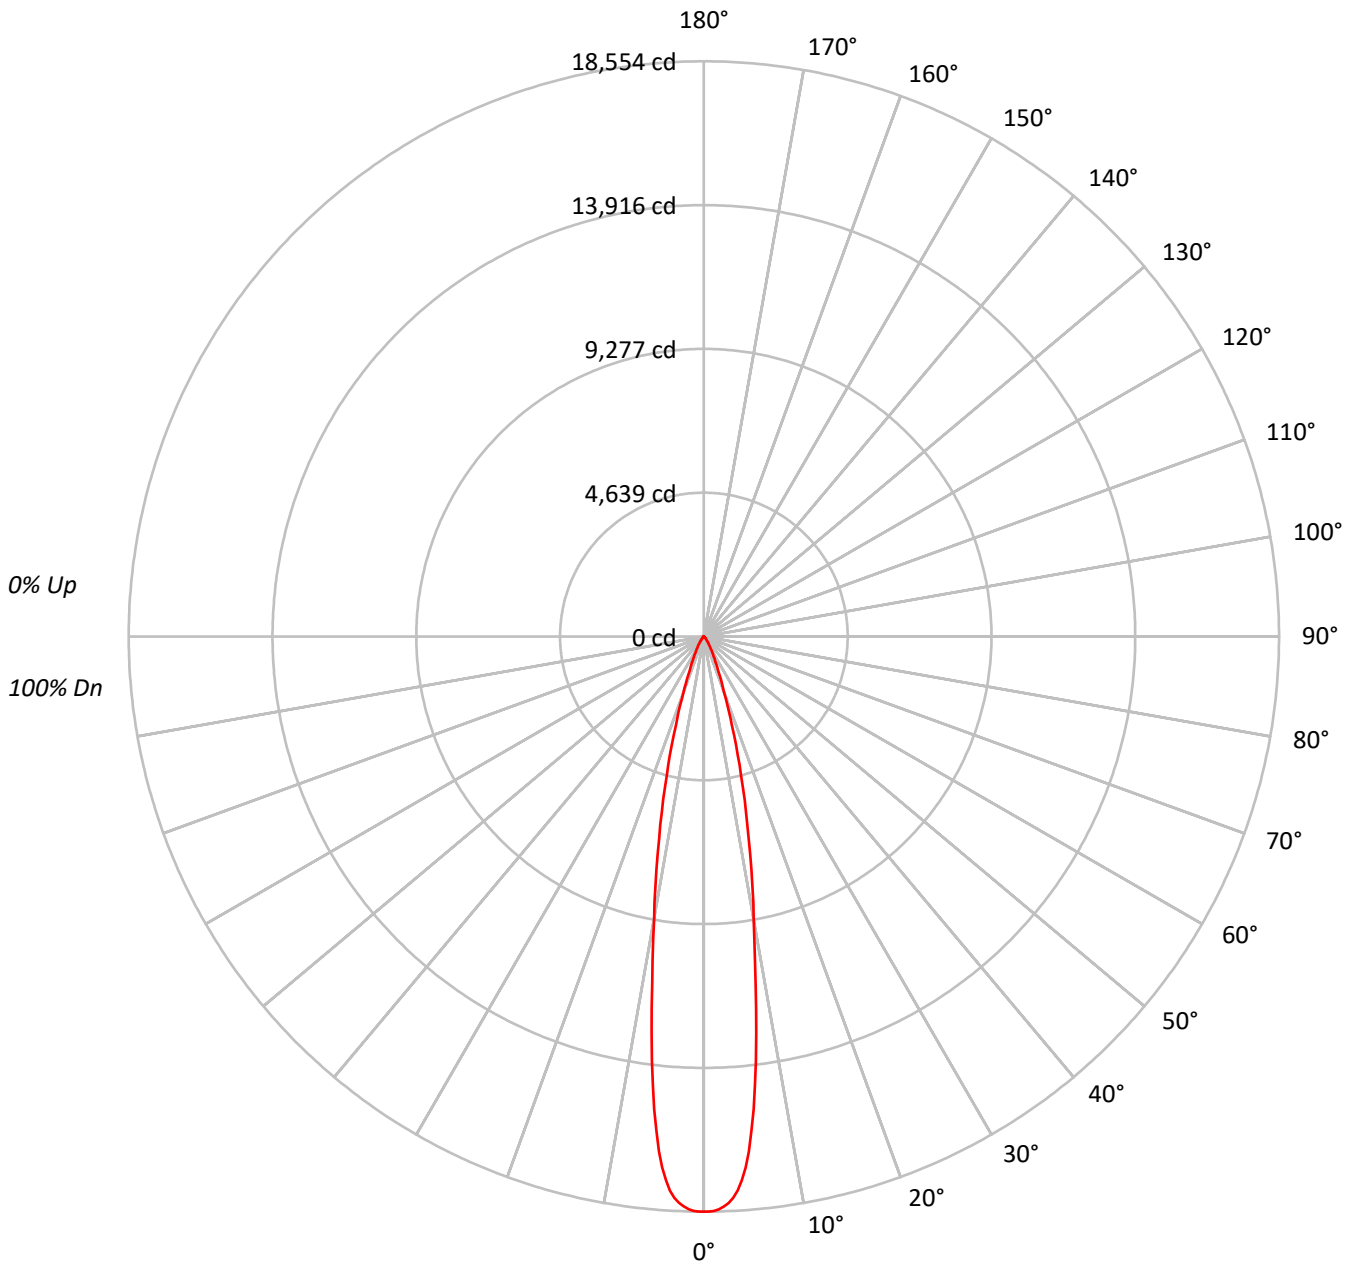



TEST NUMBER: P762999

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBS1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	97	97	98	98	97															
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	94	94	98	96	95															
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	91	91	98	93	92															
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	88	88	93	91	89															
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	85	85	91	88	86															
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	83	83	88	86	84															
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	81	81	86	84	82															
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	79	79	84	82	80															
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	77	77	82	80	78															
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	75	75	81	78	76															

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	2027191
5°	1828904
10°	1026486
15°	521777
20°	220918
25°	101978
30°	53985
35°	29091
40°	15547
45°	9194
50°	5337
55°	2838
60°	1814
65°	1293
70°	543
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 9194 cd/sqm



TEST NUMBER: P762999

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBS1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1321.0	40.5
10°-20°	1300.8	39.9
20°-30°	424.9	13.0
30°-40°	144.7	4.4
40°-50°	48.7	1.5
50°-60°	14.7	0.4
60°-70°	4.9	0.2
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3046.7	93.5
0°-40°	3191.4	97.9
0°-60°	3254.7	99.8
0°-90°	3259.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3259.8	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	18554	
5°	16675	###
15°	4613	1301
25°	846	425
35°	218	145
45°	60	49
55°	15	15
65°	5	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P762999

CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBS1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	18553.7
0.5°	18553.7
1°	18530.5
1.5°	18484.3
2°	18400.0
2.5°	18287.7
3°	18129.1
3.5°	17907.7
4°	17578.9
4.5°	17179.1
5°	16675.2
5.5°	16012.7
6°	15333.6
6.5°	14555.5
7°	13793.8
7.5°	12901.7
8°	12105.3
8.5°	11304.0
9°	10563.9
9.5°	9884.8
10°	9252.1
12.5°	6643.3
15°	4612.8
17.5°	3013.5
20°	1900.0
22.5°	1230.9
25°	845.9
27.5°	594.8
30°	427.9
32.5°	307.3
35°	218.1
37.5°	152.0
40°	109.0
42.5°	79.3
45°	59.5
47.5°	46.3
50°	31.4
52.5°	19.8
55°	14.9
57.5°	11.6
60°	8.3
62.5°	6.6
65°	5.0



TEST NUMBER: P762999  
CATALOG NUMBER: LD6D25D010-EU6DR2015309040-6LBS1MW

**CANDELA DISTRIBUTION (continued):**

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





67.5°		3.3
70°		1.7

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)