

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P766918

Luminaire Tested: LD6D45BD010-EU6DR6540509024-6LBDP1B

Issue Date: 2/5/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P766918  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/5/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D45BD010-EU6DR6540509024-6LBDP1B  
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 65° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 2742.7 lumens  
Efficiency: N/A  
Efficacy: 70.9 lumens/watt  
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct


Input Watts (W): 38.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT



Downlight

TEST NUMBER: P766918  
CATALOG NUMBER: LD6D45BD010-EU6DR6540509024-6LBDP1B

### Luminous Intensity Polar Plot

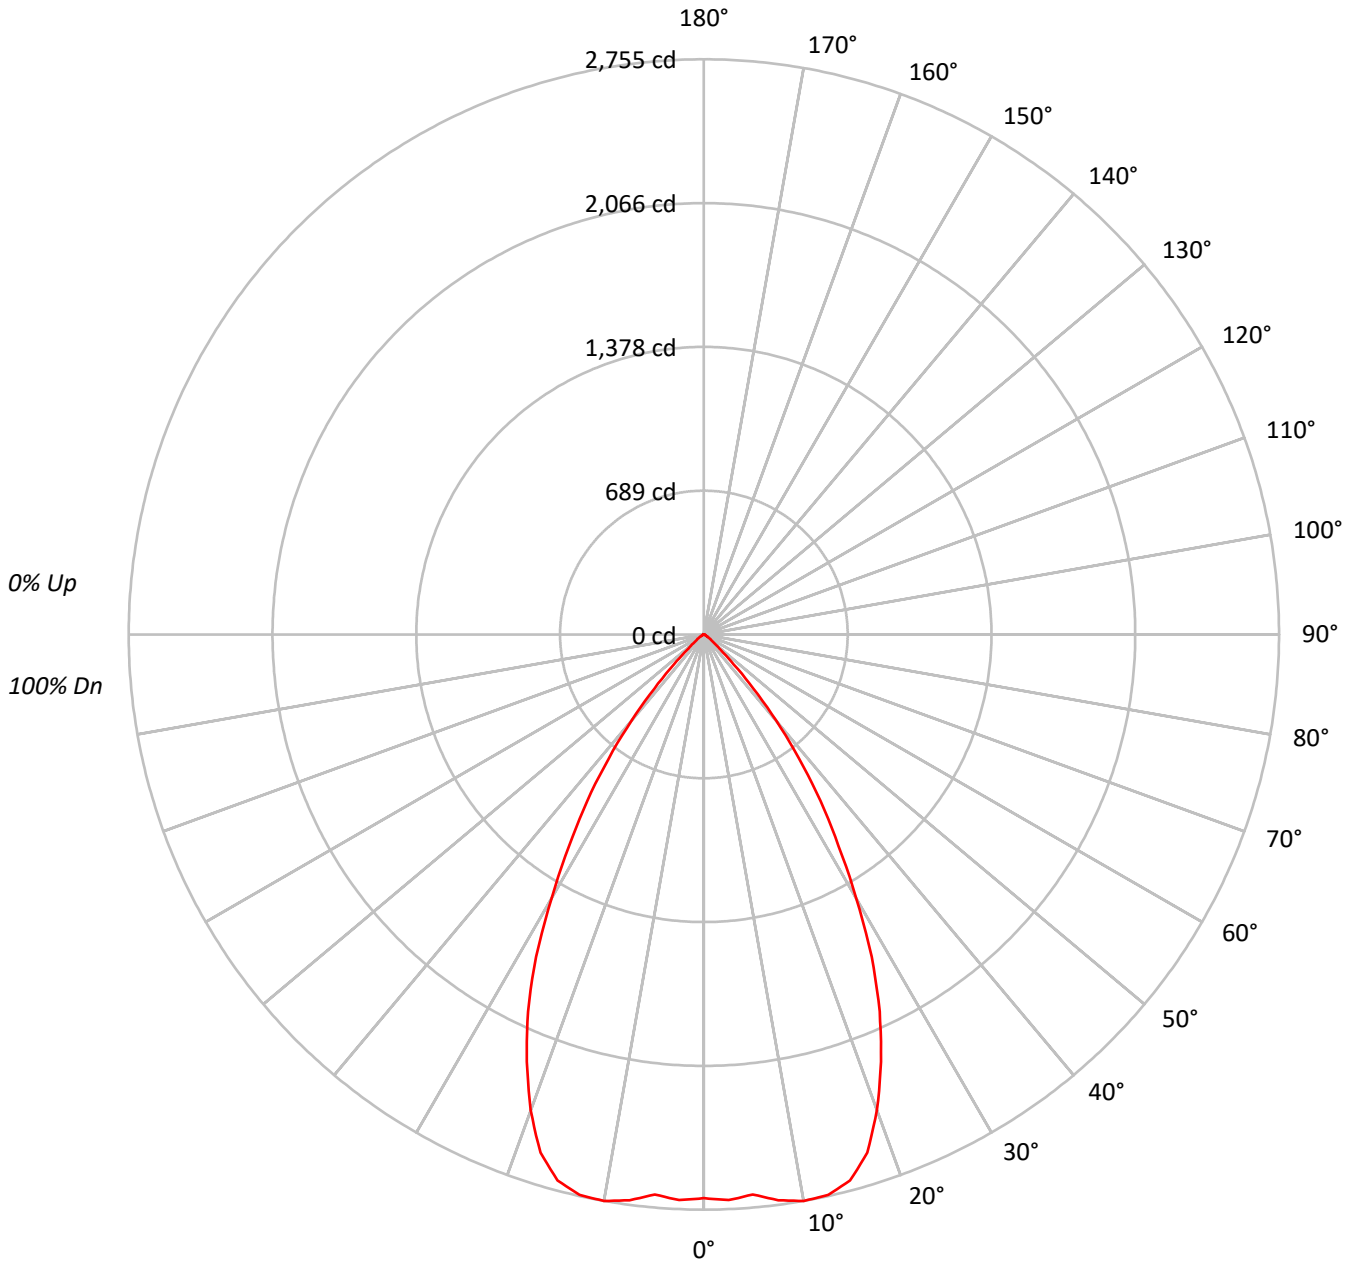



TEST NUMBER: P766918

CATALOG NUMBER: LD6D45BD010-EU6DR6540509024-6LBDP1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	295037
5°	295286
10°	305679
15°	306191
20°	281892
25°	240184
30°	183871
35°	129901
40°	76678
45°	31135
50°	11287
55°	6286
60°	3606
65°	1991
70°	2076
75°	1604
80°	1699
85°	1504

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 31135 cd/sqm



TEST NUMBER: P766918

CATALOG NUMBER: LD6D45BD010-EU6DR6540509024-6LBDP1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	260.0	9.5
10°-20°	750.0	27.3
20°-30°	899.9	32.8
30°-40°	604.8	22.0
40°-50°	181.0	6.6
50°-60°	31.9	1.2
60°-70°	9.1	0.3
70°-80°	4.5	0.2
80°-90°	1.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1909.9	69.6
0°-40°	2514.7	91.7
0°-60°	2727.7	99.5
0°-90°	2742.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	2742.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	2700	
5°	2692	260
15°	2707	750
25°	1992	900
35°	974	605
45°	202	181
55°	33	32
65°	8	9
75°	4	4
85°	1	1
90°	0	



TEST NUMBER: P766918

CATALOG NUMBER: LD6D45BD010-EU6DR6540509024-6LBDP1B

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	2700.3
2.5°	2711.8
5°	2692.3
7.5°	2733.0
10°	2755.2
12.5°	2749.8
15°	2706.9
17.5°	2601.7
20°	2424.4
22.5°	2215.7
25°	1992.3
27.5°	1740.2
30°	1457.4
32.5°	1201.1
35°	973.9
37.5°	749.4
40°	537.6
42.5°	351.1
45°	201.5
47.5°	106.7
50°	66.4
52.5°	46.0
55°	33.0
57.5°	23.8
60°	16.5
62.5°	10.7
65°	7.7
67.5°	6.9
70°	6.5
72.5°	5.0
75°	3.8
77.5°	3.5
80°	2.7
82.5°	1.9
85°	1.2
87.5°	0.8
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)