

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P766466

Luminaire Tested: LD6D45BD010-EU6DR3540509027-6LBDP1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P766466
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D45BD010-EU6DR3540509027-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4263.3 lumens
Efficiency: N/A
Efficacy: 110.2 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P766466

CATALOG NUMBER: LD6D45BD010-EU6DR3540509027-6LBDP1MW

Luminous Intensity Polar Plot

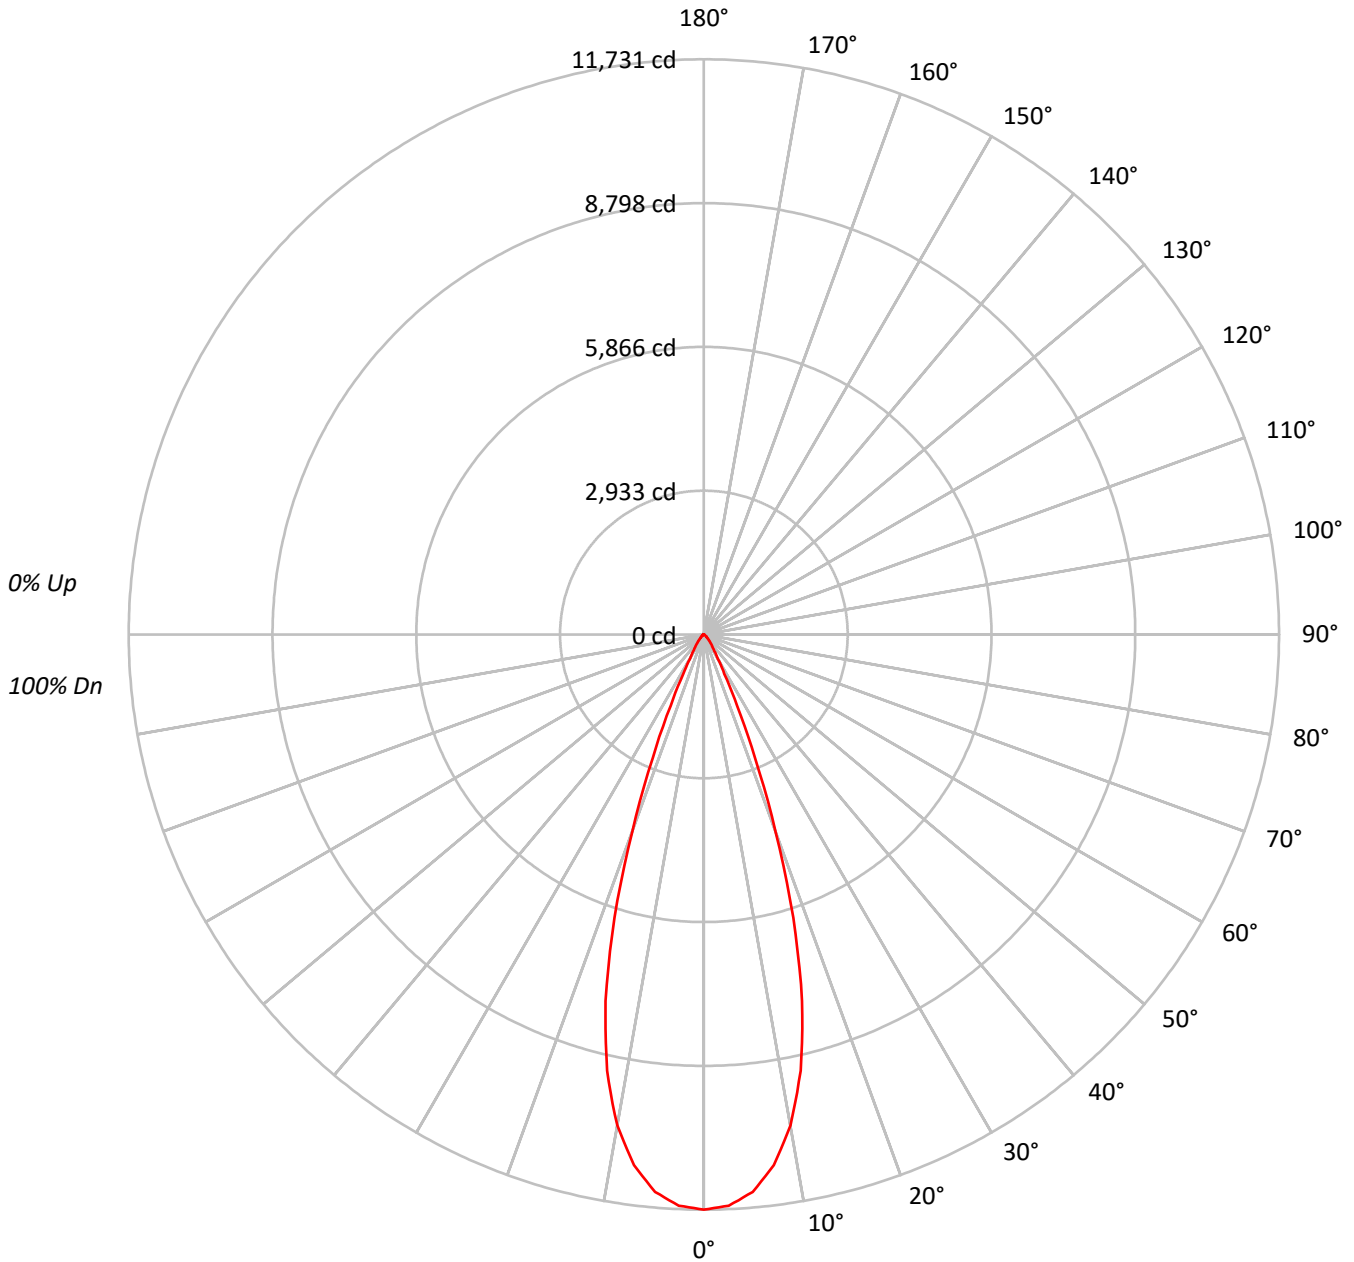



TEST NUMBER: P766466

CATALOG NUMBER: LD6D45BD010-EU6DR3540509027-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96			96
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92			92
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88			88
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84			84
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81			81
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78			78
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75			75
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72			72
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70			70
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68			68

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1281694
5°	1251581
10°	1128002
15°	875511
20°	496578
25°	193191
30°	72077
35°	39508
40°	25816
45°	15714
50°	10012
55°	7067
60°	5179
65°	2818
70°	192
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 15714 cd/sqm



TEST NUMBER: P766466

CATALOG NUMBER: LD6D45BD010-EU6DR3540509027-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1049.5	24.6
10°-20°	2049.1	48.1
20°-30°	835.7	19.6
30°-40°	200.0	4.7
40°-50°	83.3	2.0
50°-60°	34.5	0.8
60°-70°	10.8	0.3
70°-80°	0.2	0.0
80°-90°	0.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3934.3	92.3
0°-40°	4134.3	97.0
0°-60°	4252.1	99.7
0°-90°	4263.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4263.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11731	
5°	11411	###
15°	7740	2049
25°	1602	836
35°	296	200
45°	102	83
55°	37	35
65°	11	11
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P766466

CATALOG NUMBER: LD6D45BD010-EU6DR3540509027-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	11730.6
2.5°	11660.2
5°	11411.4
7.5°	10915.0
10°	10167.1
12.5°	9114.1
15°	7740.0
17.5°	6059.5
20°	4270.8
22.5°	2723.3
25°	1602.5
27.5°	905.8
30°	571.3
32.5°	401.1
35°	296.2
37.5°	229.0
40°	181.0
42.5°	139.5
45°	101.7
47.5°	76.1
50°	58.9
52.5°	46.7
55°	37.1
57.5°	30.1
60°	23.7
62.5°	17.3
65°	10.9
67.5°	3.8
70°	0.6
72.5°	0.6
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.6
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)