

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P766959

Luminaire Tested: LD6D45BD010-EU6DR6540509035-6LBDP1LI

Issue Date: 2/5/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P766959  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/5/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D45BD010-EU6DR6540509035-6LBDP1LI  
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 65° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 4559.3 lumens  
Efficiency: N/A  
Efficacy: 117.8 lumens/watt  
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 38.7  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P766959

CATALOG NUMBER: LD6D45BD010-EU6DR6540509035-6LBDP1LI

### Luminous Intensity Polar Plot

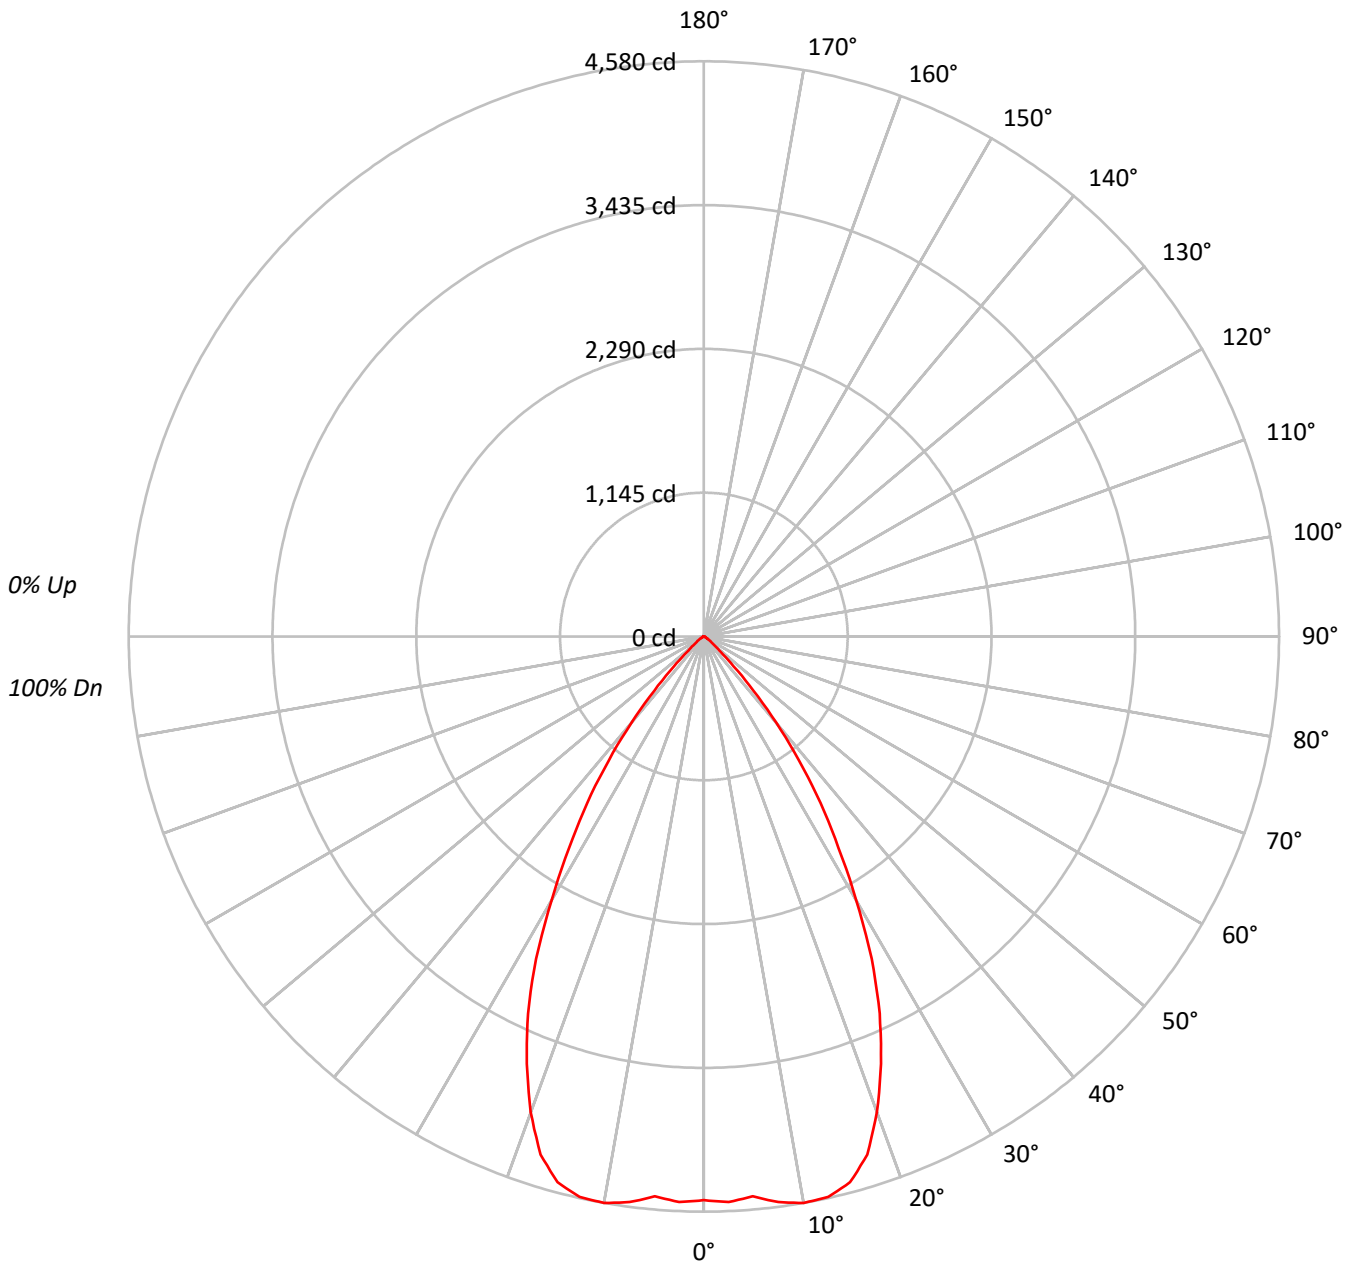



TEST NUMBER: P766959

CATALOG NUMBER: LD6D45BD010-EU6DR6540509035-6LBDP1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	490461
5°	490864
10°	508145
15°	508995
20°	468615
25°	399281
30°	305656
35°	215947
40°	127468
45°	51748
50°	18766
55°	10458
60°	5987
65°	3309
70°	3450
75°	2702
80°	2831
85°	2382

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 51748 cd/sqm



TEST NUMBER: P766959

CATALOG NUMBER: LD6D45BD010-EU6DR6540509035-6LBDP1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	432.2	9.5
10°-20°	1246.8	27.3
20°-30°	1496.0	32.8
30°-40°	1005.3	22.0
40°-50°	300.9	6.6
50°-60°	53.1	1.2
60°-70°	15.1	0.3
70°-80°	7.4	0.2
80°-90°	2.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3175.0	69.6
0°-40°	4180.3	91.7
0°-60°	4534.4	99.5
0°-90°	4559.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4559.3	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	4489	
5°	4476	432
15°	4500	1247
25°	3312	1496
35°	1619	1005
45°	335	301
55°	55	53
65°	13	15
75°	6	7
85°	2	2
90°	0	



TEST NUMBER: P766959

CATALOG NUMBER: LD6D45BD010-EU6DR6540509035-6LBDP1LI

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	4488.9
2.5°	4508.0
5°	4475.5
7.5°	4543.1
10°	4580.1
12.5°	4571.2
15°	4499.8
17.5°	4325.0
20°	4030.3
22.5°	3683.2
25°	3312.0
27.5°	2892.9
30°	2422.7
32.5°	1996.6
35°	1619.0
37.5°	1245.8
40°	893.7
42.5°	583.7
45°	334.9
47.5°	177.3
50°	110.4
52.5°	76.5
55°	54.9
57.5°	39.5
60°	27.4
62.5°	17.9
65°	12.8
67.5°	11.5
70°	10.8
72.5°	8.3
75°	6.4
77.5°	5.7
80°	4.5
82.5°	3.2
85°	1.9
87.5°	1.3
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)