

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P766973

Luminaire Tested: LD6D45BD010-EU6DR6540509040-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P766973
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D45BD010-EU6DR6540509040-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 3921.5 lumens
Efficiency: N/A
Efficacy: 101.3 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P766973
CATALOG NUMBER: LD6D45BD010-EU6DR6540509040-6LBDP1MW

Luminous Intensity Polar Plot

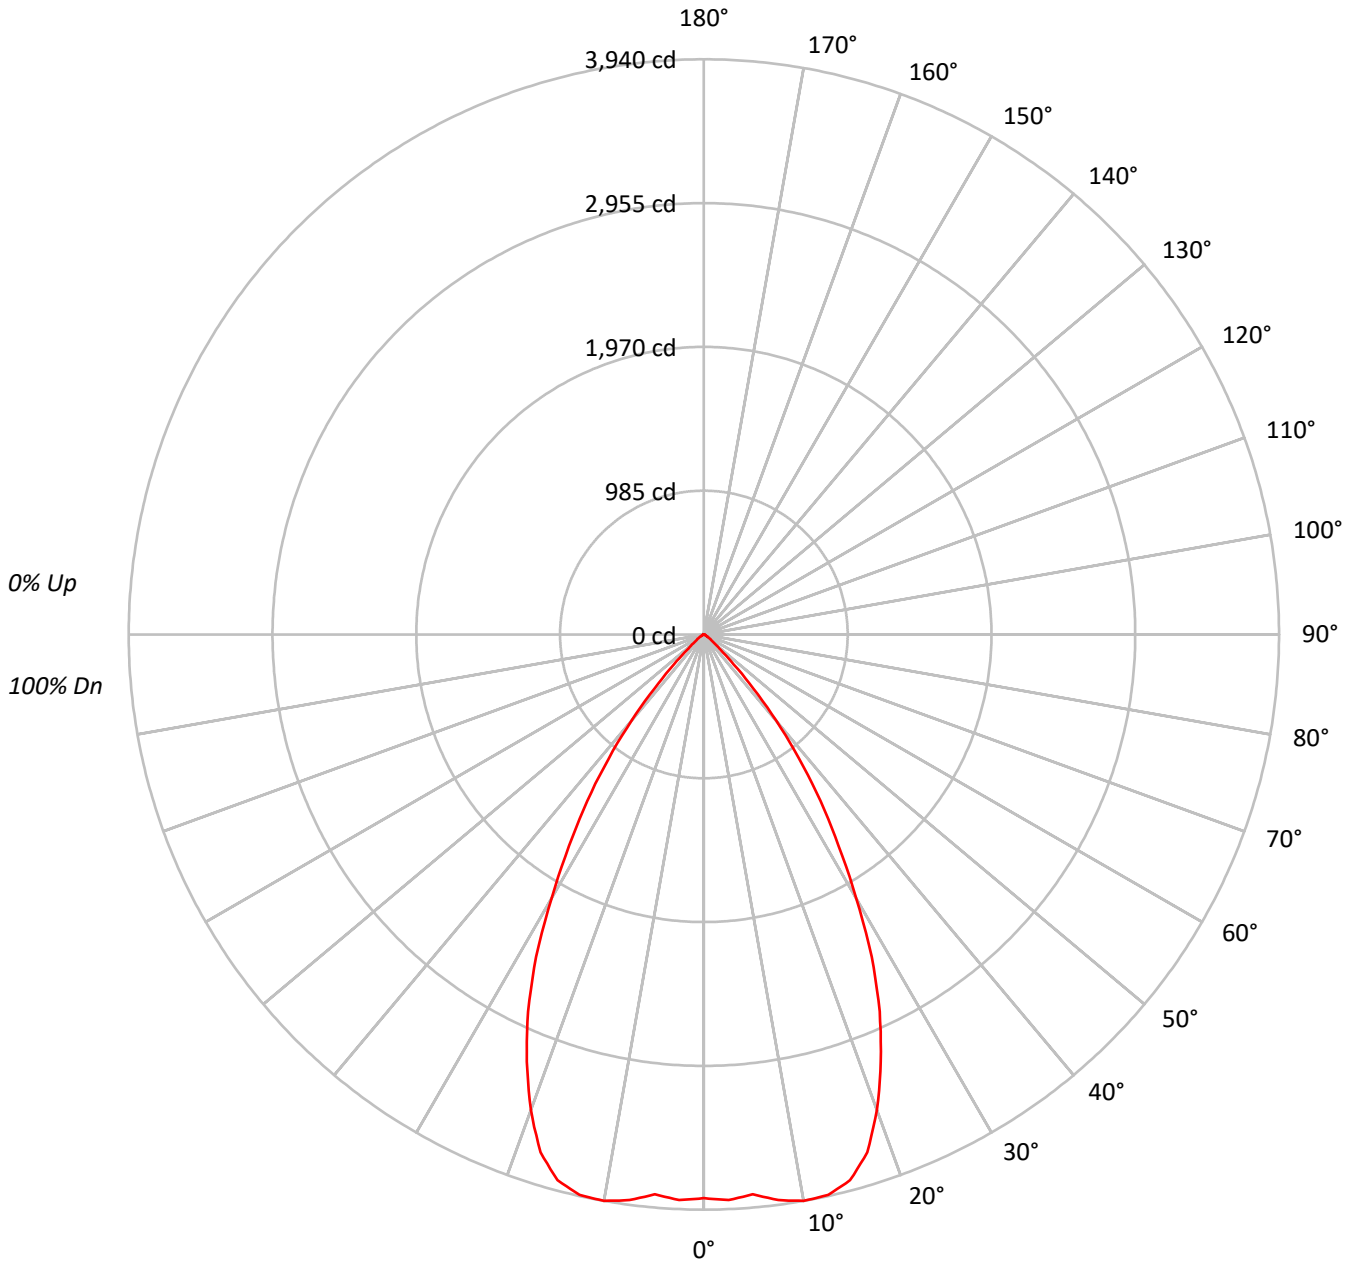



TEST NUMBER: P766973
 CATALOG NUMBER: LD6D45BD010-EU6DR6540509040-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	421856
5°	422206
10°	437073
15°	437789
20°	403060
25°	343428
30°	262912
35°	185735
40°	109640
45°	44517
50°	16131
55°	8991
60°	5157
65°	2844
70°	2971
75°	2322
80°	2391
85°	2006

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 44517 cd/sqm



TEST NUMBER: P766973

CATALOG NUMBER: LD6D45BD010-EU6DR6540509040-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	371.8	9.5
10°-20°	1072.4	27.3
20°-30°	1286.7	32.8
30°-40°	864.7	22.1
40°-50°	258.8	6.6
50°-60°	45.7	1.2
60°-70°	13.0	0.3
70°-80°	6.3	0.2
80°-90°	2.0	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2730.9	69.6
0°-40°	3595.6	91.7
0°-60°	3900.1	99.5
0°-90°	3921.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	3921.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3861	
5°	3850	372
15°	3870	1072
25°	2849	1287
35°	1392	865
45°	288	259
55°	47	46
65°	11	13
75°	6	6
85°	2	2
90°	0	



TEST NUMBER: P766973
CATALOG NUMBER: LD6D45BD010-EU6DR6540509040-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	3861.0
2.5°	3877.5
5°	3849.5
7.5°	3907.6
10°	3939.5
12.5°	3931.8
15°	3870.3
17.5°	3720.0
20°	3466.5
22.5°	3168.0
25°	2848.7
27.5°	2488.2
30°	2083.9
32.5°	1717.3
35°	1392.5
37.5°	1071.6
40°	768.7
42.5°	502.0
45°	288.1
47.5°	152.5
50°	94.9
52.5°	65.8
55°	47.2
57.5°	34.0
60°	23.6
62.5°	15.4
65°	11.0
67.5°	9.9
70°	9.3
72.5°	7.1
75°	5.5
77.5°	4.9
80°	3.8
82.5°	2.7
85°	1.6
87.5°	1.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)