

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P766974

Luminaire Tested: LD6D45BD010-EU6DR6540509040-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P766974
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D45BD010-EU6DR6540509040-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 4442.1 lumens
Efficiency: N/A
Efficacy: 114.8 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 38.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P766974

CATALOG NUMBER: LD6D45BD010-EU6DR6540509040-6LBS1B

Luminous Intensity Polar Plot

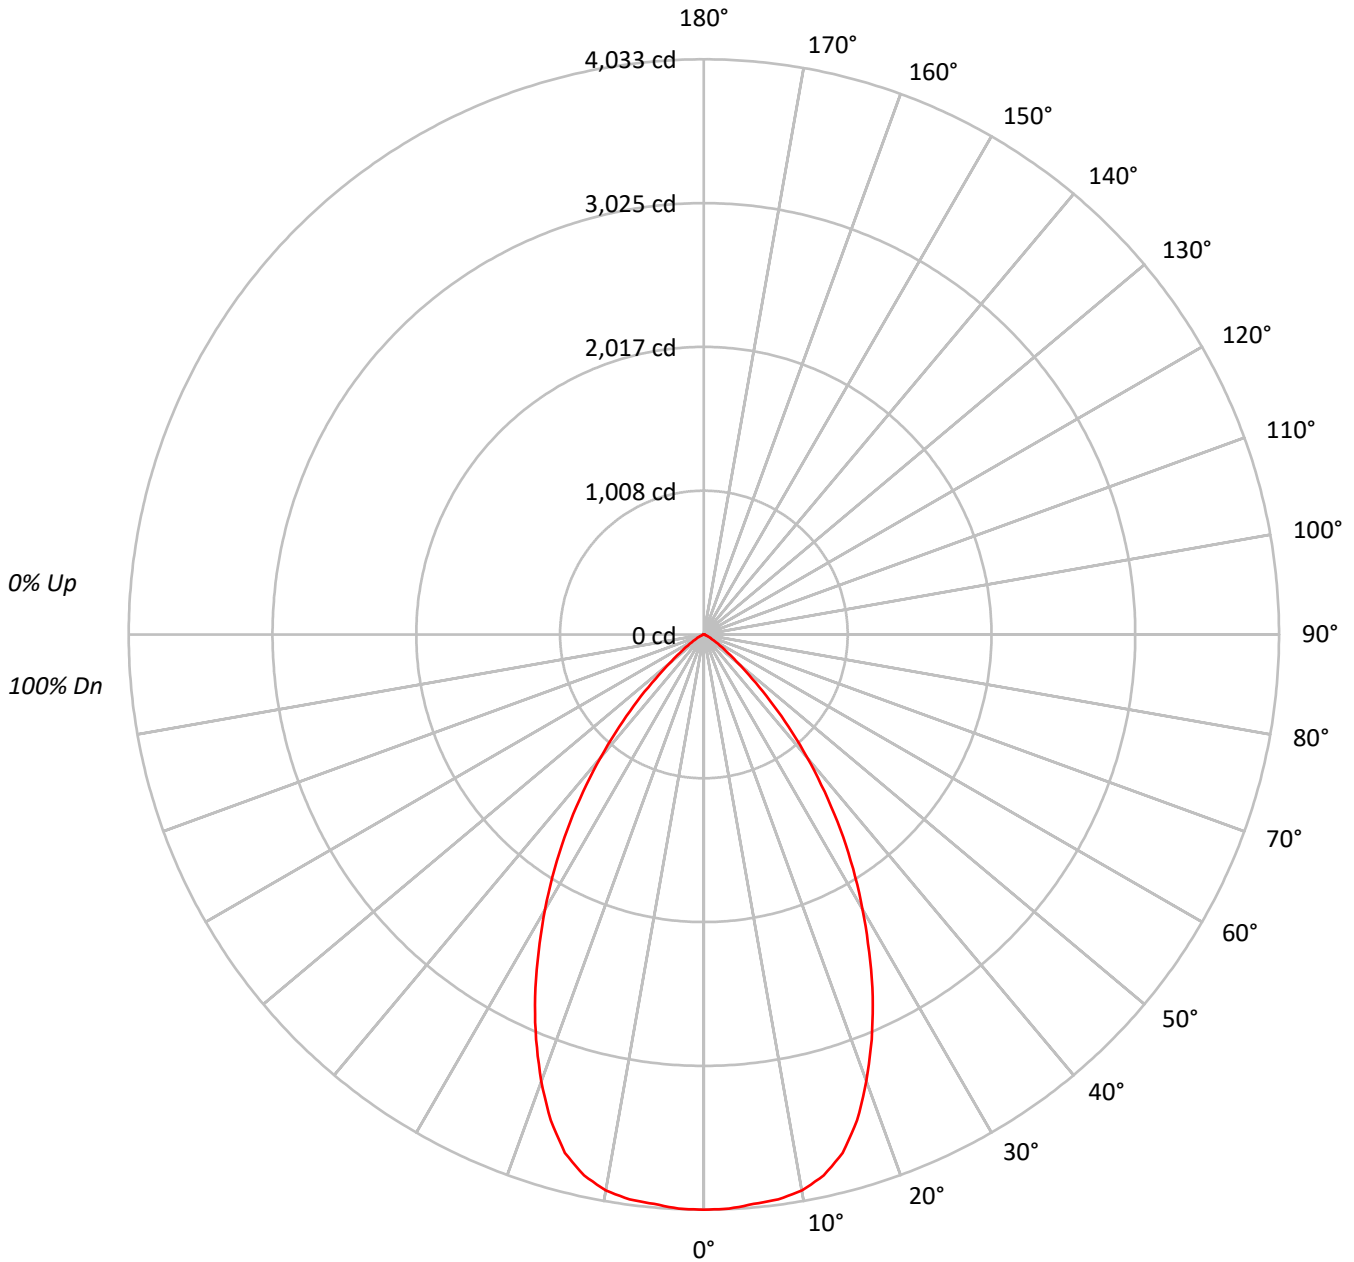



TEST NUMBER: P766974

CATALOG NUMBER: LD6D45BD010-EU6DR6540509040-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	113	110	107	105	111	108	105	103	104	102	100		100	99	97		97	95	94	93
2	107	102	97	94	105	100	96	92	97	93	90		94	91	88		91	89	87	85
3	101	94	88	84	99	92	87	83	90	86	82		87	84	81		85	82	80	78
4	95	87	81	76	93	86	80	76	84	79	75		82	77	74		80	76	73	72
5	90	81	74	70	88	80	74	69	78	73	69		76	72	68		75	71	68	66
6	85	75	69	64	83	74	68	64	73	67	63		71	67	63		70	66	62	61
7	80	70	64	59	79	69	63	59	68	63	59		67	62	58		66	61	58	56
8	76	66	59	55	75	65	59	55	64	58	54		63	58	54		62	57	54	52
9	72	61	55	51	71	61	55	51	60	54	51		59	54	50		58	54	50	49
10	68	58	52	47	67	57	51	47	57	51	47		56	51	47		55	50	47	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	235560
5°	234965
10°	234764
15°	227527
20°	207134
25°	180507
30°	150133
35°	118954
40°	85855
45°	54240
50°	28276
55°	15029
60°	7896
65°	4339
70°	1827
75°	2008
80°	1379
85°	1206

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 54240 cd/sqm



TEST NUMBER: P766974

CATALOG NUMBER: LD6D45BD010-EU6DR6540509040-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	381.4	8.6
10°-20°	1044.5	23.5
20°-30°	1276.7	28.7
30°-40°	1035.9	23.3
40°-50°	516.2	11.6
50°-60°	144.0	3.2
60°-70°	32.7	0.7
70°-80°	8.5	0.2
80°-90°	2.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	2702.6	60.8
0°-40°	3738.5	84.2
0°-60°	4398.7	99.0
0°-90°	4442.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	4442.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	4033	
5°	4008	381
15°	3763	1044
25°	2801	1277
35°	1668	1036
45°	657	516
55°	148	144
65°	31	33
75°	9	9
85°	2	2
90°	0	



TEST NUMBER: P766974

CATALOG NUMBER: LD6D45BD010-EU6DR6540509040-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	4033.3
2.5°	4030.3
5°	4007.8
7.5°	3994.8
10°	3958.6
12.5°	3885.1
15°	3763.0
17.5°	3572.2
20°	3332.7
22.5°	3074.3
25°	2801.1
27.5°	2508.9
30°	2226.2
32.5°	1947.0
35°	1668.4
37.5°	1390.5
40°	1126.1
42.5°	878.4
45°	656.7
47.5°	457.6
50°	311.2
52.5°	214.6
55°	147.6
57.5°	99.6
60°	67.6
62.5°	46.8
65°	31.4
67.5°	16.0
70°	10.7
72.5°	10.1
75°	8.9
77.5°	5.9
80°	4.1
82.5°	3.0
85°	1.8
87.5°	1.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)