

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P758617

Luminaire Tested: LD6D05D010-EU6DR600210IC9027-6LBDP1B

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P758617
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D05D010-EU6DR600210IC9027-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 505.3 lumens
Efficiency: N/A
Efficacy: 67.4 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.83
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P758617

CATALOG NUMBER: LD6D05D010-EU6DR600210IC9027-6LBDP1B

Luminous Intensity Polar Plot

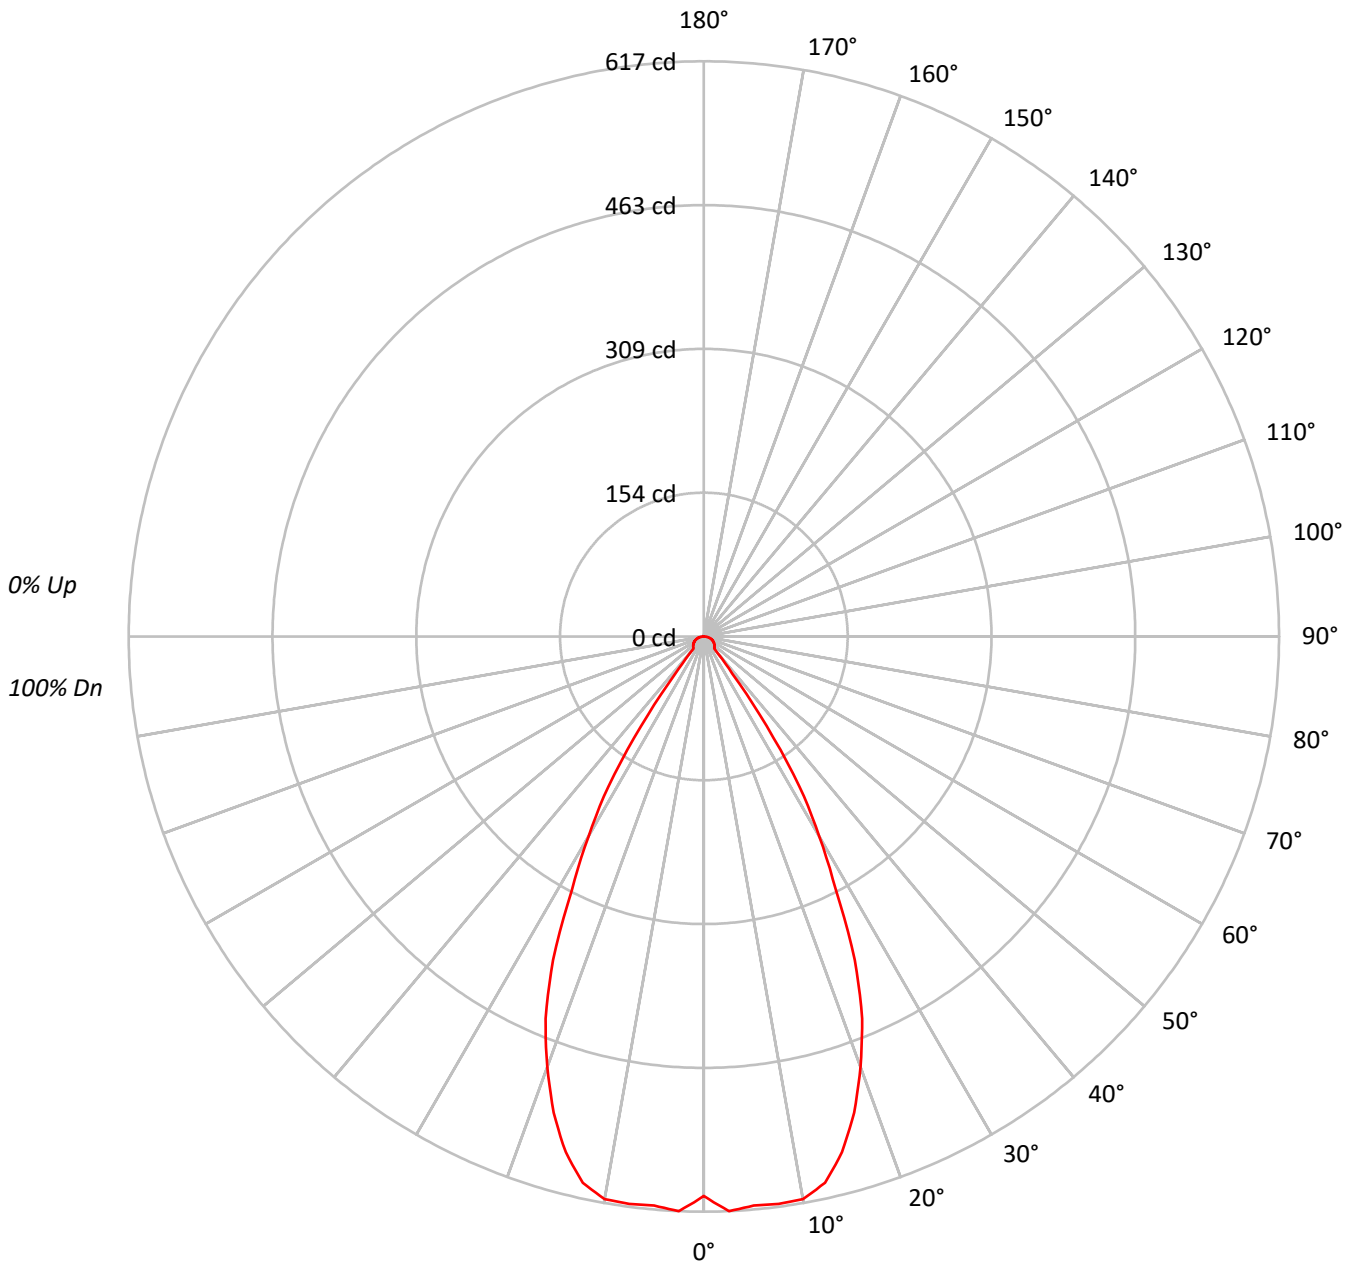



TEST NUMBER: P758617

CATALOG NUMBER: LD6D05D010-EU6DR600210IC9027-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93			93
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86			86
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80			80
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75			75
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70			70
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66			66
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62			62
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59			59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55			55
10	73	64	58	54	72	63	58	54	63	58	54	62	57	54	61	57	54	53			53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	65578
5°	67200
10°	67999
15°	64781
20°	57113
25°	46197
30°	31251
35°	15659
40°	2539
45°	2488
50°	2533
55°	2572
60°	2644
65°	2715
70°	2779
75°	2786
80°	2706
85°	2257

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 72.5°
 Luminance: 2798 cd/sqm



TEST NUMBER: P758617

CATALOG NUMBER: LD6D05D010-EU6DR600210IC9027-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	58.6	11.6
10°-20°	158.4	31.3
20°-30°	170.4	33.7
30°-40°	74.1	14.7
40°-50°	12.4	2.5
50°-60°	12.1	2.4
60°-70°	10.4	2.0
70°-80°	6.9	1.4
80°-90°	2.1	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	387.4	76.7
0°-40°	461.5	91.3
0°-60°	486.0	96.2
0°-90°	505.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	505.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	600	
5°	613	59
15°	573	158
25°	383	170
35°	117	74
45°	16	12
55°	14	12
65°	10	10
75°	7	7
85°	2	2
90°	0	



TEST NUMBER: P758617

CATALOG NUMBER: LD6D05D010-EU6DR600210IC9027-6LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	600.2
2.5°	617.1
5°	612.7
7.5°	614.0
10°	612.9
12.5°	600.3
15°	572.7
17.5°	535.7
20°	491.2
22.5°	443.7
25°	383.2
27.5°	306.5
30°	247.7
32.5°	190.9
35°	117.4
37.5°	50.2
40°	17.8
42.5°	16.4
45°	16.1
47.5°	15.5
50°	14.9
52.5°	14.2
55°	13.5
57.5°	12.8
60°	12.1
62.5°	11.3
65°	10.5
67.5°	9.6
70°	8.7
72.5°	7.7
75°	6.6
77.5°	5.4
80°	4.3
82.5°	3.0
85°	1.8
87.5°	0.6
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)