

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P758032

Luminaire Tested: LD6D05D010-EU6DR200210IC9040-6LBDP1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P758032
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D05D010-EU6DR200210IC9040-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 651.2 lumens
Efficiency: N/A
Efficacy: 86.8 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P758032

CATALOG NUMBER: LD6D05D010-EU6DR200210IC9040-6LBDP1B

Luminous Intensity Polar Plot

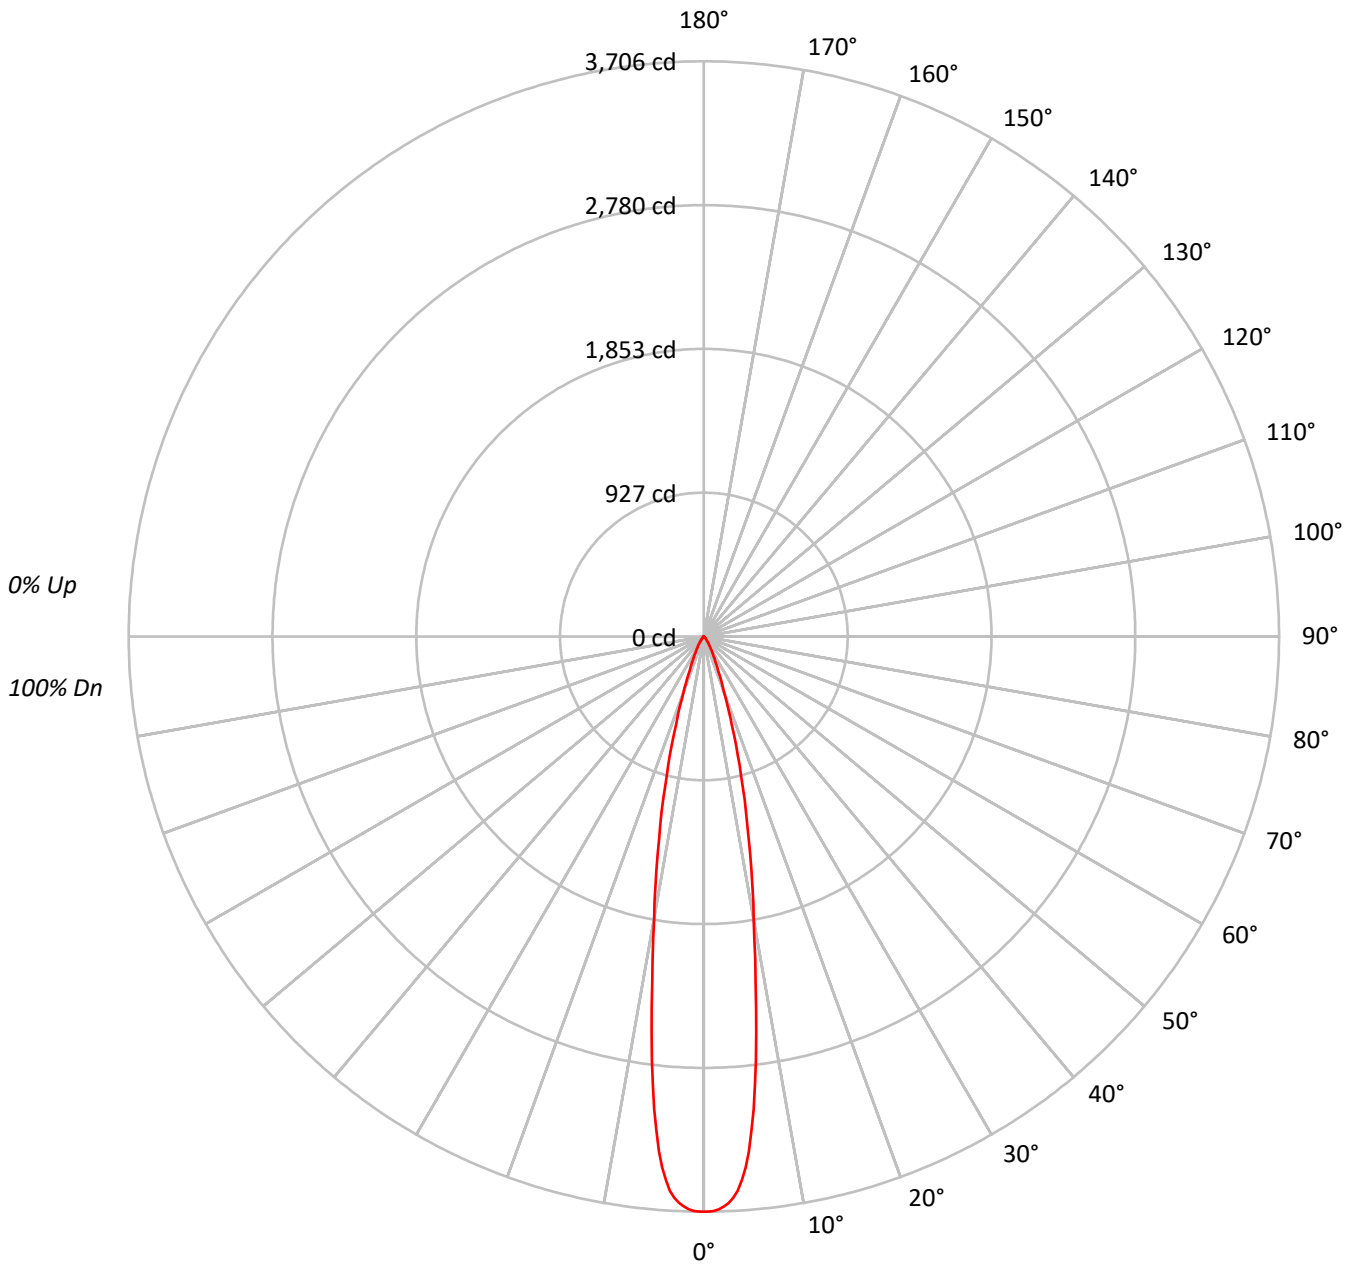



TEST NUMBER: P758032

CATALOG NUMBER: LD6D05D010-EU6DR200210IC9040-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

| | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|----|----|-----|--|--|--|--|--|----|--|--|--|--|--|--|--|--|---|
| RF | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | 20 | | | | | | | | | |
| RC | 80 | | | | | | | | | 50 | | | | | | | | | 30 | | | | | | | | | 10 | | | | | | | | | 0 |
| RW | 70 | 50 | 30 | 10 | 70 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 50 | 30 | 10 | 0 | | | | | | | | | | | | | | | | |
| RCR | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 0 | 119 | 119 | 119 | 119 | 116 | 116 | 116 | 116 | 111 | 111 | 111 | 106 | 106 | 106 | 102 | 102 | 102 | 100 | | | | 100 | | | | | | | | | | | | | | | |
| 1 | 115 | 113 | 111 | 109 | 113 | 111 | 109 | 108 | 107 | 106 | 104 | 103 | 102 | 101 | 100 | 99 | 98 | 97 | 97 | 98 | 98 | 97 | | | | | | | | | | | | | | | |
| 2 | 111 | 108 | 105 | 102 | 109 | 106 | 104 | 101 | 103 | 101 | 99 | 100 | 99 | 97 | 98 | 96 | 95 | 94 | 94 | 98 | 96 | 95 | | | | | | | | | | | | | | | |
| 3 | 108 | 103 | 100 | 97 | 106 | 102 | 99 | 96 | 100 | 97 | 95 | 97 | 95 | 93 | 95 | 93 | 92 | 91 | 91 | 95 | 93 | 92 | | | | | | | | | | | | | | | |
| 4 | 105 | 99 | 96 | 93 | 103 | 98 | 95 | 92 | 96 | 93 | 91 | 95 | 92 | 90 | 93 | 91 | 89 | 88 | 88 | 93 | 91 | 89 | | | | | | | | | | | | | | | |
| 5 | 102 | 96 | 92 | 89 | 100 | 95 | 91 | 89 | 94 | 90 | 88 | 92 | 89 | 87 | 91 | 88 | 86 | 85 | 85 | 91 | 88 | 86 | | | | | | | | | | | | | | | |
| 6 | 99 | 93 | 89 | 86 | 98 | 92 | 88 | 86 | 91 | 87 | 85 | 90 | 87 | 84 | 88 | 86 | 84 | 83 | 83 | 88 | 86 | 84 | | | | | | | | | | | | | | | |
| 7 | 96 | 90 | 86 | 83 | 95 | 89 | 86 | 83 | 88 | 85 | 82 | 87 | 84 | 82 | 86 | 84 | 82 | 81 | 81 | 86 | 84 | 82 | | | | | | | | | | | | | | | |
| 8 | 94 | 87 | 83 | 81 | 93 | 87 | 83 | 80 | 86 | 83 | 80 | 85 | 82 | 80 | 84 | 82 | 80 | 79 | 79 | 84 | 82 | 80 | | | | | | | | | | | | | | | |
| 9 | 91 | 85 | 81 | 78 | 91 | 85 | 81 | 78 | 84 | 80 | 78 | 83 | 80 | 78 | 82 | 80 | 78 | 77 | 77 | 82 | 80 | 78 | | | | | | | | | | | | | | | |
| 10 | 89 | 83 | 79 | 76 | 88 | 82 | 79 | 76 | 82 | 78 | 76 | 81 | 78 | 76 | 81 | 78 | 76 | 75 | 75 | 81 | 78 | 76 | | | | | | | | | | | | | | | |

AVERAGE LUMINANCE (cd/sqm):

| | |
|-----|--------|
| | 0° |
| 0° | 404975 |
| 5° | 365371 |
| 10° | 205062 |
| 15° | 104236 |
| 20° | 44137 |
| 25° | 20374 |
| 30° | 10787 |
| 35° | 5815 |
| 40° | 3109 |
| 45° | 1839 |
| 50° | 1071 |
| 55° | 571 |
| 60° | 371 |
| 65° | 259 |
| 70° | 96 |
| 75° | 0 |
| 80° | 0 |
| 85° | 0 |

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 1839 cd/sqm



TEST NUMBER: P758032

CATALOG NUMBER: LD6D05D010-EU6DR200210IC9040-6LBDP1B

ZONAL LUMENS:

| Zone | Lumens | % Fixture |
|-----------|--------|-----------|
| 0°-10° | 263.9 | 40.5 |
| 10°-20° | 259.9 | 39.9 |
| 20°-30° | 84.9 | 13.0 |
| 30°-40° | 28.9 | 4.4 |
| 40°-50° | 9.7 | 1.5 |
| 50°-60° | 2.9 | 0.5 |
| 60°-70° | 1.0 | 0.2 |
| 70°-80° | 0.0 | 0.0 |
| 80°-90° | 0.0 | 0.0 |
| 90°-100° | 0.0 | 0.0 |
| 100°-110° | 0.0 | 0.0 |
| 110°-120° | 0.0 | 0.0 |
| 120°-130° | 0.0 | 0.0 |
| 130°-140° | 0.0 | 0.0 |
| 140°-150° | 0.0 | 0.0 |
| 150°-160° | 0.0 | 0.0 |
| 160°-170° | 0.0 | 0.0 |
| 170°-180° | 0.0 | 0.0 |
| 0°-30° | 608.6 | 93.5 |
| 0°-40° | 637.6 | 97.9 |
| 0°-60° | 650.2 | 99.8 |
| 0°-90° | 651.2 | 100.0 |
| 90°-120° | 0.0 | 0.0 |
| 90°-150° | 0.0 | 0.0 |
| 90°-180° | 0.0 | 0.0 |
| 0°-180° | 651.2 | 100.0 |

CANDELA DISTRIBUTION:

| | 0° | Flux |
|-----|------|------|
| 0° | 3706 | |
| 5° | 3331 | 264 |
| 15° | 922 | 260 |
| 25° | 169 | 85 |
| 35° | 44 | 29 |
| 45° | 12 | 10 |
| 55° | 3 | 3 |
| 65° | 1 | 1 |
| 75° | 0 | 0 |
| 85° | 0 | 0 |
| 90° | 0 | |



TEST NUMBER: P758032

CATALOG NUMBER: LD6D05D010-EU6DR200210IC9040-6LBDP1B

CANDELA DISTRIBUTION (FULL):

| | 0° |
|-------|--------|
| 0° | 3706.5 |
| 0.5° | 3706.5 |
| 1° | 3701.9 |
| 1.5° | 3692.7 |
| 2° | 3675.8 |
| 2.5° | 3653.4 |
| 3° | 3621.7 |
| 3.5° | 3577.5 |
| 4° | 3511.8 |
| 4.5° | 3431.9 |
| 5° | 3331.3 |
| 5.5° | 3198.9 |
| 6° | 3063.2 |
| 6.5° | 2907.8 |
| 7° | 2755.6 |
| 7.5° | 2577.4 |
| 8° | 2418.3 |
| 8.5° | 2258.2 |
| 9° | 2110.4 |
| 9.5° | 1974.7 |
| 10° | 1848.3 |
| 12.5° | 1327.2 |
| 15° | 921.5 |
| 17.5° | 602.0 |
| 20° | 379.6 |
| 22.5° | 245.9 |
| 25° | 169.0 |
| 27.5° | 118.8 |
| 30° | 85.5 |
| 32.5° | 61.4 |
| 35° | 43.6 |
| 37.5° | 30.4 |
| 40° | 21.8 |
| 42.5° | 15.8 |
| 45° | 11.9 |
| 47.5° | 9.2 |
| 50° | 6.3 |
| 52.5° | 4.0 |
| 55° | 3.0 |
| 57.5° | 2.3 |
| 60° | 1.7 |
| 62.5° | 1.3 |
| 65° | 1.0 |



TEST NUMBER: P758032

CATALOG NUMBER: LD6D05D010-EU6DR200210IC9040-6LBDP1B

CANDELA DISTRIBUTION (continued):

| | 0° |
|-------|-----|
| 72.5° | 0.0 |
| 75° | 0.0 |
| 77.5° | 0.0 |
| 80° | 0.0 |
| 82.5° | 0.0 |
| 85° | 0.0 |
| 87.5° | 0.0 |
| 90° | 0.0 |

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



| | | |
|-------|--|-----|
| 67.5° | | 0.7 |
| 70° | | 0.3 |

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)