

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P758737

Luminaire Tested: LD6D05D010-EU6DR650210IC9040-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P758737
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D05D010-EU6DR650210IC9040-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 542.0 lumens
Efficiency: N/A
Efficacy: 72.3 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 7.5
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P758737
CATALOG NUMBER: LD6D05D010-EU6DR650210IC9040-6LBDP1MW

Luminous Intensity Polar Plot

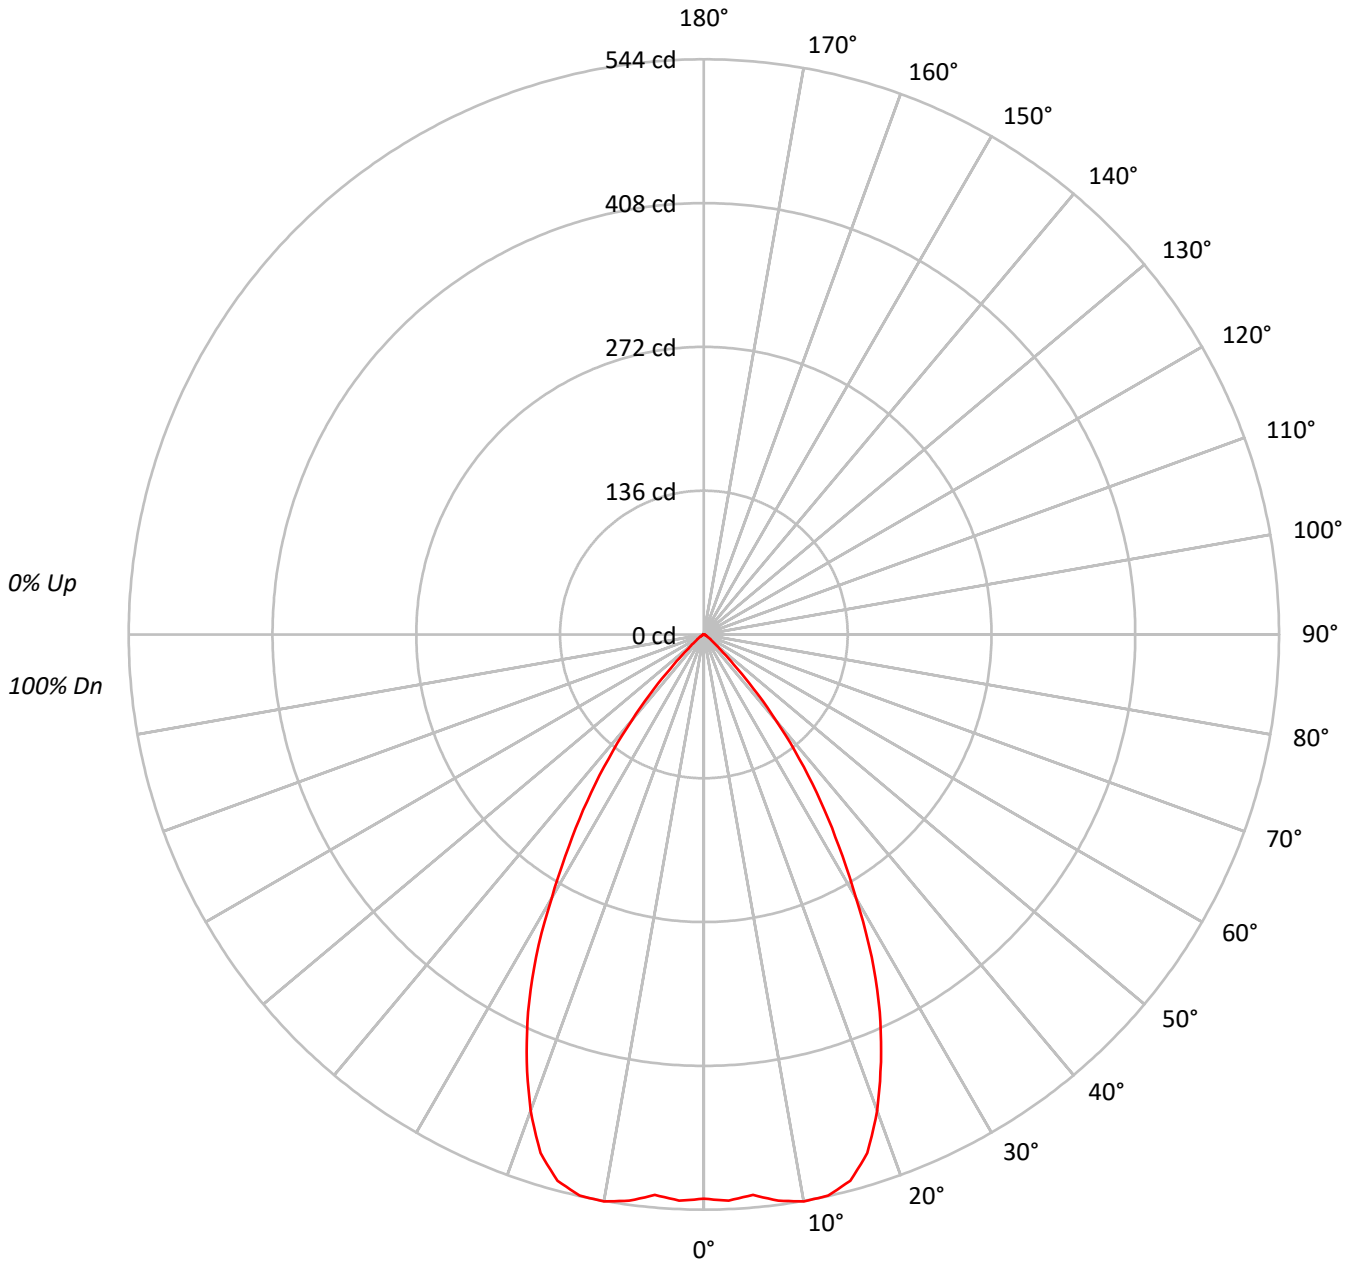



TEST NUMBER: P758737

CATALOG NUMBER: LD6D05D010-EU6DR650210IC9040-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93		
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87		
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80		
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75		
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69		
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65		
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60		
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57		
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53		
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	58302
5°	58349
10°	60410
15°	60505
20°	55706
25°	47463
30°	36335
35°	25676
40°	15147
45°	6150
50°	2227
55°	1238
60°	721
65°	388
70°	415
75°	296
80°	315
85°	251

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 6150 cd/sqm



TEST NUMBER: P758737

CATALOG NUMBER: LD6D05D010-EU6DR650210IC9040-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	51.4	9.5
10°-20°	148.2	27.3
20°-30°	177.8	32.8
30°-40°	119.5	22.1
40°-50°	35.8	6.6
50°-60°	6.3	1.2
60°-70°	1.8	0.3
70°-80°	0.9	0.2
80°-90°	0.3	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	377.4	69.6
0°-40°	497.0	91.7
0°-60°	539.0	99.5
0°-90°	542.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	542.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	534	
5°	532	51
15°	535	148
25°	394	178
35°	192	120
45°	40	36
55°	6	6
65°	2	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P758737

CATALOG NUMBER: LD6D05D010-EU6DR650210IC9040-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	533.6
2.5°	535.9
5°	532.0
7.5°	540.1
10°	544.5
12.5°	543.4
15°	534.9
17.5°	514.2
20°	479.1
22.5°	437.8
25°	393.7
27.5°	343.9
30°	288.0
32.5°	237.4
35°	192.5
37.5°	148.1
40°	106.2
42.5°	69.4
45°	39.8
47.5°	21.1
50°	13.1
52.5°	9.1
55°	6.5
57.5°	4.7
60°	3.3
62.5°	2.1
65°	1.5
67.5°	1.4
70°	1.3
72.5°	1.0
75°	0.7
77.5°	0.7
80°	0.5
82.5°	0.4
85°	0.2
87.5°	0.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)