

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P758828

Luminaire Tested: LD6D05D010-EU6DR700210IC9050-6LBDP1MW

Issue Date: 2/5/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P758828  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/5/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D05D010-EU6DR700210IC9050-6LBDP1MW  
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 70° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 558.7 lumens  
Efficiency: N/A  
Efficacy: 74.5 lumens/watt  
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 7.5  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P758828

CATALOG NUMBER: LD6D05D010-EU6DR700210IC9050-6LBDP1MW

### Luminous Intensity Polar Plot

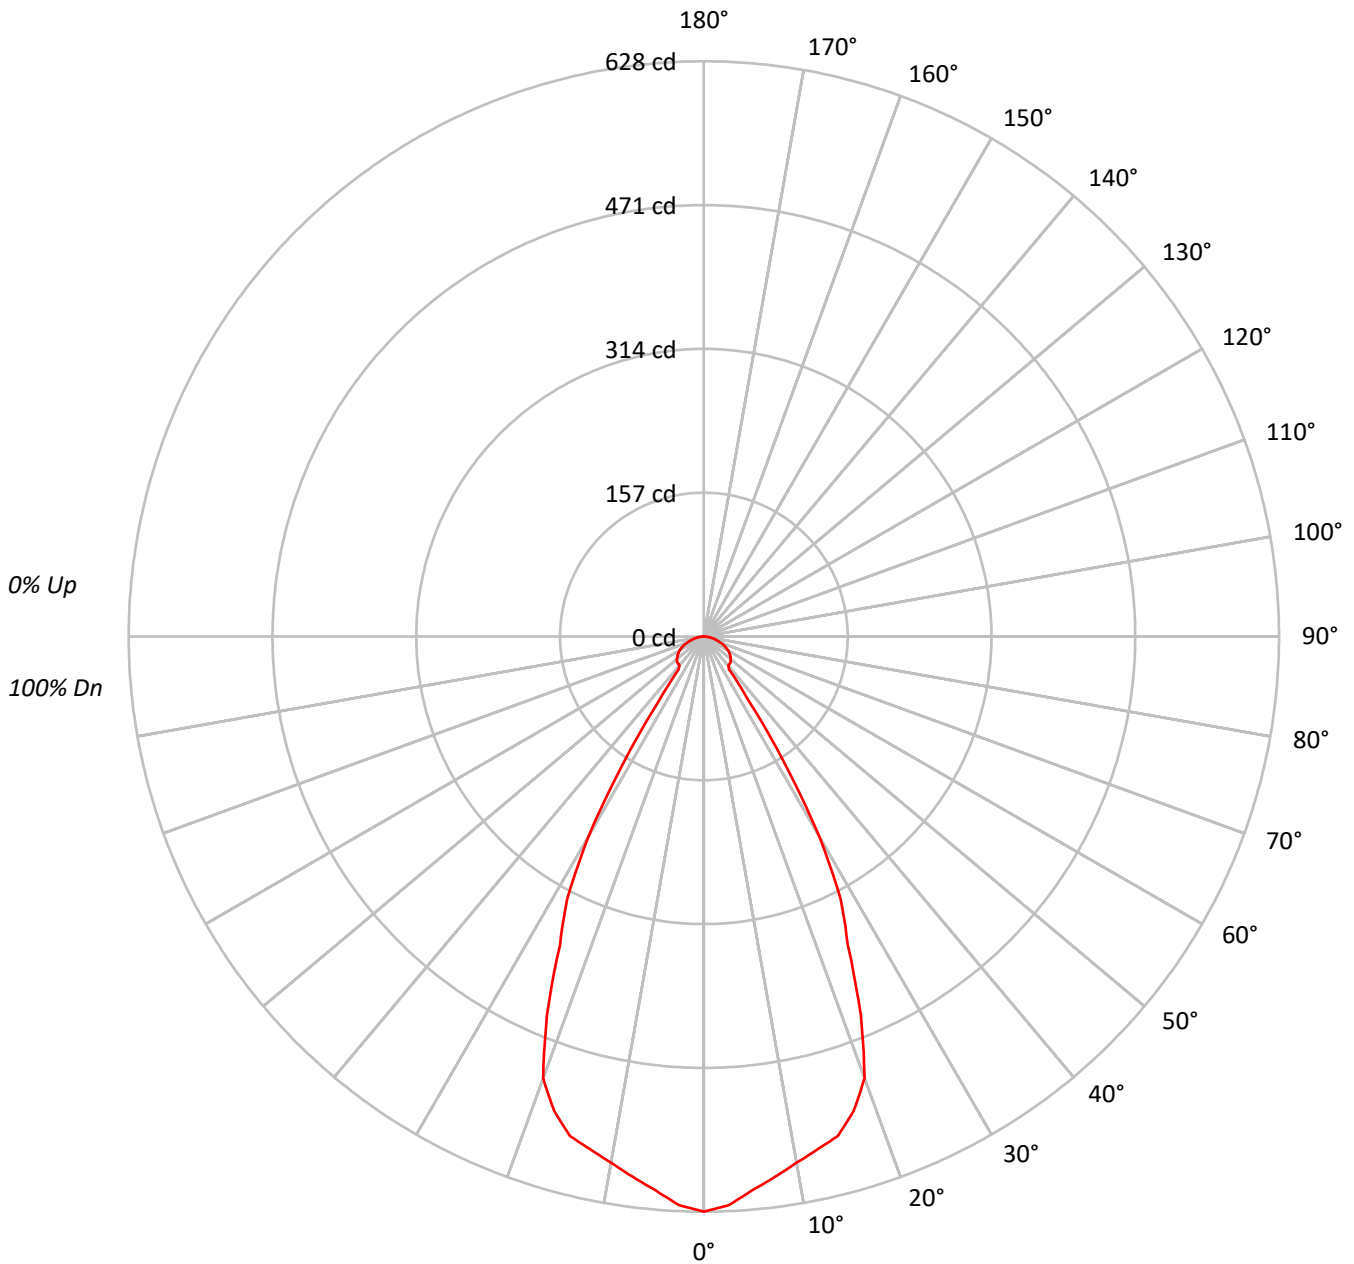



TEST NUMBER: P758828

CATALOG NUMBER: LD6D05D010-EU6DR700210IC9050-6LBDP1MW

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76			
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70			
5	89	80	74	69	87	79	73	68	77	72	68	75	71	67	74	70	67	65			
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61			
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57			
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53			
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50			
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48			

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	68616
5°	66575
10°	64726
15°	63865
20°	59648
25°	44811
30°	31680
35°	11217
40°	5905
45°	6289
50°	6510
55°	6629
60°	6665
65°	6541
70°	6166
75°	5699
80°	5097
85°	4137

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 57.5°  
 Luminance: 6670 cd/sqm



TEST NUMBER: P758828

CATALOG NUMBER: LD6D05D010-EU6DR700210IC9050-6LBDP1MW

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	57.3	10.2
10°-20°	157.0	28.1
20°-30°	173.0	31.0
30°-40°	66.1	11.8
40°-50°	31.2	5.6
50°-60°	31.0	5.6
60°-70°	24.9	4.5
70°-80°	14.3	2.6
80°-90°	3.9	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	387.3	69.3
0°-40°	453.3	81.1
0°-60°	515.6	92.3
0°-90°	558.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	558.7	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	628	
5°	607	57
15°	565	157
25°	372	173
35°	84	66
45°	41	31
55°	35	31
65°	25	25
75°	14	14
85°	3	4
90°	0	



TEST NUMBER: P758828

CATALOG NUMBER: LD6D05D010-EU6DR700210IC9050-6LBDP1MW

**CANDELA DISTRIBUTION (FULL):**

	0°
0°	628.0
2.5°	621.4
5°	607.0
7.5°	595.0
10°	583.4
12.5°	573.5
15°	564.6
17.5°	543.3
20°	513.0
22.5°	447.5
25°	371.7
27.5°	323.5
30°	251.1
32.5°	162.1
35°	84.1
37.5°	45.4
40°	41.4
42.5°	41.1
45°	40.7
47.5°	39.8
50°	38.3
52.5°	36.6
55°	34.8
57.5°	32.8
60°	30.5
62.5°	28.0
65°	25.3
67.5°	22.3
70°	19.3
72.5°	16.3
75°	13.5
77.5°	10.7
80°	8.1
82.5°	5.7
85°	3.3
87.5°	1.3
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)