

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P768570

Luminaire Tested: LD6D55D010-EU6DR7055659027-6LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P768570
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D55D010-EU6DR7055659027-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6379.6 lumens
Efficiency: N/A
Efficacy: 109.6 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 58.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P768570
CATALOG NUMBER: LD6D55D010-EU6DR7055659027-6LBDP1H

Luminous Intensity Polar Plot

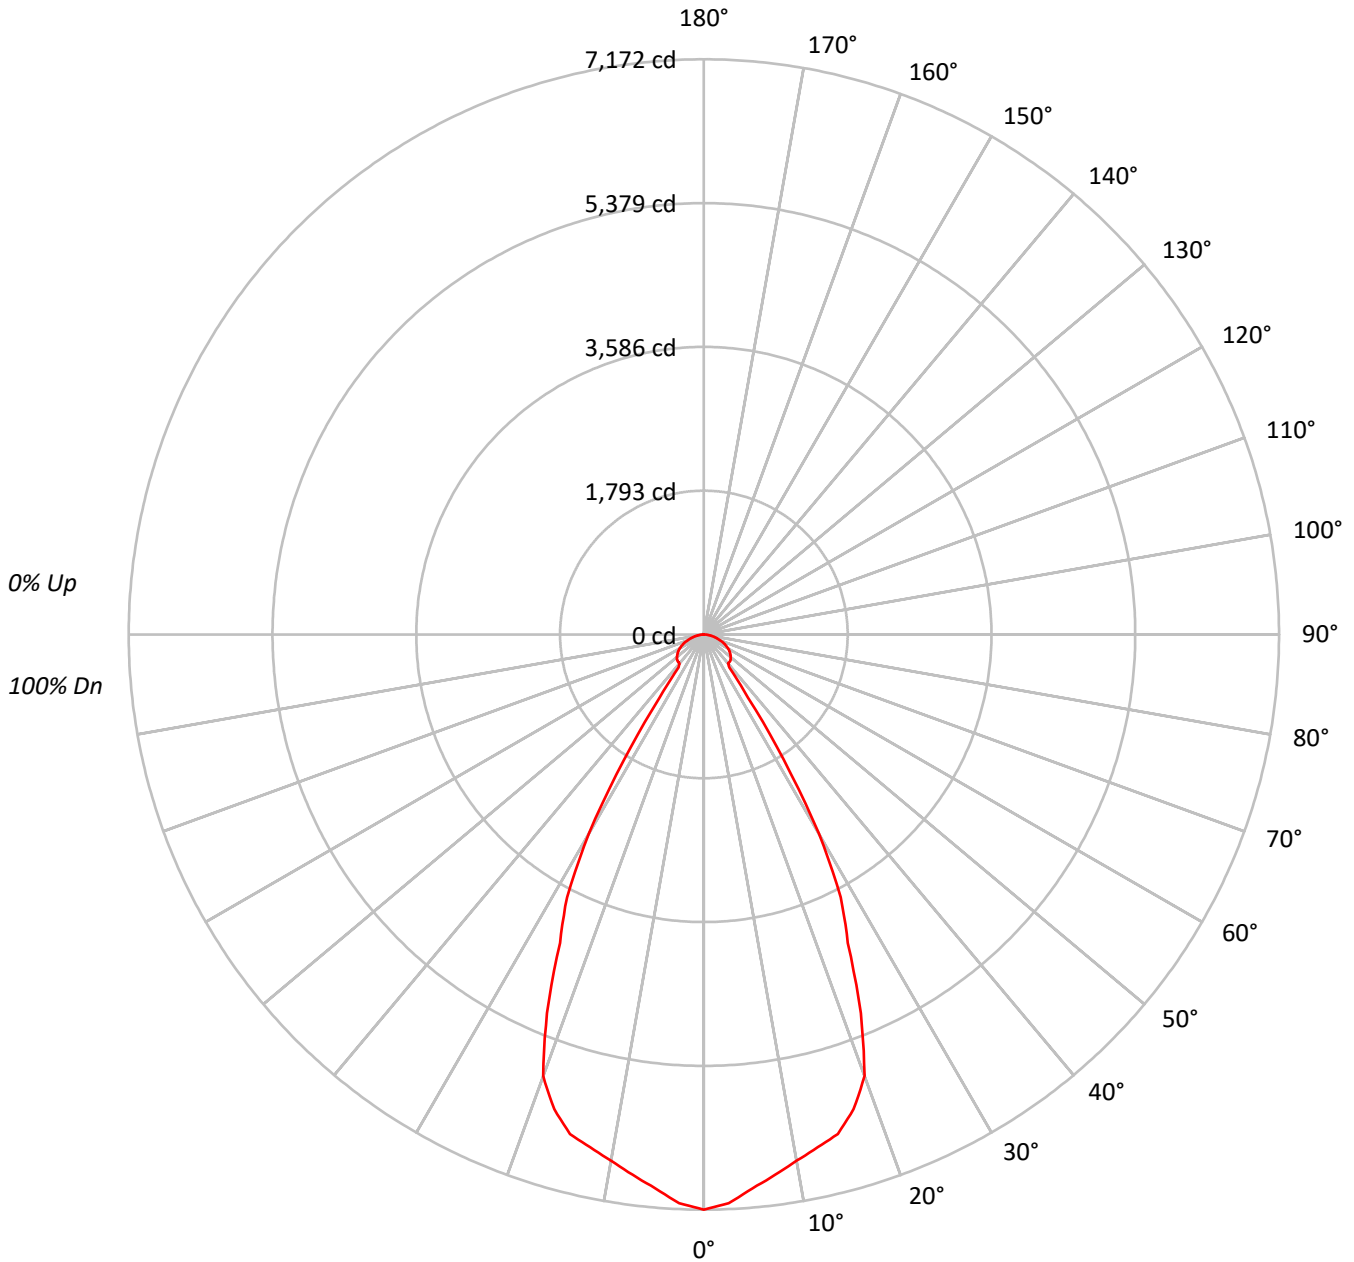



TEST NUMBER: P768570
 CATALOG NUMBER: LD6D55D010-EU6DR7055659027-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91				
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83				
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76				
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70				
5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65				
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61				
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57				
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53				
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50				
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48				

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	783673
5°	760387
10°	739191
15°	729490
20°	681196
25°	511748
30°	361761
35°	128141
40°	67378
45°	71774
50°	74315
55°	75720
60°	76177
65°	74561
70°	70376
75°	65180
80°	57887
85°	47011

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 57.5°
 Luminance: 76216 cd/sqm



TEST NUMBER: P768570

CATALOG NUMBER: LD6D55D010-EU6DR7055659027-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	653.9	10.3
10°-20°	1793.7	28.1
20°-30°	1975.5	31.0
30°-40°	754.8	11.8
40°-50°	356.4	5.6
50°-60°	354.3	5.6
60°-70°	283.7	4.4
70°-80°	163.0	2.6
80°-90°	44.3	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	4423.1	69.3
0°-40°	5177.9	81.2
0°-60°	5888.6	92.3
0°-90°	6379.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6379.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7172	
5°	6933	654
15°	6449	1794
25°	4245	1975
35°	961	755
45°	464	356
55°	398	354
65°	288	284
75°	154	163
85°	38	44
90°	0	



TEST NUMBER: P768570
CATALOG NUMBER: LD6D55D010-EU6DR7055659027-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	7172.5
2.5°	7097.6
5°	6932.9
7.5°	6795.5
10°	6662.6
12.5°	6550.2
15°	6449.1
17.5°	6205.0
20°	5858.6
22.5°	5111.4
25°	4244.9
27.5°	3695.3
30°	2867.4
32.5°	1852.2
35°	960.7
37.5°	519.0
40°	472.4
42.5°	469.0
45°	464.5
47.5°	454.2
50°	437.2
52.5°	417.9
55°	397.5
57.5°	374.8
60°	348.6
62.5°	319.1
65°	288.4
67.5°	254.4
70°	220.3
72.5°	186.2
75°	154.4
77.5°	121.5
80°	92.0
82.5°	64.7
85°	37.5
87.5°	14.8
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)