

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P767895

Luminaire Tested: LD6D55D010-EU6DR2555659035-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P767895
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-4)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D55D010-EU6DR2555659035-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 25° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6173.0 lumens
Efficiency: N/A
Efficacy: 106.1 lumens/watt
Spacing Criteria (0/90/45): 0.42 / 0.42 / 0.45
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 58.2
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P767895
CATALOG NUMBER: LD6D55D010-EU6DR2555659035-6LBDP1LI

Luminous Intensity Polar Plot

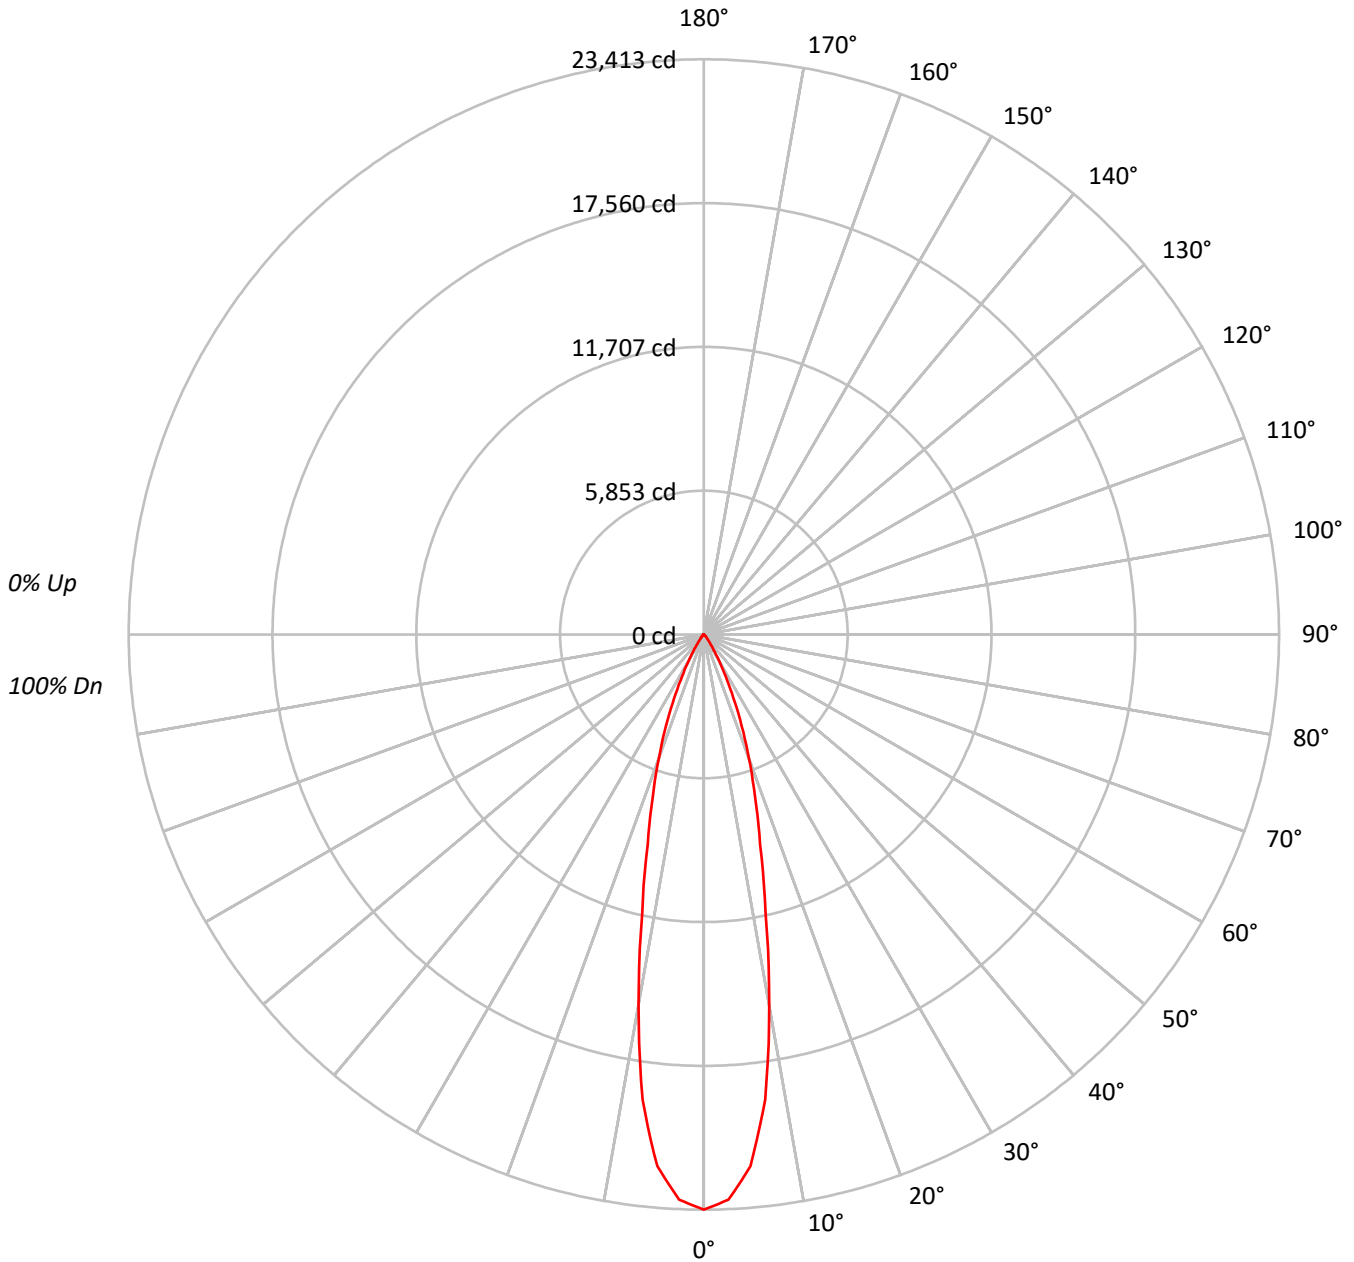



TEST NUMBER: P767895

CATALOG NUMBER: LD6D55D010-EU6DR2555659035-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	97	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	93	89	86	98	93	89	86	91	87	85	89	86	84	88	85	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	93	87	82	79	92	86	82	79	85	81	78	84	80	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2558089
5°	2382538
10°	1699531
15°	1000955
20°	622804
25°	341800
30°	156317
35°	59195
40°	26814
45°	16116
50°	6697
55°	4305
60°	3016
65°	2042
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 16116 cd/sqm



TEST NUMBER: P767895

CATALOG NUMBER: LD6D55D010-EU6DR2555659035-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1866.9	30.2
10°-20°	2528.6	41.0
20°-30°	1338.1	21.7
30°-40°	330.3	5.4
40°-50°	80.6	1.3
50°-60°	21.2	0.3
60°-70°	7.1	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5733.6	92.9
0°-40°	6063.9	98.2
0°-60°	6165.7	99.9
0°-90°	6173.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6173.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	23413	
5°	21723	###
15°	8849	2529
25°	2835	1338
35°	444	330
45°	104	81
55°	23	21
65°	8	7
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P767895
CATALOG NUMBER: LD6D55D010-EU6DR2555659035-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	23412.7
2.5°	23027.9
5°	21723.0
7.5°	19101.4
10°	15318.5
12.5°	11579.9
15°	8849.0
17.5°	6896.6
20°	5356.4
22.5°	4017.1
25°	2835.2
27.5°	1901.3
30°	1239.0
32.5°	753.8
35°	443.8
37.5°	271.6
40°	188.0
42.5°	143.7
45°	104.3
47.5°	63.0
50°	39.4
52.5°	28.5
55°	22.6
57.5°	17.7
60°	13.8
62.5°	10.8
65°	7.9
67.5°	3.0
70°	1.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)