

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P768820

Luminaire Tested: LD6D60D010-EU6DR3555659030-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P768820
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D60D010-EU6DR3555659030-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6697.4 lumens
Efficiency: N/A
Efficacy: 104.0 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 64.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P768820
CATALOG NUMBER: LD6D60D010-EU6DR3555659030-6LBS1B

Luminous Intensity Polar Plot

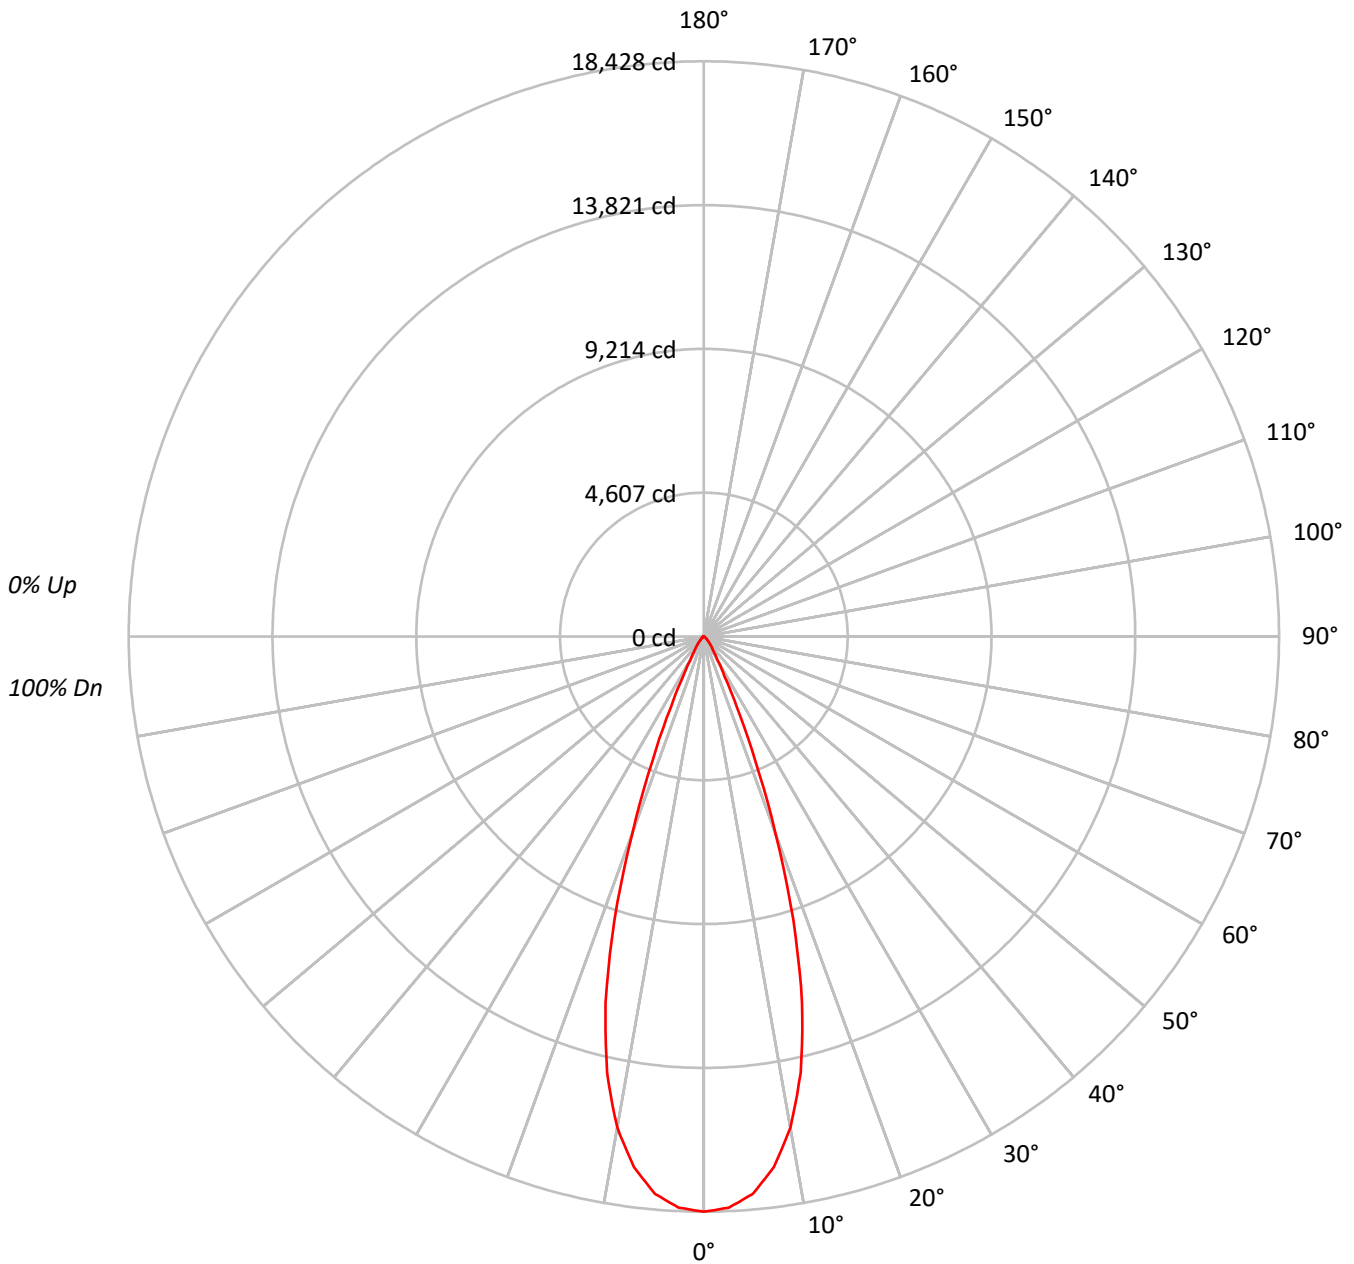



TEST NUMBER: P768820

CATALOG NUMBER: LD6D60D010-EU6DR3555659030-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96																			
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92																			
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88																			
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84																			
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81																			
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78																			
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75																			
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72																			
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70																			
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2013446
5°	1966134
10°	1772012
15°	1375366
20°	780086
25°	303487
30°	113219
35°	62063
40°	40564
45°	24692
50°	15723
55°	11106
60°	8129
65°	4421
70°	319
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 24692 cd/sqm



TEST NUMBER: P768820

CATALOG NUMBER: LD6D60D010-EU6DR3555659030-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1648.7	24.6
10°-20°	3219.0	48.1
20°-30°	1312.8	19.6
30°-40°	314.2	4.7
40°-50°	130.9	2.0
50°-60°	54.2	0.8
60°-70°	17.0	0.3
70°-80°	0.4	0.0
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6180.5	92.3
0°-40°	6494.7	97.0
0°-60°	6679.8	99.7
0°-90°	6697.4	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6697.4	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	18428	
5°	17926	###
15°	12159	3219
25°	2517	1313
35°	465	314
45°	160	131
55°	58	54
65°	17	17
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P768820
CATALOG NUMBER: LD6D60D010-EU6DR3555659030-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	18427.9
2.5°	18317.3
5°	17926.4
7.5°	17146.6
10°	15971.8
12.5°	14317.6
15°	12159.0
17.5°	9518.9
20°	6709.1
22.5°	4278.1
25°	2517.4
27.5°	1423.0
30°	897.4
32.5°	630.1
35°	465.3
37.5°	359.8
40°	284.4
42.5°	219.1
45°	159.8
47.5°	119.6
50°	92.5
52.5°	73.4
55°	58.3
57.5°	47.2
60°	37.2
62.5°	27.1
65°	17.1
67.5°	6.0
70°	1.0
72.5°	1.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)