

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P769173

Luminaire Tested: LD6D60D010-EU6DR5555659050-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P769173
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D60D010-EU6DR5555659050-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8620.8 lumens
Efficiency: N/A
Efficacy: 133.9 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 64.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P769173
CATALOG NUMBER: LD6D60D010-EU6DR5555659050-6LBS1LI

Luminous Intensity Polar Plot

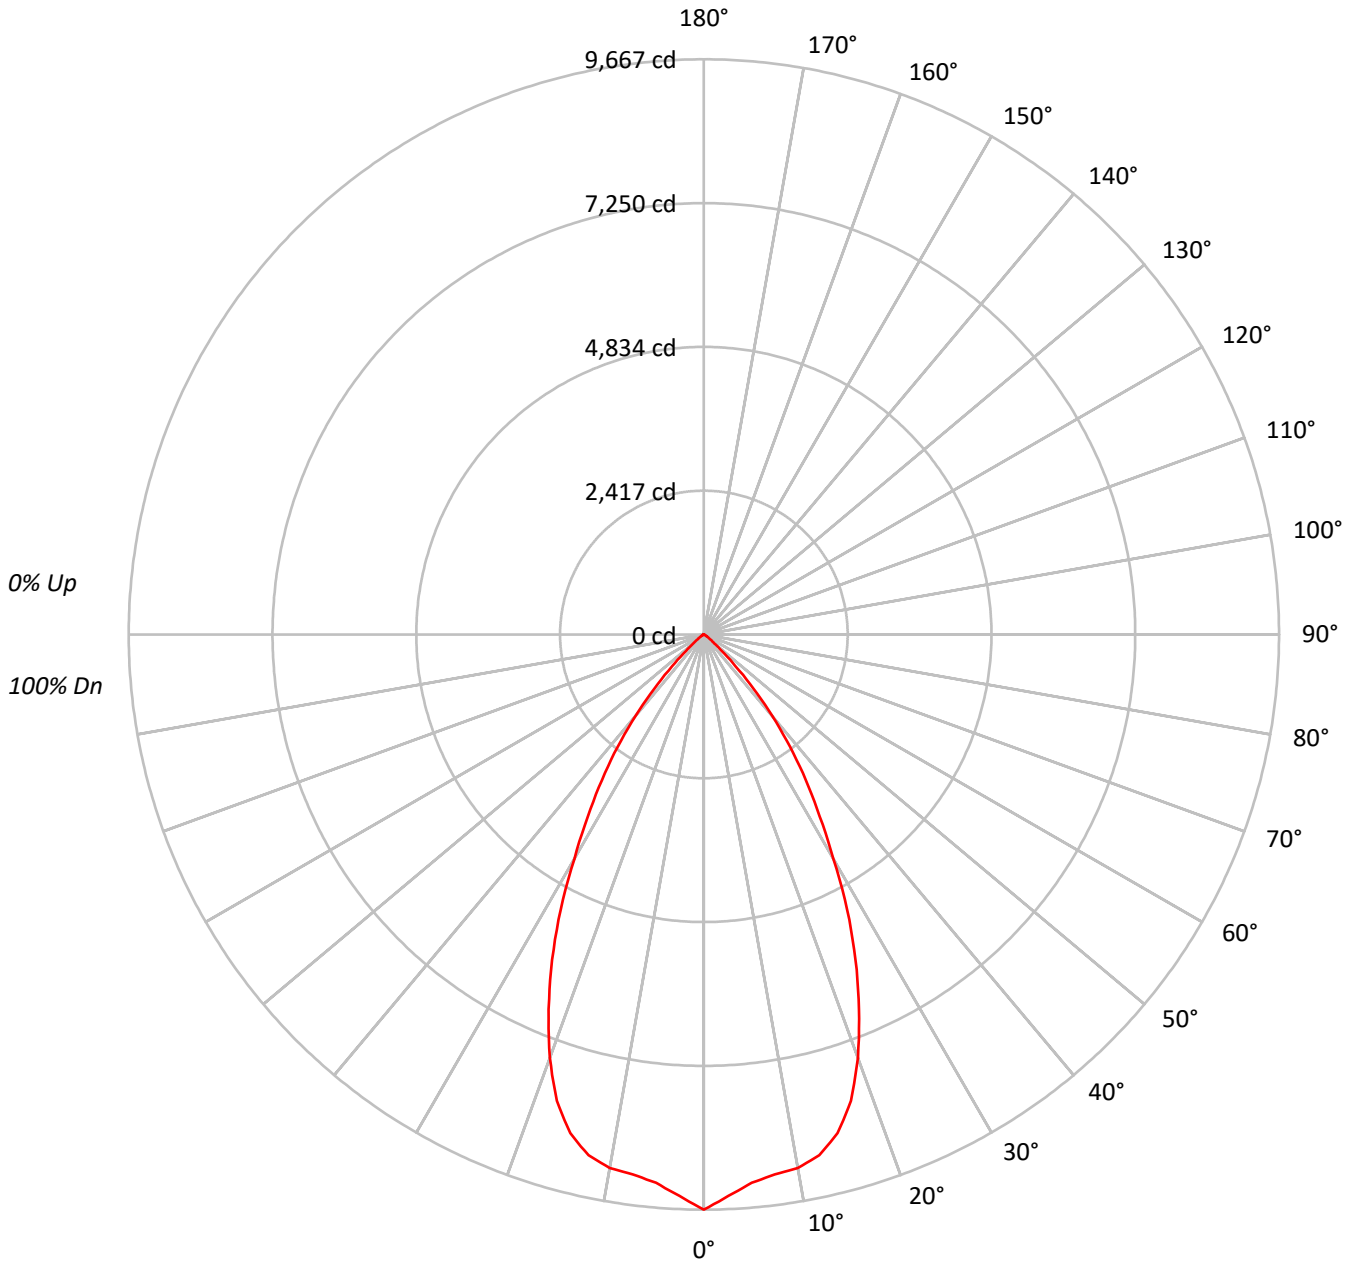



TEST NUMBER: P769173

CATALOG NUMBER: LD6D60D010-EU6DR5555659050-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94		
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87		
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81		
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75		
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70		
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65		
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61		
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57		
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54		
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1056213
5°	1014259
10°	1010443
15°	981409
20°	879976
25°	727253
30°	549354
35°	398321
40°	254908
45°	116429
50°	38075
55°	16420
60°	7058
65°	931
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 116429 cd/sqm



TEST NUMBER: P769173

CATALOG NUMBER: LD6D60D010-EU6DR5555659050-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	880.0	10.2
10°-20°	2401.6	27.9
20°-30°	2736.8	31.7
30°-40°	1863.1	21.6
40°-50°	642.0	7.4
50°-60°	88.7	1.0
60°-70°	8.6	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6018.4	69.8
0°-40°	7881.5	91.4
0°-60°	8612.2	99.9
0°-90°	8620.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8620.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9667	
5°	9248	880
15°	8676	2402
25°	6032	2737
35°	2986	1863
45°	754	642
55°	86	89
65°	4	9
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P769173

CATALOG NUMBER: LD6D60D010-EU6DR5555659050-6LBS1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	9666.9
2.5°	9445.3
5°	9247.6
7.5°	9150.6
10°	9107.5
12.5°	8963.7
15°	8676.2
17.5°	8219.8
20°	7568.2
22.5°	6815.9
25°	6032.5
27.5°	5216.8
30°	4354.3
32.5°	3623.6
35°	2986.3
37.5°	2380.2
40°	1787.2
42.5°	1238.6
45°	753.5
47.5°	406.1
50°	224.0
52.5°	133.0
55°	86.2
57.5°	55.1
60°	32.3
62.5°	14.4
65°	3.6
67.5°	1.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)