

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P770044

Luminaire Tested: LD6D65D010-EU6DR6555659024-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P770044
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D65D010-EU6DR6555659024-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 6571.6 lumens
Efficiency: N/A
Efficacy: 90.3 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct


Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P770044
CATALOG NUMBER: LD6D65D010-EU6DR6555659024-6LBS1LI

Luminous Intensity Polar Plot

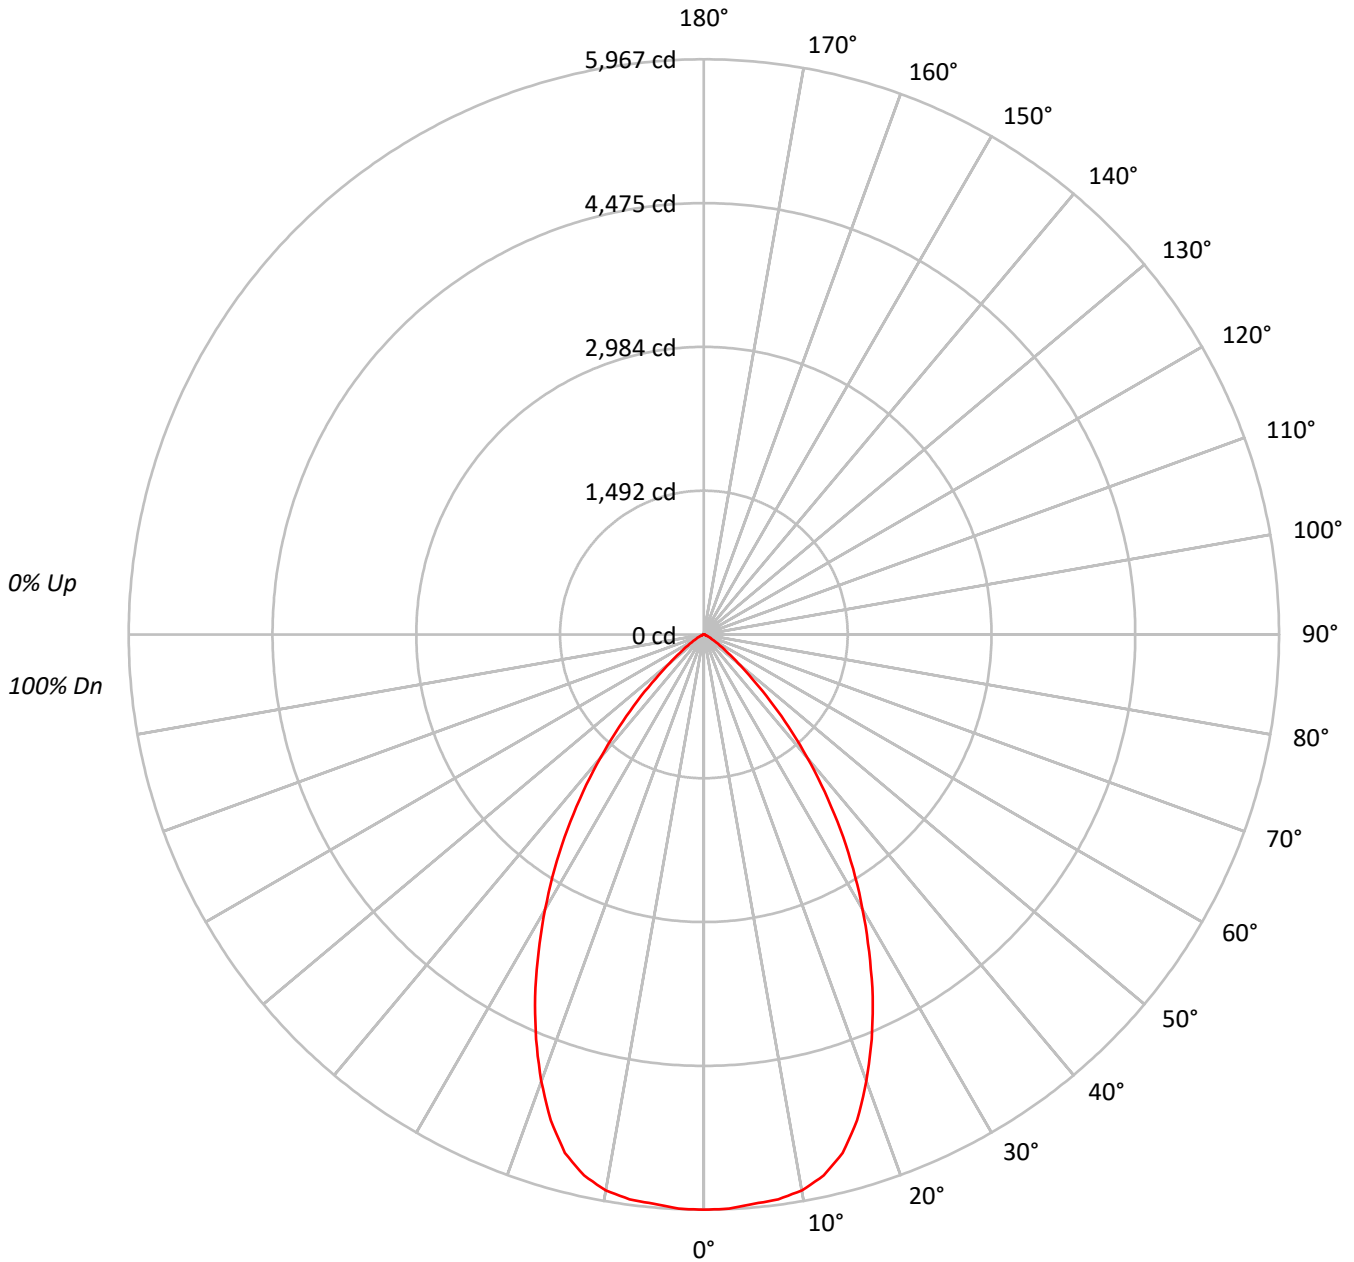



TEST NUMBER: P770044
 CATALOG NUMBER: LD6D65D010-EU6DR6555659024-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93																			
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85																			
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78																			
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72																			
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66																			
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61																			
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56																			
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52																			
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49																			
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	348484
5°	347605
10°	347313
15°	336604
20°	306435
25°	267039
30°	222104
35°	175985
40°	127017
45°	80242
50°	41823
55°	22228
60°	11681
65°	6426
70°	2698
75°	2979
80°	2052
85°	1742

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 80242 cd/sqm



TEST NUMBER: P770044

CATALOG NUMBER: LD6D65D010-EU6DR6555659024-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	564.3	8.6
10°-20°	1545.2	23.5
20°-30°	1888.8	28.7
30°-40°	1532.5	23.3
40°-50°	763.7	11.6
50°-60°	213.0	3.2
60°-70°	48.4	0.7
70°-80°	12.6	0.2
80°-90°	3.2	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3998.2	60.8
0°-40°	5530.7	84.2
0°-60°	6507.4	99.0
0°-90°	6571.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	6571.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5967	
5°	5929	564
15°	5567	1545
25°	4144	1889
35°	2468	1532
45°	972	764
55°	218	213
65°	46	48
75°	13	13
85°	3	3
90°	0	



TEST NUMBER: P770044

CATALOG NUMBER: LD6D65D010-EU6DR6555659024-6LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	5966.8
2.5°	5962.5
5°	5929.1
7.5°	5909.8
10°	5856.4
12.5°	5747.6
15°	5567.0
17.5°	5284.7
20°	4930.4
22.5°	4548.1
25°	4143.9
27.5°	3711.6
30°	3293.4
32.5°	2880.4
35°	2468.3
37.5°	2057.0
40°	1666.0
42.5°	1299.5
45°	971.5
47.5°	676.9
50°	460.3
52.5°	317.4
55°	218.3
57.5°	147.3
60°	100.0
62.5°	69.3
65°	46.5
67.5°	23.7
70°	15.8
72.5°	14.9
75°	13.2
77.5°	8.8
80°	6.1
82.5°	4.4
85°	2.6
87.5°	1.8
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)