

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P770030

Luminaire Tested: LD6D65D010-EU6DR6055659050-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P770030
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-60)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D65D010-EU6DR6055659050-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8905.3 lumens
Efficiency: N/A
Efficacy: 122.3 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 72.8
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P770030
CATALOG NUMBER: LD6D65D010-EU6DR6055659050-6LBS1H

Luminous Intensity Polar Plot

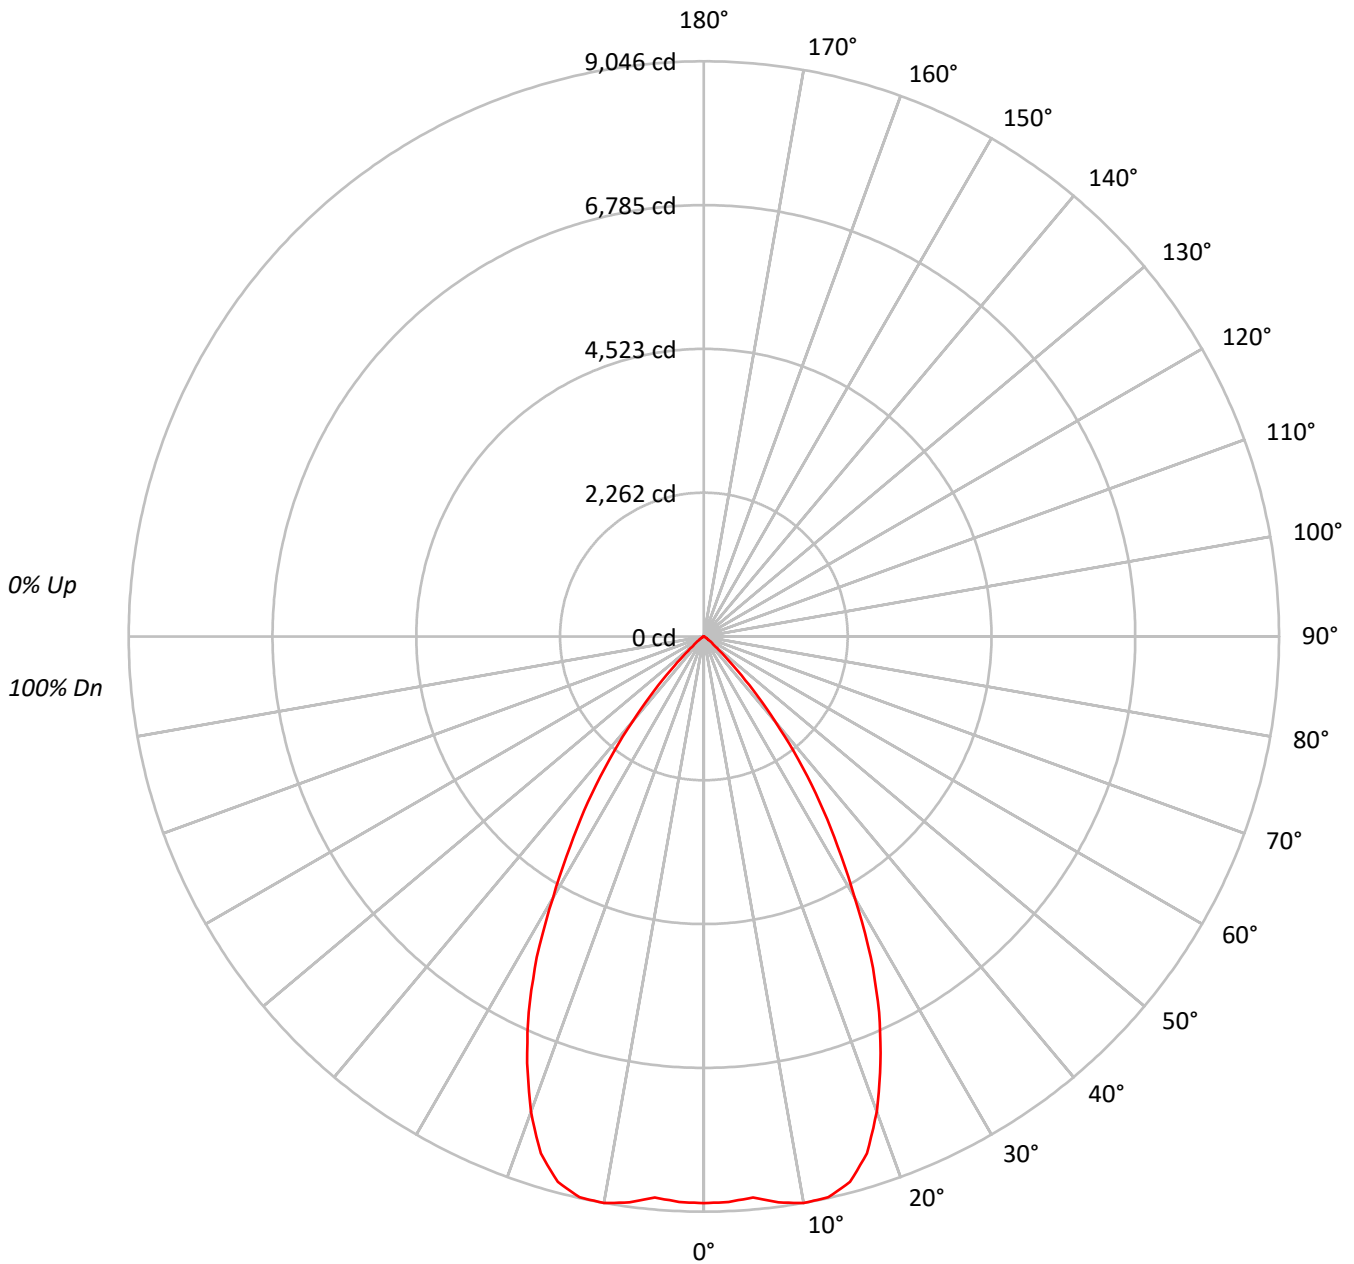



TEST NUMBER: P770030

CATALOG NUMBER: LD6D65D010-EU6DR6055659050-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70
6	87	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65
7	83	74	68	63	82	73	67	63	72	67	63	71	66	63	69	65	62	61
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	61	58	57
9	75	65	59	55	74	65	59	55	64	59	55	63	58	55	62	58	55	53
10	72	62	56	52	71	61	56	52	61	55	52	60	55	52	59	55	52	50

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	973710
5°	971331
10°	1003598
15°	1004631
20°	924369
25°	786241
30°	599087
35°	423650
40°	248775
45°	100375
50°	33520
55°	16135
60°	6621
65°	982
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 100375 cd/sqm



TEST NUMBER: P770030

CATALOG NUMBER: LD6D65D010-EU6DR6055659050-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	854.3	9.6
10°-20°	2460.5	27.6
20°-30°	2944.9	33.1
30°-40°	1969.7	22.1
40°-50°	584.0	6.6
50°-60°	84.0	0.9
60°-70°	8.0	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6259.7	70.3
0°-40°	8229.3	92.4
0°-60°	8897.3	99.9
0°-90°	8905.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8905.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8912	
5°	8856	854
15°	8882	2460
25°	6522	2945
35°	3176	1970
45°	650	584
55°	85	84
65°	4	8
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P770030
CATALOG NUMBER: LD6D65D010-EU6DR6055659050-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	8911.8
2.5°	8900.4
5°	8856.2
7.5°	8976.3
10°	9045.8
12.5°	9033.1
15°	8881.5
17.5°	8523.8
20°	7950.0
22.5°	7261.1
25°	6521.8
27.5°	5688.8
30°	4748.5
32.5°	3909.3
35°	3176.2
37.5°	2441.9
40°	1744.2
42.5°	1150.2
45°	649.6
47.5°	332.4
50°	197.2
52.5°	127.7
55°	84.7
57.5°	54.3
60°	30.3
62.5°	12.6
65°	3.8
67.5°	1.3
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)