

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P770821

Luminaire Tested: LD6D70BD010-EU6DR6570959024-6LBDP1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P770821
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D70BD010-EU6DR6570959024-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 5229.1 lumens
Efficiency: N/A
Efficacy: 78.5 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 66.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P770821

CATALOG NUMBER: LD6D70BD010-EU6DR6570959024-6LBDP1MW

Luminous Intensity Polar Plot

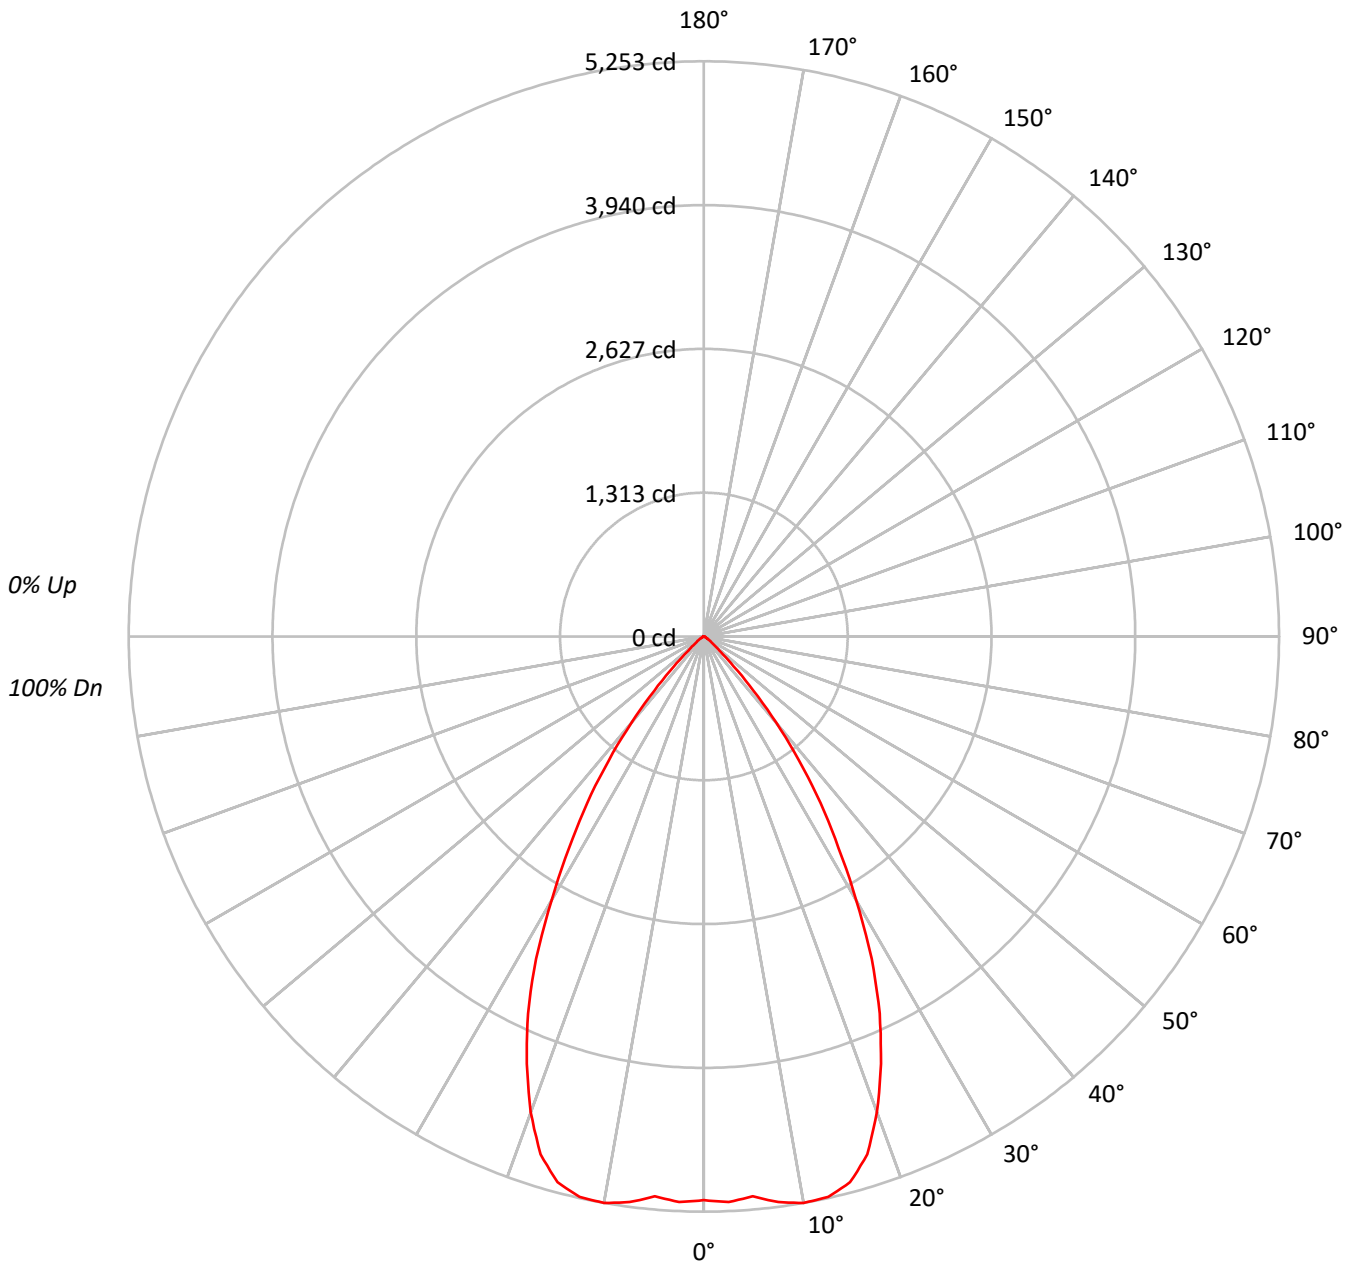



TEST NUMBER: P770821

CATALOG NUMBER: LD6D70BD010-EU6DR6570959024-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10		0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100		
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93		
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87		
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80		
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75		
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69		
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65		
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60		
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57		
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53		
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50		

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	562518
5°	562978
10°	582801
15°	583764
20°	537448
25°	457932
30°	350570
35°	247665
40°	146196
45°	59350
50°	21519
55°	11982
60°	6883
65°	3775
70°	3961
75°	3082
80°	3209
85°	2758

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 59350 cd/sqm



TEST NUMBER: P770821

CATALOG NUMBER: LD6D70BD010-EU6DR6570959024-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	495.7	9.5
10°-20°	1430.0	27.3
20°-30°	1715.7	32.8
30°-40°	1153.0	22.1
40°-50°	345.2	6.6
50°-60°	60.9	1.2
60°-70°	17.3	0.3
70°-80°	8.5	0.2
80°-90°	2.7	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	3641.5	69.6
0°-40°	4794.5	91.7
0°-60°	5200.6	99.5
0°-90°	5229.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	5229.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5148	
5°	5133	496
15°	5161	1430
25°	3798	1716
35°	1857	1153
45°	384	345
55°	63	61
65°	15	17
75°	7	8
85°	2	3
90°	0	



TEST NUMBER: P770821
CATALOG NUMBER: LD6D70BD010-EU6DR6570959024-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

0°	
0°	5148.4
2.5°	5170.3
5°	5133.0
7.5°	5210.6
10°	5253.0
12.5°	5242.7
15°	5160.8
17.5°	4960.3
20°	4622.3
22.5°	4224.3
25°	3798.5
27.5°	3317.9
30°	2778.7
32.5°	2290.0
35°	1856.8
37.5°	1428.8
40°	1025.0
42.5°	669.4
45°	384.1
47.5°	203.4
50°	126.6
52.5°	87.8
55°	62.9
57.5°	45.4
60°	31.5
62.5°	20.5
65°	14.6
67.5°	13.2
70°	12.4
72.5°	9.5
75°	7.3
77.5°	6.6
80°	5.1
82.5°	3.7
85°	2.2
87.5°	1.5
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)