

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P770884

Luminaire Tested: LD6D70BD010-EU6DR6570959050-6LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P770884
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D70BD010-EU6DR6570959050-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7534.9 lumens
Efficiency: N/A
Efficacy: 113.1 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 66.6
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P770884
CATALOG NUMBER: LD6D70BD010-EU6DR6570959050-6LBDP1H

Luminous Intensity Polar Plot

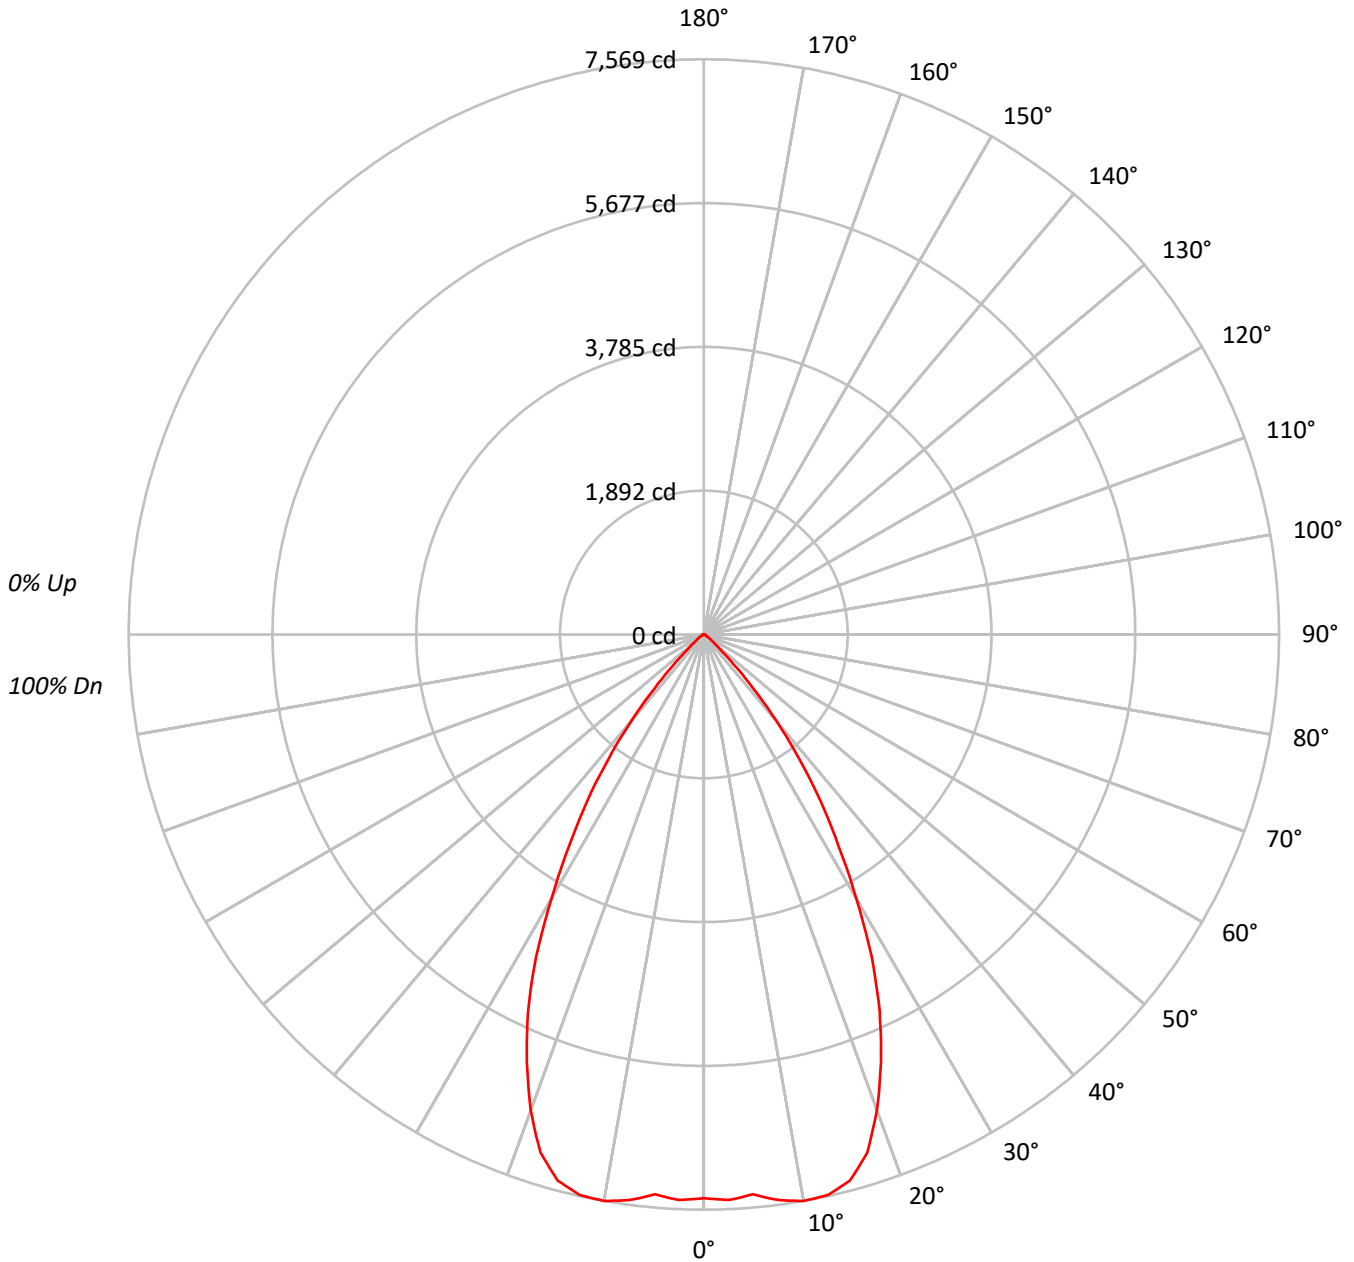



TEST NUMBER: P770884

CATALOG NUMBER: LD6D70BD010-EU6DR6570959050-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	810562
5°	811234
10°	839797
15°	841191
20°	774459
25°	659875
30°	505158
35°	356879
40°	210664
45°	85526
50°	31004
55°	17277
60°	9899
65°	5455
70°	5718
75°	4433
80°	4656
85°	4012

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 85526 cd/sqm



TEST NUMBER: P770884

CATALOG NUMBER: LD6D70BD010-EU6DR6570959050-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	714.4	9.5
10°-20°	2060.6	27.3
20°-30°	2472.3	32.8
30°-40°	1661.5	22.1
40°-50°	497.4	6.6
50°-60°	87.8	1.2
60°-70°	25.0	0.3
70°-80°	12.2	0.2
80°-90°	3.9	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5247.3	69.6
0°-40°	6908.7	91.7
0°-60°	7493.9	99.5
0°-90°	7534.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7534.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	7419	
5°	7396	714
15°	7437	2061
25°	5474	2472
35°	2676	1661
45°	554	497
55°	91	88
65°	21	25
75°	10	12
85°	3	4
90°	0	



TEST NUMBER: P770884

CATALOG NUMBER: LD6D70BD010-EU6DR6570959050-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	7418.6
2.5°	7450.3
5°	7396.5
7.5°	7508.3
10°	7569.4
12.5°	7554.6
15°	7436.6
17.5°	7147.7
20°	6660.7
22.5°	6087.1
25°	5473.6
27.5°	4781.0
30°	4004.0
32.5°	3299.8
35°	2675.6
37.5°	2058.9
40°	1477.0
42.5°	964.6
45°	553.5
47.5°	293.1
50°	182.4
52.5°	126.5
55°	90.7
57.5°	65.4
60°	45.3
62.5°	29.5
65°	21.1
67.5°	19.0
70°	17.9
72.5°	13.7
75°	10.5
77.5°	9.5
80°	7.4
82.5°	5.3
85°	3.2
87.5°	2.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)