

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771288

Luminaire Tested: LD6D75BD010-EU6DR4570959024-6LBDP1LI

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P771288  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D75BD010-EU6DR4570959024-6LBDP1LI  
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 45° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 7861.6 lumens  
Efficiency: N/A  
Efficacy: 108.6 lumens/watt  
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69  
Luminous Opening: Circular (Dia: 0.35' x H: 0')  
CIE Type: Direct

Input Watts (W): 72.4  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight

TEST NUMBER: P771288

CATALOG NUMBER: LD6D75BD010-EU6DR4570959024-6LBDP1LI

### Luminous Intensity Polar Plot

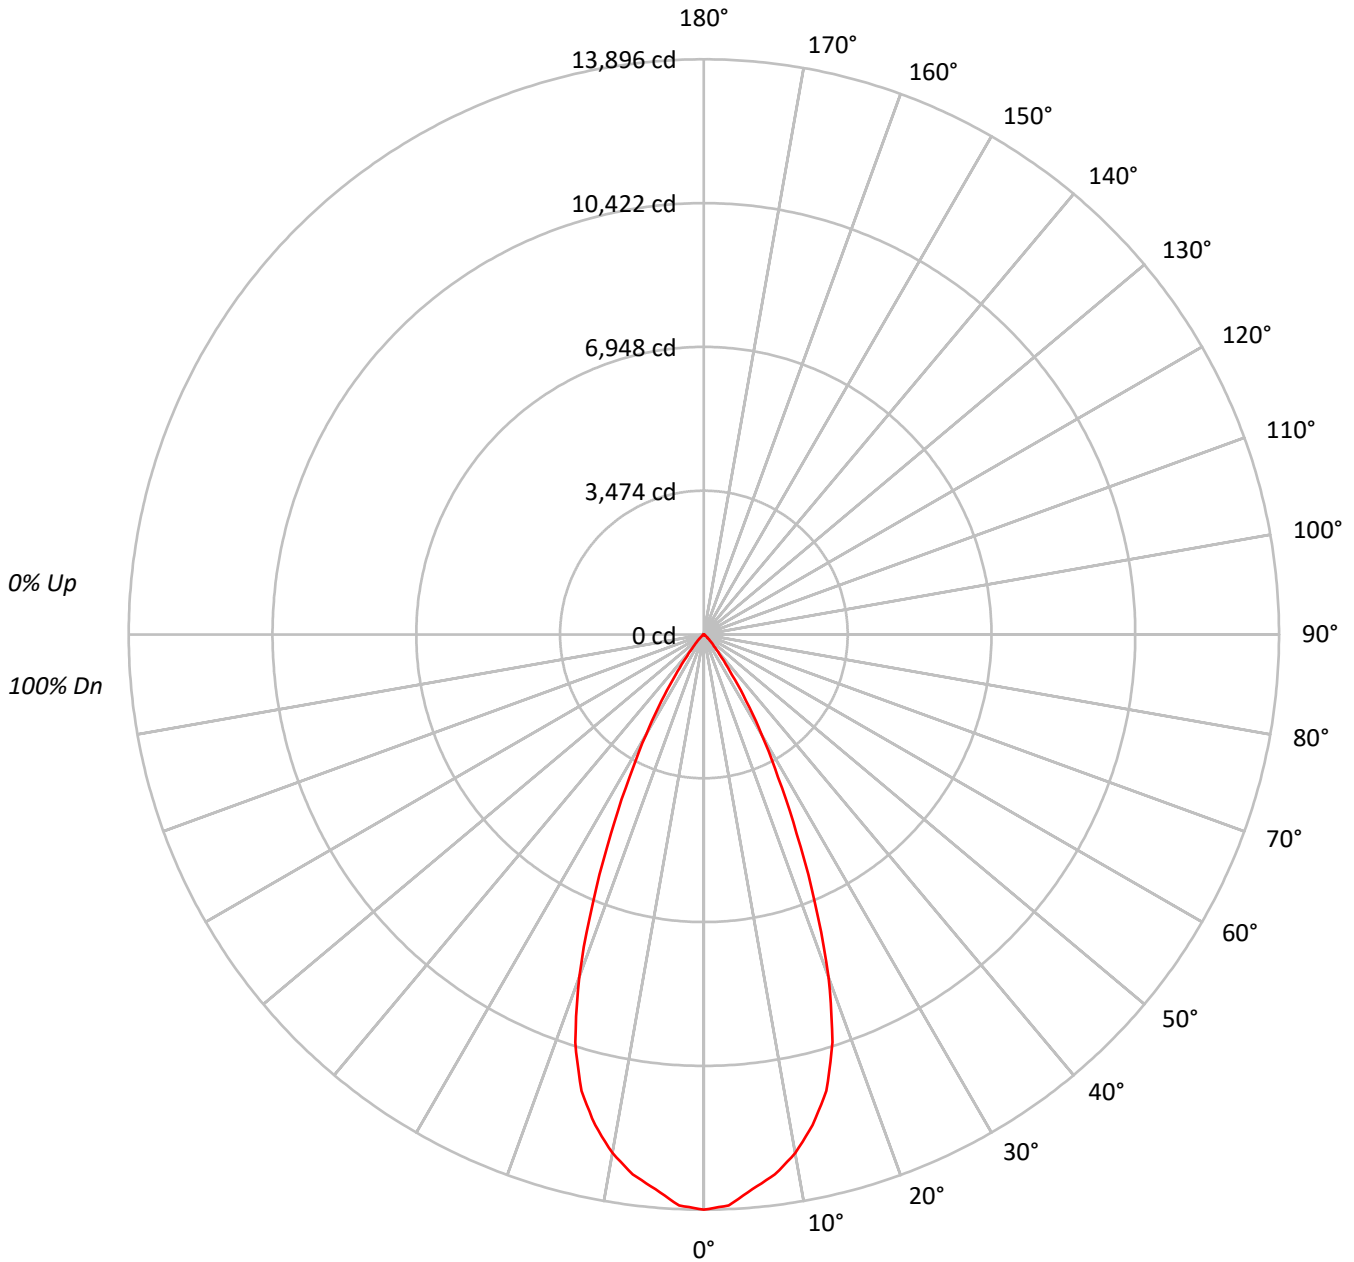



TEST NUMBER: P771288

CATALOG NUMBER: LD6D75BD010-EU6DR4570959024-6LBDP1LI

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			95																
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			90																
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			85																
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			81																
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			77																
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			73																
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			69																
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			66																
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			63																
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			60																

**AVERAGE LUMINANCE (cd/sqm):**

	0°
0°	1518244
5°	1475017
10°	1411192
15°	1291548
20°	1024643
25°	639694
30°	352576
35°	158312
40°	62358
45°	29389
50°	13938
55°	7296
60°	3584
65°	853
70°	351
75°	0
80°	0
85°	0

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 0°  
 Vertical Angle: 45°  
 Luminance: 29389 cd/sqm



TEST NUMBER: P771288

CATALOG NUMBER: LD6D75BD010-EU6DR4570959024-6LBDP1LI

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	1263.6	16.1
10°-20°	3109.9	39.6
20°-30°	2462.8	31.3
30°-40°	820.1	10.4
40°-50°	162.8	2.1
50°-60°	37.0	0.5
60°-70°	5.3	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6836.3	87.0
0°-40°	7656.4	97.4
0°-60°	7856.2	99.9
0°-90°	7861.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7861.6	100.0

**CANDELA DISTRIBUTION:**

	0°	Flux
0°	13896	
5°	13449	###
15°	11418	3110
25°	5306	2463
35°	1187	820
45°	190	163
55°	38	37
65°	3	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P771288

CATALOG NUMBER: LD6D75BD010-EU6DR4570959024-6LBDP1LI

**CANDELA DISTRIBUTION (FULL):**

0°	
0°	13895.6
2.5°	13804.9
5°	13448.6
7.5°	13154.6
10°	12719.6
12.5°	12140.4
15°	11418.0
17.5°	10331.6
20°	8812.4
22.5°	7002.5
25°	5306.2
27.5°	3885.4
30°	2794.6
32.5°	1900.6
35°	1186.9
37.5°	703.9
40°	437.2
42.5°	287.4
45°	190.2
47.5°	122.4
50°	82.0
52.5°	54.6
55°	38.3
57.5°	25.1
60°	16.4
62.5°	8.7
65°	3.3
67.5°	1.1
70°	1.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report





Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)