

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771172

Luminaire Tested: LD6D75BD010-EU6DR3570959035-6LBDP1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P771172
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D75BD010-EU6DR3570959035-6LBDP1MW
Description: 6 INCH ROUND DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7721.9 lumens
Efficiency: N/A
Efficacy: 106.7 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P771172
CATALOG NUMBER: LD6D75BD010-EU6DR3570959035-6LBDP1MW

Luminous Intensity Polar Plot

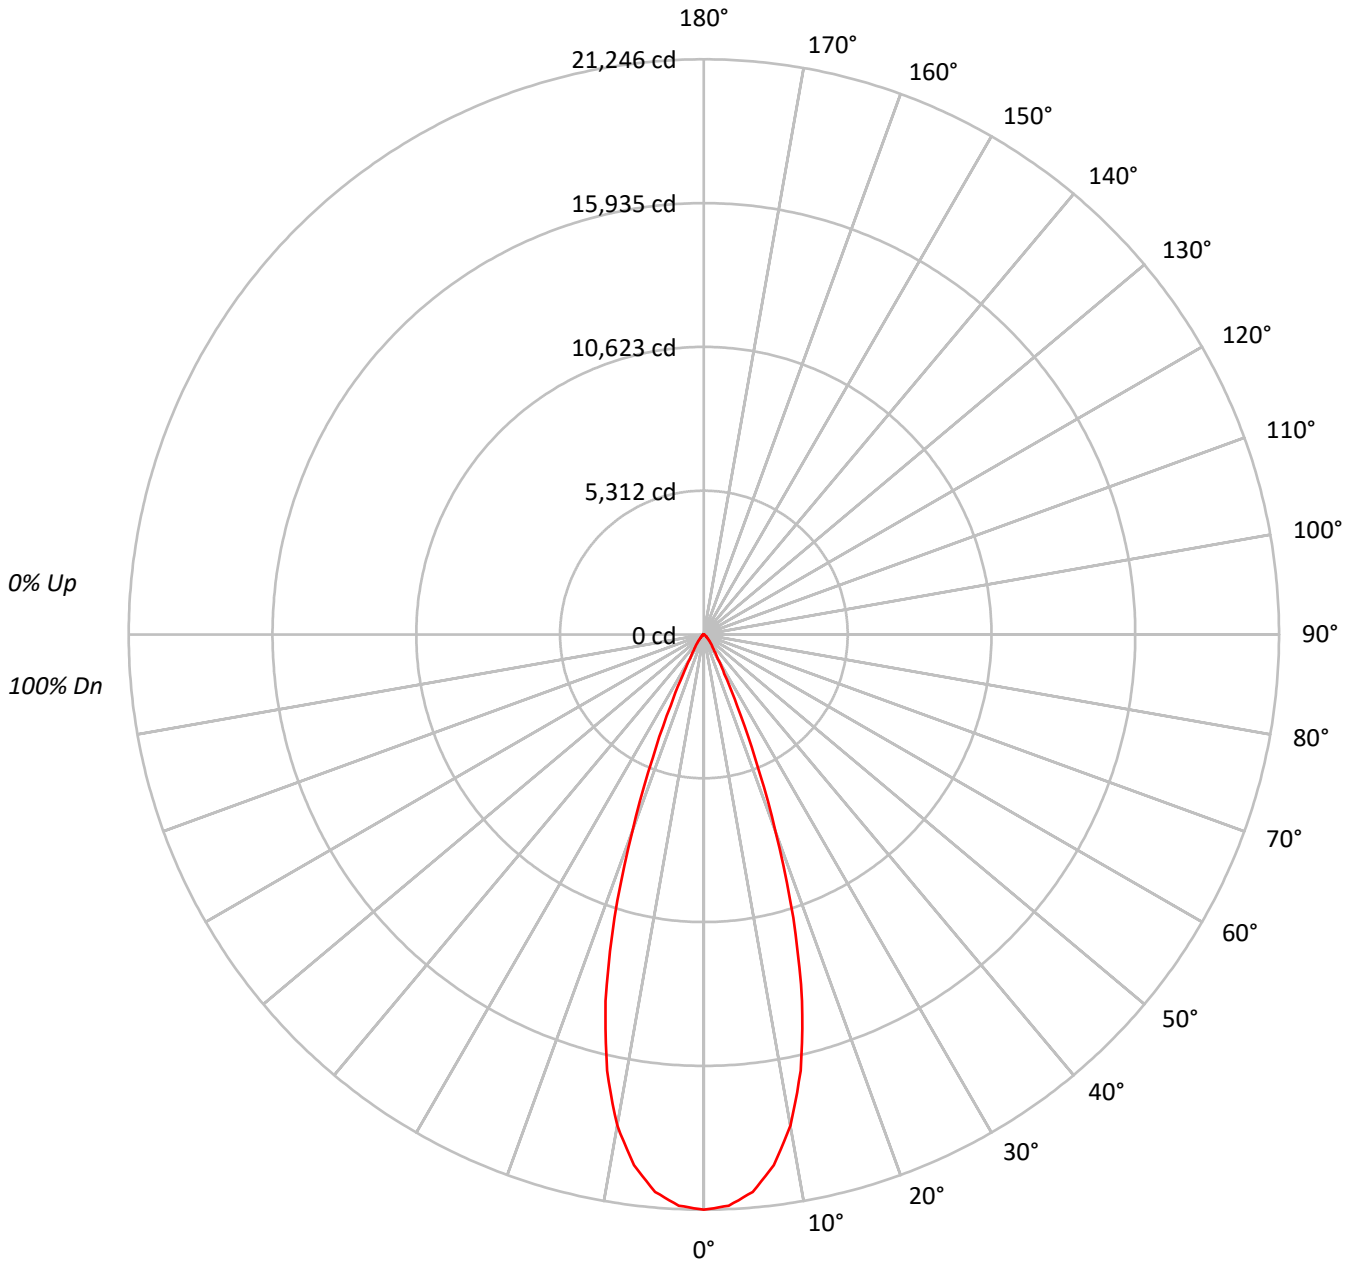



TEST NUMBER: P771172

CATALOG NUMBER: LD6D75BD010-EU6DR3570959035-6LBDP1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96			
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92			
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88			
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84			
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81			
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78			
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75			
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72			
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70			
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2321398
5°	2266860
10°	2043042
15°	1585726
20°	899394
25°	349914
30°	130541
35°	71560
40°	46768
45°	28462
50°	18120
55°	12801
60°	9375
65°	5093
70°	383
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 28462 cd/sqm



TEST NUMBER: P771172

CATALOG NUMBER: LD6D75BD010-EU6DR3570959035-6LBDP1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1900.9	24.6
10°-20°	3711.3	48.1
20°-30°	1513.6	19.6
30°-40°	362.2	4.7
40°-50°	151.0	2.0
50°-60°	62.5	0.8
60°-70°	19.6	0.3
70°-80°	0.5	0.0
80°-90°	0.3	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7125.8	92.3
0°-40°	7488.0	97.0
0°-60°	7701.5	99.7
0°-90°	7721.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7721.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	21246	
5°	20668	###
15°	14019	3711
25°	2902	1514
35°	536	362
45°	184	151
55°	67	63
65°	20	20
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P771172

CATALOG NUMBER: LD6D75BD010-EU6DR3570959035-6LBDP1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	21246.4
2.5°	21119.0
5°	20668.3
7.5°	19769.1
10°	18414.7
12.5°	16507.5
15°	14018.7
17.5°	10974.9
20°	7735.2
22.5°	4932.4
25°	2902.5
27.5°	1640.7
30°	1034.7
32.5°	726.5
35°	536.5
37.5°	414.8
40°	327.9
42.5°	252.6
45°	184.2
47.5°	137.9
50°	106.6
52.5°	84.6
55°	67.2
57.5°	54.5
60°	42.9
62.5°	31.3
65°	19.7
67.5°	7.0
70°	1.2
72.5°	1.2
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.2
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)