

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771325

Luminaire Tested: LD6D75BD010-EU6DR4570959035-6LBDP1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P771325
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D75BD010-EU6DR4570959035-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7783.5 lumens
Efficiency: N/A
Efficacy: 107.5 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P771325
CATALOG NUMBER: LD6D75BD010-EU6DR4570959035-6LBDP1B

Luminous Intensity Polar Plot

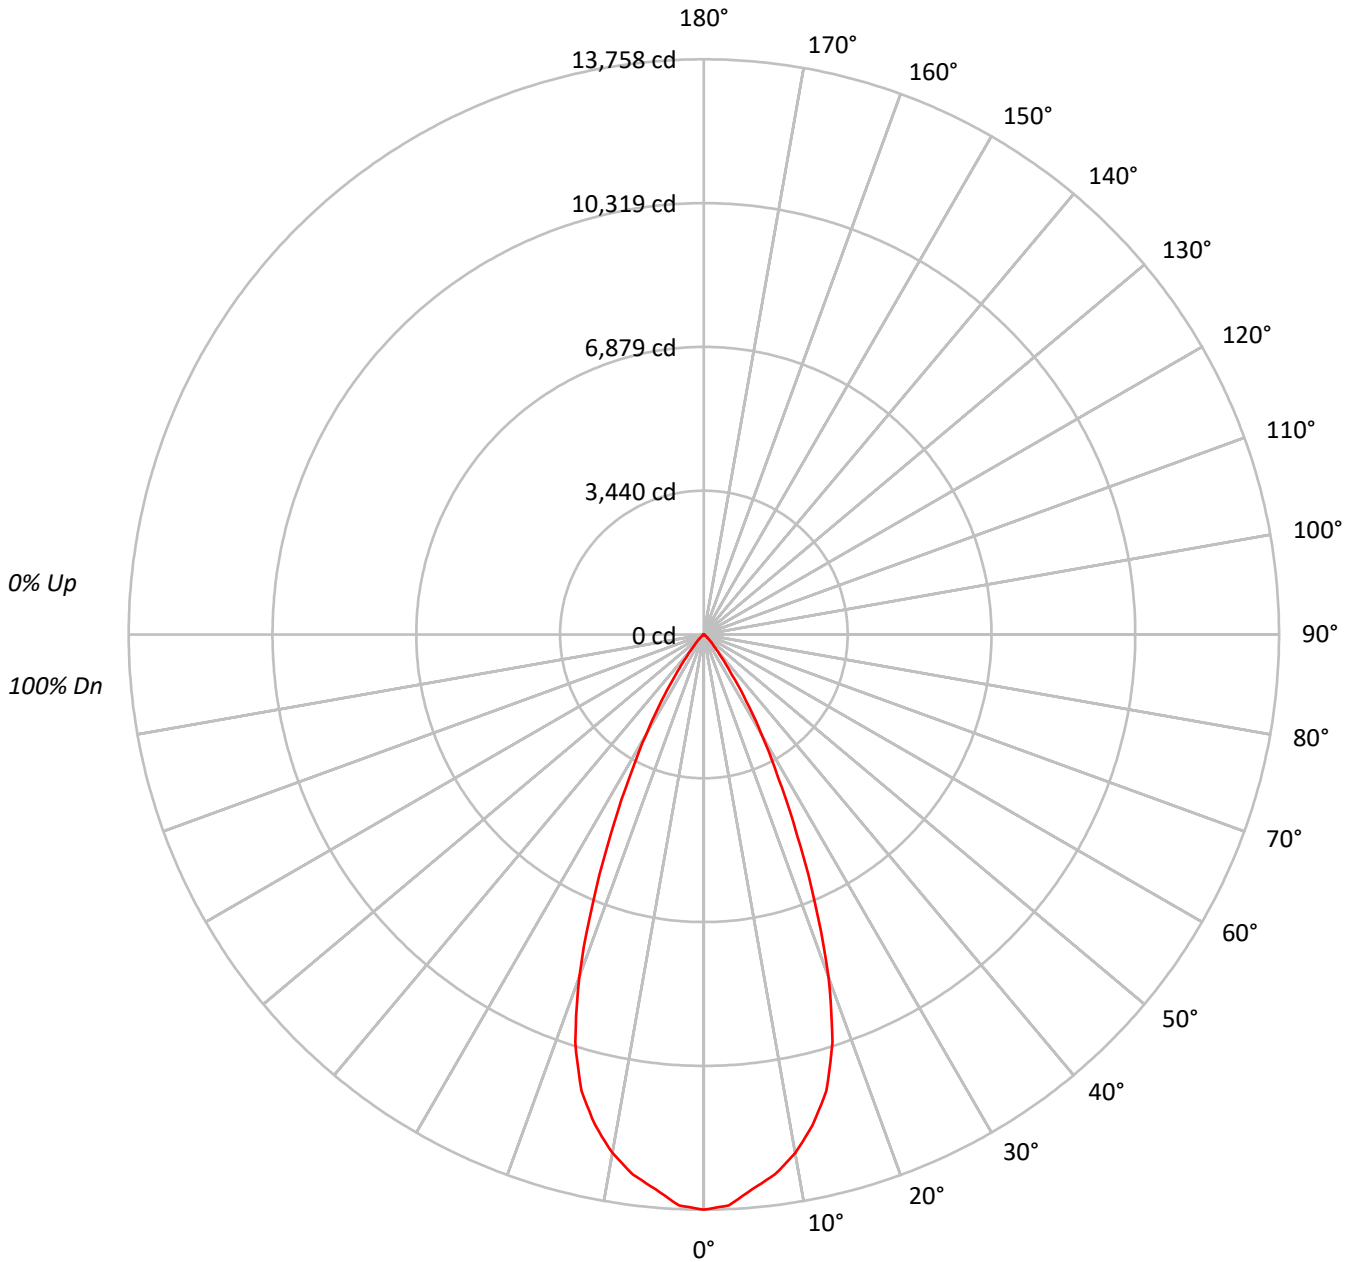



TEST NUMBER: P771325

CATALOG NUMBER: LD6D75BD010-EU6DR4570959035-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1503155
5°	1460364
10°	1397169
15°	1278709
20°	1014458
25°	633340
30°	349082
35°	156738
40°	61730
45°	29096
50°	13802
55°	7220
60°	3540
65°	827
70°	351
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 29096 cd/sqm



TEST NUMBER: P771325

CATALOG NUMBER: LD6D75BD010-EU6DR4570959035-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1251.1	16.1
10°-20°	3079.0	39.6
20°-30°	2438.3	31.3
30°-40°	812.0	10.4
40°-50°	161.2	2.1
50°-60°	36.6	0.5
60°-70°	5.3	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6768.4	87.0
0°-40°	7580.4	97.4
0°-60°	7778.1	99.9
0°-90°	7783.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7783.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	13758	
5°	13315	###
15°	11304	3079
25°	5254	2438
35°	1175	812
45°	188	161
55°	38	37
65°	3	5
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P771325

CATALOG NUMBER: LD6D75BD010-EU6DR4570959035-6LBDP1B

CANDELA DISTRIBUTION (FULL):

0°	
0°	13757.5
2.5°	13667.7
5°	13315.0
7.5°	13023.9
10°	12593.2
12.5°	12019.7
15°	11304.5
17.5°	10228.9
20°	8724.8
22.5°	6932.9
25°	5253.5
27.5°	3846.8
30°	2766.9
32.5°	1881.7
35°	1175.1
37.5°	696.9
40°	432.8
42.5°	284.6
45°	188.3
47.5°	121.2
50°	81.2
52.5°	54.1
55°	37.9
57.5°	24.9
60°	16.2
62.5°	8.7
65°	3.2
67.5°	1.1
70°	1.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)