

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771511

Luminaire Tested: LD6D75BD010-EU6DR5570959050-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P771511
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D75BD010-EU6DR5570959050-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9181.6 lumens
Efficiency: N/A
Efficacy: 126.8 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 72.4
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P771511
CATALOG NUMBER: LD6D75BD010-EU6DR5570959050-6LBS1B

Luminous Intensity Polar Plot

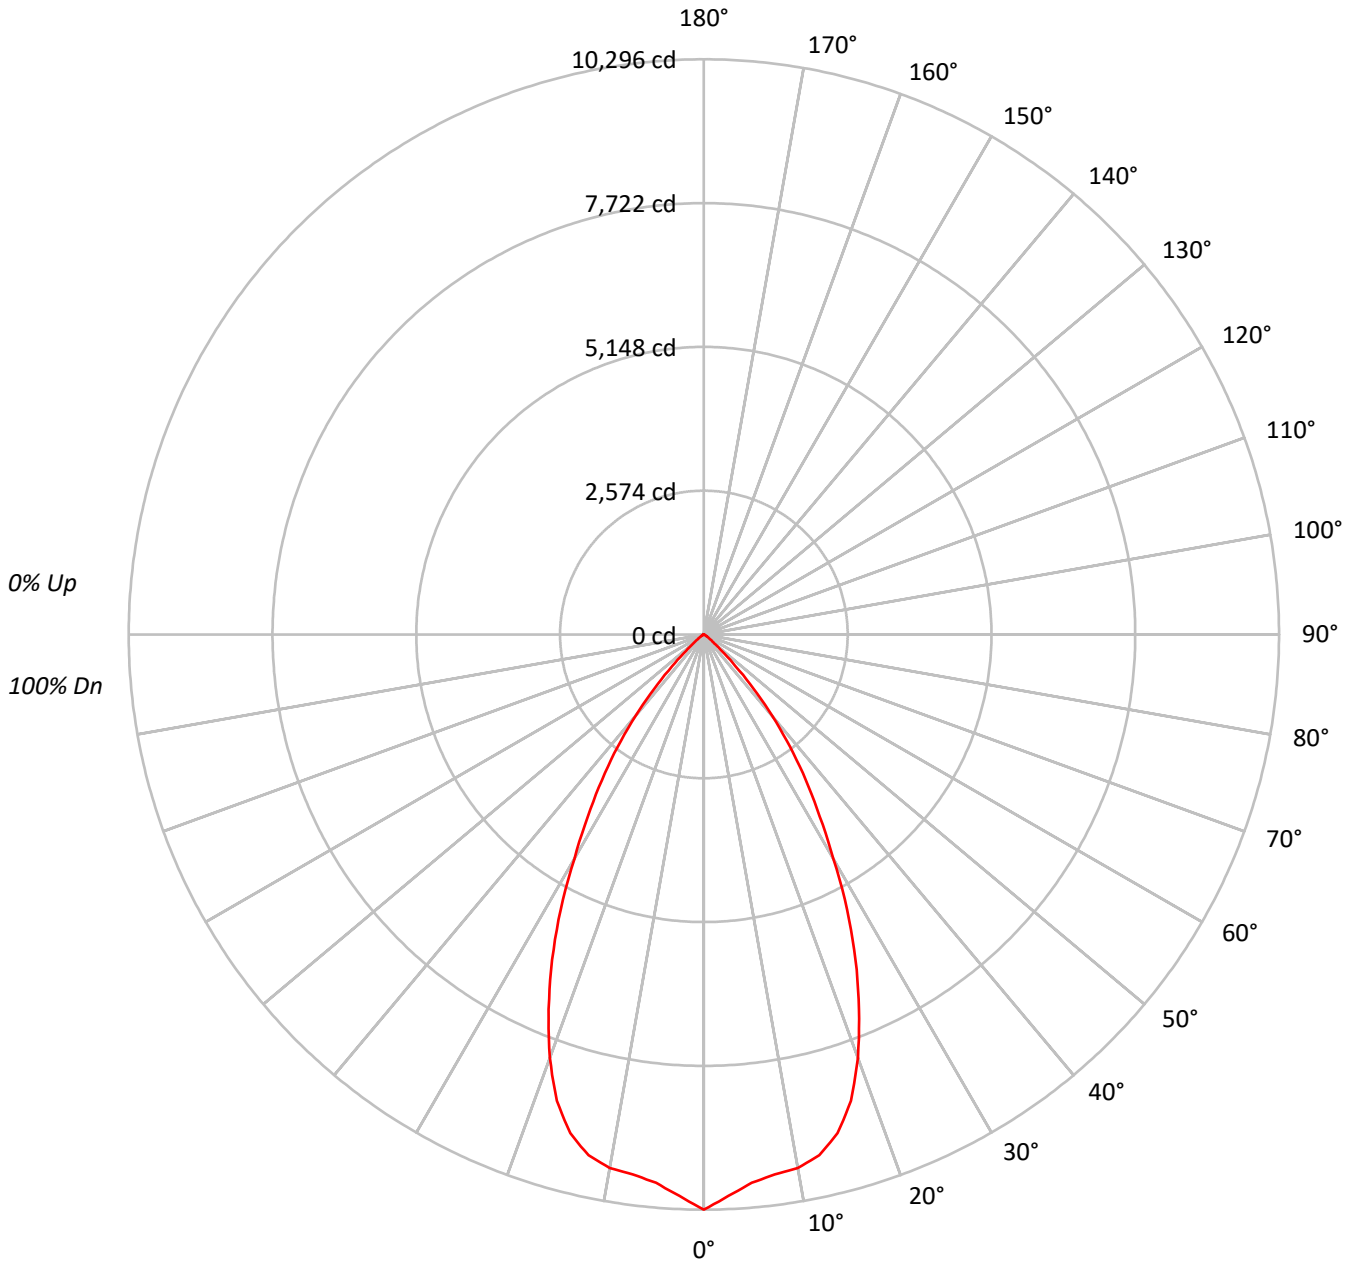



TEST NUMBER: P771511

CATALOG NUMBER: LD6D75BD010-EU6DR5570959050-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	114	111	108	106	111	109	106	104	105	103	101	101	99	98	97	96	95	94
2	108	103	99	96	106	101	98	95	98	95	92	95	93	90	92	90	89	87
3	102	96	91	87	100	95	90	86	92	88	85	90	86	84	87	85	82	81
4	97	90	84	80	95	88	83	79	86	82	78	84	81	78	82	79	77	75
5	92	84	78	74	91	83	77	73	81	76	73	79	75	72	78	74	71	70
6	88	79	73	68	86	78	72	68	76	71	68	75	70	67	74	70	67	65
7	83	74	68	64	82	73	67	63	72	67	63	71	66	63	70	65	62	61
8	79	69	63	59	78	69	63	59	68	63	59	67	62	59	66	62	58	57
9	75	66	60	56	74	65	59	55	64	59	55	63	58	55	62	58	55	54
10	72	62	56	52	71	61	56	52	61	56	52	60	55	52	59	55	52	50

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1124916
5°	1080231
10°	1076168
15°	1045251
20°	937217
25°	774560
30°	585083
35°	424237
40°	271496
45°	124001
50°	40557
55°	17506
60°	7517
65°	982
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 124001 cd/sqm



TEST NUMBER: P771511

CATALOG NUMBER: LD6D75BD010-EU6DR5570959050-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	937.2	10.2
10°-20°	2557.8	27.9
20°-30°	2914.8	31.7
30°-40°	1984.3	21.6
40°-50°	683.8	7.4
50°-60°	94.5	1.0
60°-70°	9.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6409.8	69.8
0°-40°	8394.1	91.4
0°-60°	9172.5	99.9
0°-90°	9181.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9181.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	10296	
5°	9849	937
15°	9241	2558
25°	6425	2915
35°	3181	1984
45°	802	684
55°	92	95
65°	4	9
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P771511

CATALOG NUMBER: LD6D75BD010-EU6DR5570959050-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	10295.7
2.5°	10059.6
5°	9849.1
7.5°	9745.8
10°	9699.9
12.5°	9546.8
15°	9240.6
17.5°	8754.5
20°	8060.5
22.5°	7259.3
25°	6424.9
27.5°	5556.1
30°	4637.5
32.5°	3859.3
35°	3180.6
37.5°	2535.0
40°	1903.5
42.5°	1319.2
45°	802.5
47.5°	432.5
50°	238.6
52.5°	141.6
55°	91.9
57.5°	58.7
60°	34.4
62.5°	15.3
65°	3.8
67.5°	1.3
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)