

Scaled data based on original data using  
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-  
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P758916

Luminaire Tested: LD6D08D010-EU6DR150210IC9024-6LBDP1B

Issue Date: 2/2/2024

**Test Information**

Test Method: LM-79-2019  
Report Number: P758916  
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)  
Test Lab: COOPER LIGHTING SOLUTIONS  
Issue Date: 2/2/2024  
Manufacturer: COOPER LIGHTING SOLUTIONS  
Product Line: PORTFOLIO  
Catalog Number: LD6D08D010-EU6DR150210IC9024-6LBDP1B  
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 15° OPTIC  
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT  
Ballast/Driver: -

**Summary**

Lumens per Lamp: N/A  
Luminaire Lumens: 640.1 lumens  
Efficiency: N/A  
Efficacy: 71.9 lumens/watt  
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23  
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')  
CIE Type: Direct

Input Watts (W): 8.9  
Input Voltage (V): NR  
Input Current (A<sub>in</sub>): NR  
Voltage Rise (V): NR  
Power Factor: NR  
Total Harmonic Distortion (THDi): NR  
Frequency (hertz): 60  
Stabilization Time: NR  
Operation Time: NR  
Ambient Temperature (°C): NR  
Test Distance: 24 FT




Downlight



TEST NUMBER: P758916

CATALOG NUMBER: LD6D08D010-EU6DR150210IC9024-6LBDP1B

### Luminous Intensity Polar Plot

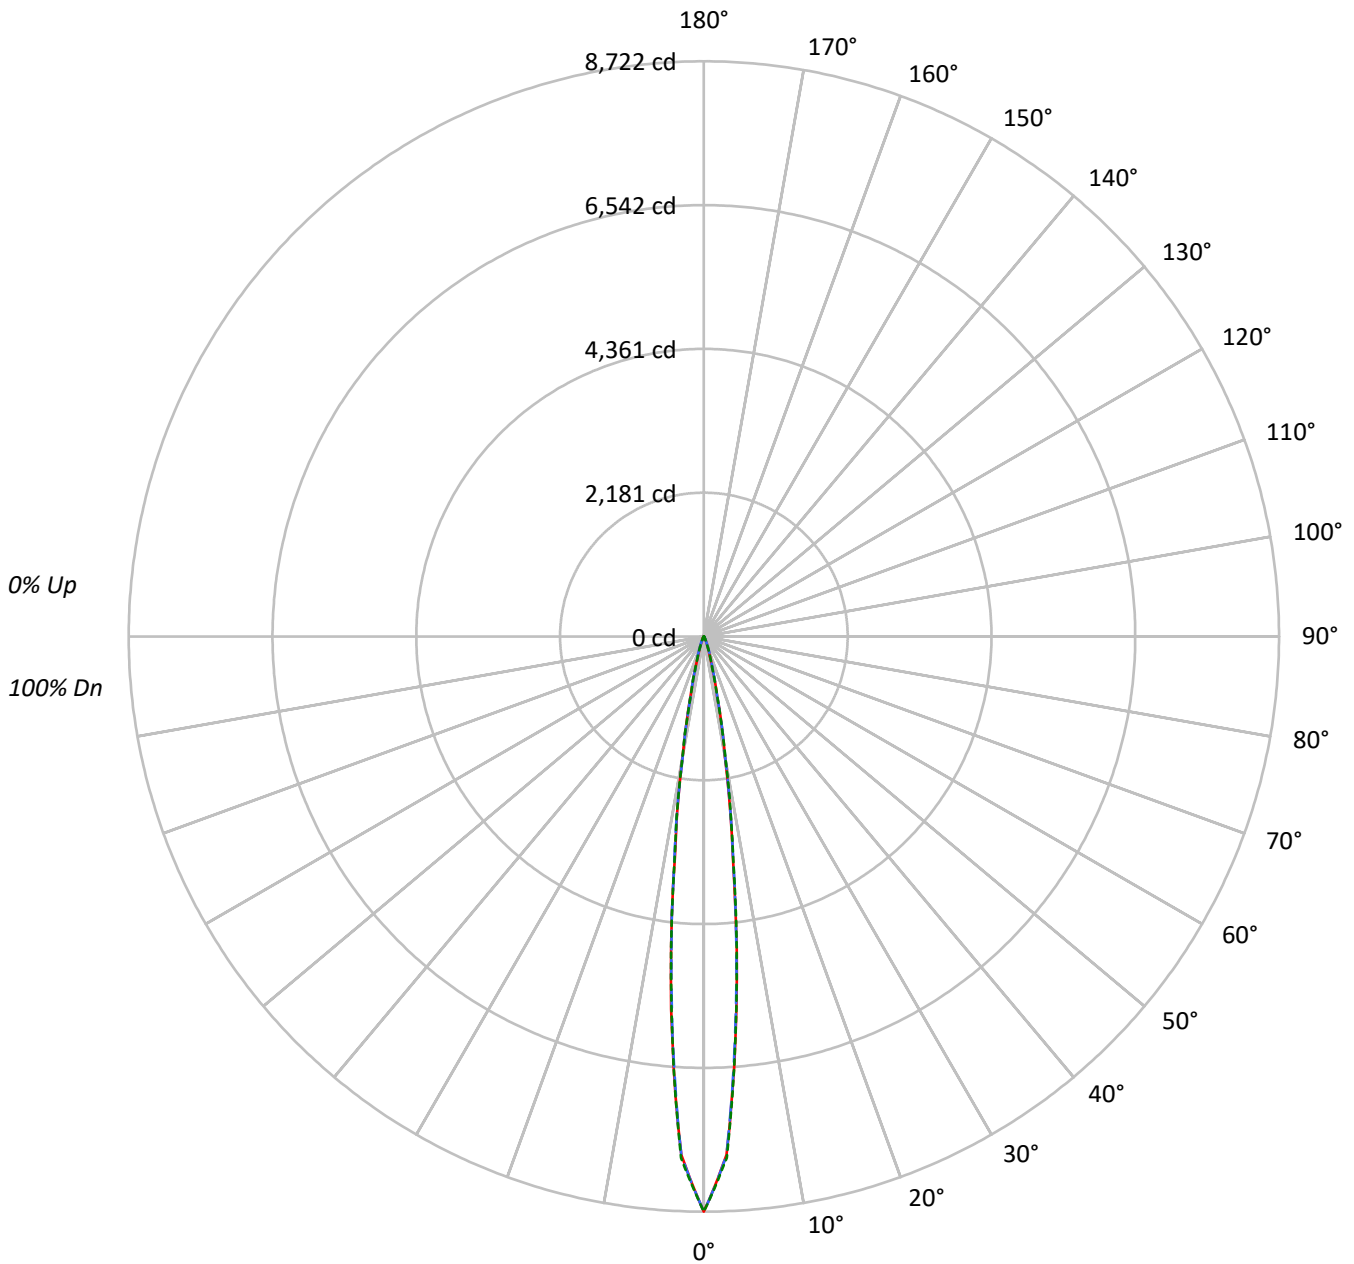



TEST NUMBER: P758916

CATALOG NUMBER: LD6D08D010-EU6DR150210IC9024-6LBDP1B

**COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:**

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98																			
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96																			
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94																			
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93																			
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92																			
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90																			
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89																			
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88																			
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87																			
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86																			

**AVERAGE LUMINANCE (cd/sqm):**

	0°	45°	90°
0°	981388	981388	981388
5°	576714	569244	573746
10°	172125	173328	175978
15°	42812	43646	42299
20°	12813	14834	13083
25°	4518	5749	4573
30°	1662	2187	1685
35°	828	937	806
40°	526	575	526
45°	385	413	385
50°	306	306	306
55°	258	258	258
60°	211	211	211
65°	157	157	157
70°	132	132	132
75°	83	83	113
80°	55	55	55
85°	33	33	33

**MAXIMUM LUMINANCE 45°-90°:**

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 413 cd/sqm



TEST NUMBER: P758916

CATALOG NUMBER: LD6D08D010-EU6DR150210IC9024-6LBDP1B

**ZONAL LUMENS:**

Zone	Lumens	% Fixture
0°-10°	415.2	64.9
10°-20°	170.8	26.7
20°-30°	33.9	5.3
30°-40°	8.5	1.3
40°-50°	4.4	0.7
50°-60°	3.3	0.5
60°-70°	2.3	0.4
70°-80°	1.3	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	619.9	96.8
0°-40°	628.4	98.2
0°-60°	636.1	99.4
0°-90°	640.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	640.1	100.0

**CANDELA DISTRIBUTION:**

	0°	22.5°	45°	67.5°	90°	Flux
0°	8722	8722	8722	8722	8722	
5°	5675	5616	5601	5640	5646	414
15°	493	502	502	494	487	169
25°	58	66	74	65	59	30
35°	11	12	13	12	11	8
45°	6	6	6	6	6	4
55°	4	4	4	4	4	3
65°	2	2	2	2	2	2
75°	1	1	1	1	2	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P758916

CATALOG NUMBER: LD6D08D010-EU6DR150210IC9024-6LBDP1B

**CANDELA DISTRIBUTION (FULL):**

	0°	22.5°	45°	67.5°	90°
0°	8721.9	8721.9	8721.9	8721.9	8721.9
2.5°	7867.5	7874.2	7876.8	7884.5	7913.3
5°	5674.7	5616.3	5601.2	5640.0	5645.5
7.5°	3361.5	3373.3	3416.5	3426.1	3391.4
10°	1844.7	1859.8	1857.6	1870.9	1886.0
12.5°	943.4	931.6	927.9	943.0	922.0
15°	492.9	502.2	502.5	493.7	487.0
17.5°	265.1	275.8	293.5	279.1	257.0
20°	156.6	166.2	181.3	169.5	159.9
22.5°	96.7	104.5	115.2	106.0	98.2
25°	58.0	65.7	73.8	65.4	58.7
27.5°	34.3	41.0	46.2	40.6	34.0
30°	22.2	25.8	29.2	25.5	22.5
32.5°	15.5	17.0	18.5	17.0	15.5
35°	11.4	12.2	12.9	12.2	11.1
37.5°	8.9	9.6	10.0	9.2	8.5
40°	7.4	7.8	8.1	7.8	7.4
42.5°	6.3	6.6	6.6	6.6	6.3
45°	5.5	5.5	5.9	5.5	5.5
47.5°	4.8	4.8	5.2	4.8	4.8
50°	4.4	4.4	4.4	4.4	4.4
52.5°	4.1	4.1	4.1	4.1	4.1
55°	3.7	3.7	3.7	3.7	3.7
57.5°	3.3	3.3	3.3	3.3	3.3
60°	3.0	3.0	3.0	3.0	3.0
62.5°	2.6	2.6	2.6	2.6	2.6
65°	2.2	2.2	2.2	2.2	2.2
67.5°	2.2	2.2	2.2	2.2	2.2
70°	1.8	1.8	1.8	1.8	1.8
72.5°	1.5	1.5	1.5	1.5	1.5
75°	1.1	1.1	1.1	1.1	1.5
77.5°	1.1	1.1	1.1	1.1	1.1
80°	0.7	0.7	0.7	0.7	0.7
82.5°	0.7	0.7	0.7	0.7	0.7
85°	0.4	0.4	0.4	0.4	0.4
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report







— 0°-180°    - - 45°-225°    - - - - 90°-270°

Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal  
Cooper Lighting Solutions Photometric Lab  
1121 Highway 74 South  
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)