

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P759195

Luminaire Tested: LD6D08D010-EU6DR300210IC9035-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P759195
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D08D010-EU6DR300210IC9035-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 885.8 lumens
Efficiency: N/A
Efficacy: 99.5 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P759195
CATALOG NUMBER: LD6D08D010-EU6DR300210IC9035-6LBS1LI

Luminous Intensity Polar Plot

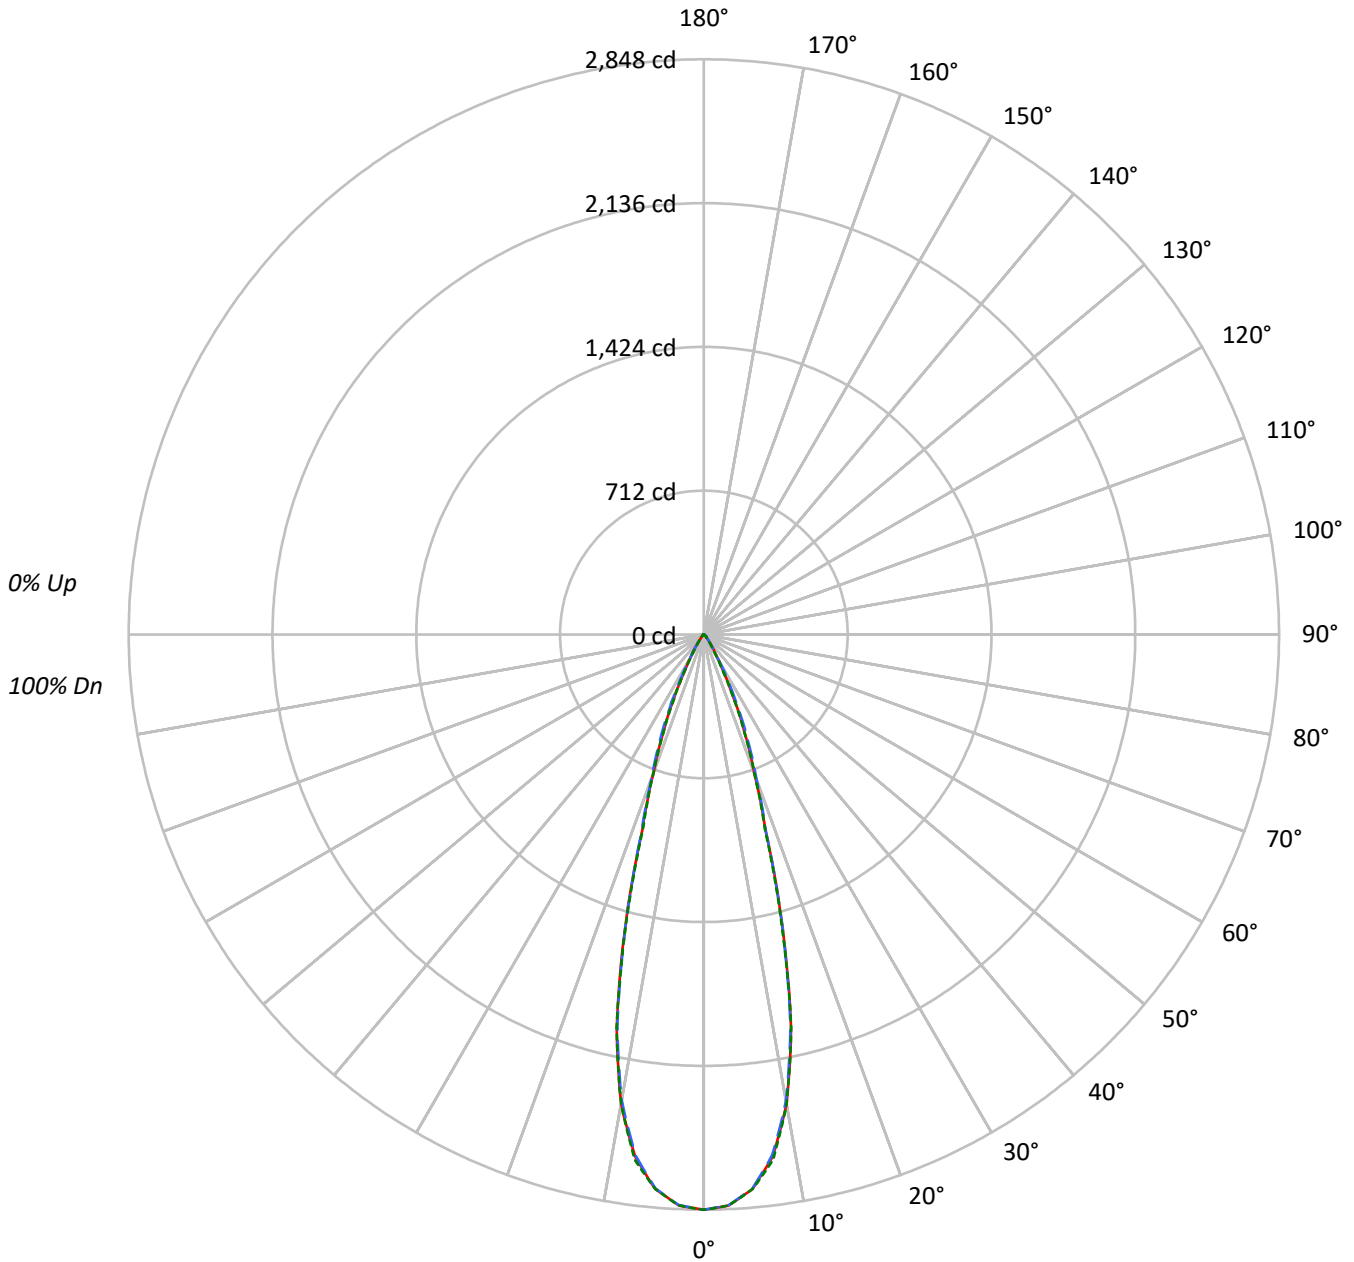



TEST NUMBER: P759195

CATALOG NUMBER: LD6D08D010-EU6DR300210IC9035-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96																			
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92																			
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89																			
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85																			
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82																			
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79																			
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77																			
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74																			
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72																			
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69																			

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	218026	218026	218026
5°	211767	211521	211775
10°	183421	182131	183375
15°	119674	119024	118429
20°	59512	61743	59422
25°	29974	33799	29365
30°	12003	13072	10456
35°	5569	5336	4467
40°	2408	2668	2258
45°	1689	2100	1710
50°	583	1536	619
55°	334	641	347
60°	230	276	230
65°	163	163	163
70°	90	67	90
75°	0	30	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 2100 cd/sqm



TEST NUMBER: P759195

CATALOG NUMBER: LD6D08D010-EU6DR300210IC9035-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	250.5	28.3
10°-20°	403.4	45.5
20°-30°	174.3	19.7
30°-40°	39.7	4.5
40°-50°	13.6	1.5
50°-60°	3.3	0.4
60°-70°	0.9	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	828.2	93.5
0°-40°	867.9	98.0
0°-60°	884.9	99.9
0°-90°	885.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	885.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	2848	2848	2848	2848	2848	
5°	2756	2753	2753	2759	2756	251
15°	1510	1492	1502	1497	1494	404
25°	355	368	400	359	348	170
35°	60	61	57	57	48	40
45°	16	19	19	19	16	11
55°	2	3	5	3	3	2
65°	1	1	1	1	1	1
75°	0	0	0	0	0	0
85°	0	0	0	0	0	0
90°	0	0	0	0	0	



TEST NUMBER: P759195

CATALOG NUMBER: LD6D08D010-EU6DR300210IC9035-6LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	2848.4	2848.4	2848.4	2848.4	2848.4
2.5°	2829.5	2827.5	2828.6	2830.0	2830.6
5°	2756.1	2753.4	2752.9	2758.6	2756.2
7.5°	2608.0	2604.2	2598.4	2611.5	2623.6
10°	2359.9	2355.7	2343.3	2349.4	2359.3
12.5°	1993.6	1980.1	1979.8	1999.4	1996.7
15°	1510.2	1492.0	1502.0	1497.2	1494.5
17.5°	1015.6	1008.6	1022.0	1017.9	1000.4
20°	730.6	732.3	758.0	745.1	729.5
22.5°	533.1	539.7	570.0	536.9	524.7
25°	354.9	368.4	400.2	359.0	347.7
27.5°	218.3	224.4	256.7	215.5	209.4
30°	135.8	132.7	147.9	127.0	118.3
32.5°	89.1	85.1	90.1	80.8	73.9
35°	59.6	60.8	57.1	56.7	47.8
37.5°	37.2	42.8	37.8	40.3	30.8
40°	24.1	31.1	26.7	29.5	22.6
42.5°	19.7	23.9	21.9	23.4	20.1
45°	15.6	19.4	19.4	19.4	15.8
47.5°	8.7	13.0	16.6	13.3	9.2
50°	4.9	6.6	12.9	6.9	5.2
52.5°	3.4	3.8	8.8	3.9	3.5
55°	2.5	2.6	4.8	2.8	2.6
57.5°	1.9	2.1	2.5	2.1	1.9
60°	1.5	1.5	1.8	1.7	1.5
62.5°	1.1	1.1	1.3	1.1	1.1
65°	0.9	0.9	0.9	0.9	0.9
67.5°	0.4	0.6	0.6	0.6	0.6
70°	0.4	0.3	0.3	0.3	0.4
72.5°	0.3	0.1	0.1	0.1	0.1
75°	0.0	0.0	0.1	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)