

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P759740

Luminaire Tested: LD6D08D010-EU6DR650210IC9035-6LBS1H

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P759740
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D08D010-EU6DR650210IC9035-6LBS1H
Description: 6 INCH ROUND SHALLOW SEMI-SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 757.1 lumens
Efficiency: N/A
Efficacy: 85.1 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P759740
CATALOG NUMBER: LD6D08D010-EU6DR650210IC9035-6LBS1H

Luminous Intensity Polar Plot

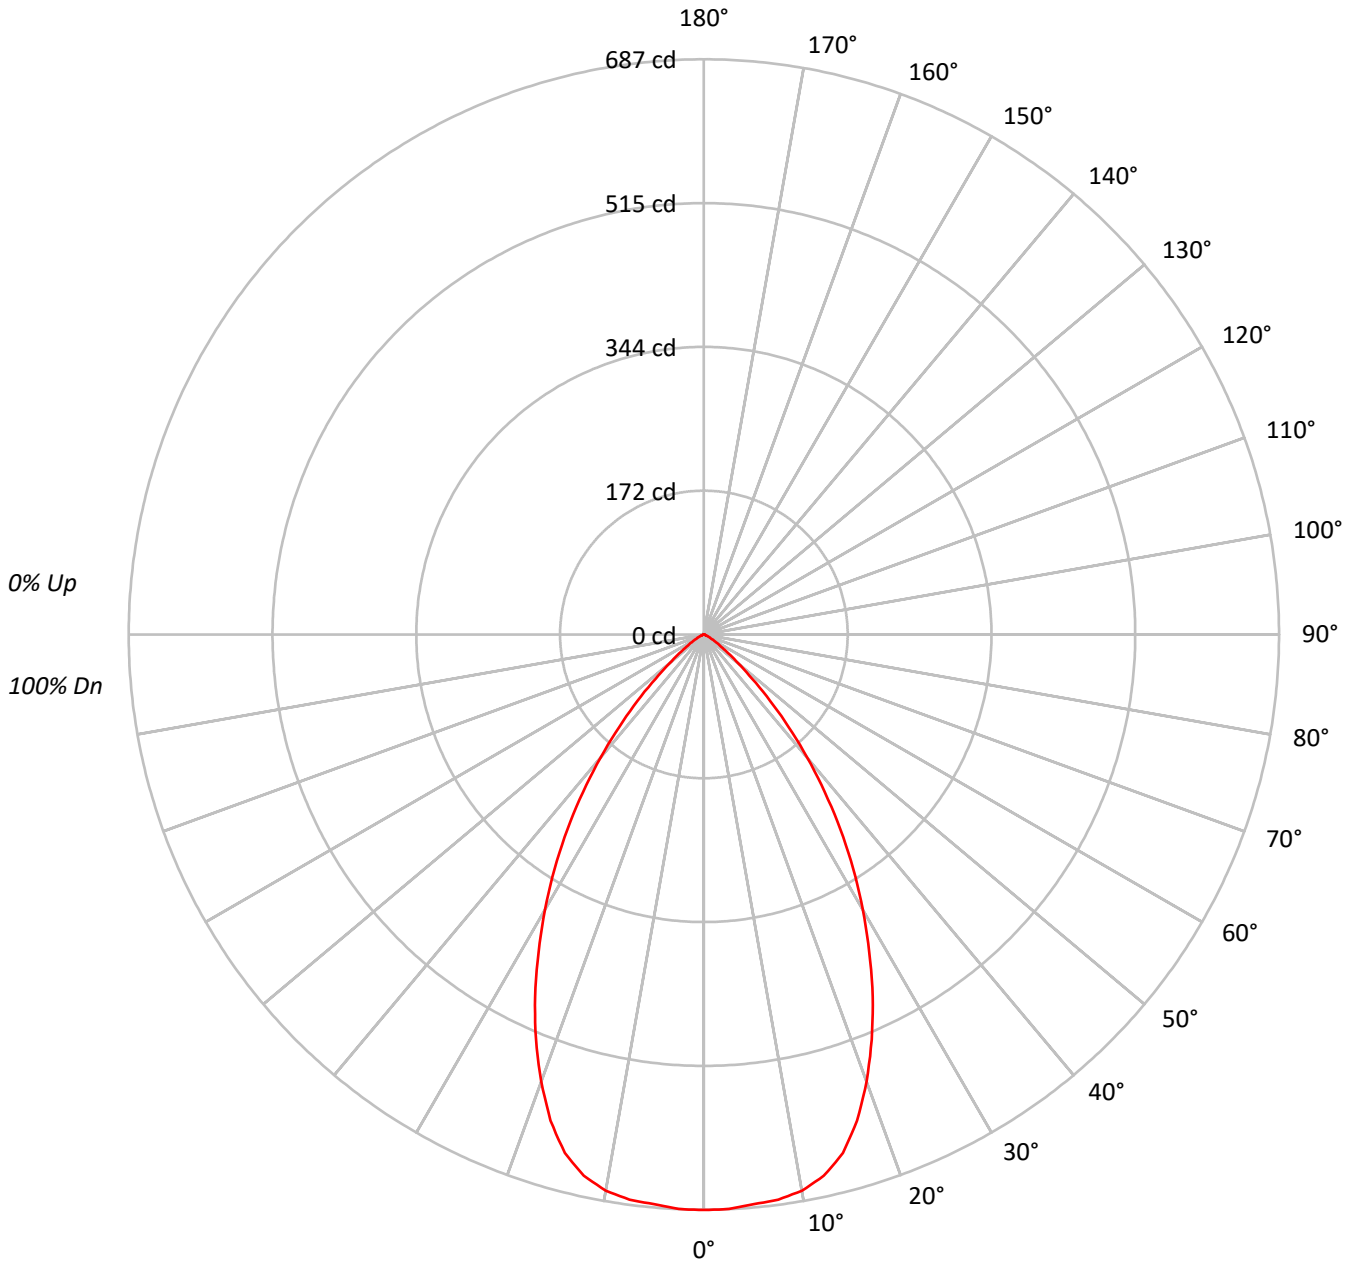



TEST NUMBER: P759740
 CATALOG NUMBER: LD6D08D010-EU6DR650210IC9035-6LBS1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61			61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	40141
5°	40042
10°	40007
15°	38776
20°	35302
25°	30758
30°	25586
35°	20277
40°	14631
45°	9242
50°	4825
55°	2566
60°	1343
65°	732
70°	307
75°	338
80°	235
85°	201

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 9242 cd/sqm



TEST NUMBER: P759740

CATALOG NUMBER: LD6D08D010-EU6DR650210IC9035-6LBS1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	65.0	8.6
10°-20°	178.0	23.5
20°-30°	217.6	28.7
30°-40°	176.6	23.3
40°-50°	88.0	11.6
50°-60°	24.6	3.2
60°-70°	5.6	0.7
70°-80°	1.4	0.2
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	460.6	60.8
0°-40°	637.1	84.2
0°-60°	749.7	99.0
0°-90°	757.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	757.1	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	687	
5°	683	65
15°	641	178
25°	477	218
35°	284	177
45°	112	88
55°	25	25
65°	5	6
75°	2	1
85°	0	0
90°	0	



TEST NUMBER: P759740

CATALOG NUMBER: LD6D08D010-EU6DR650210IC9035-6LBS1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	687.3
2.5°	686.9
5°	683.0
7.5°	680.8
10°	674.6
12.5°	662.1
15°	641.3
17.5°	608.8
20°	568.0
22.5°	523.9
25°	477.3
27.5°	427.5
30°	379.4
32.5°	331.8
35°	284.4
37.5°	237.0
40°	191.9
42.5°	149.7
45°	111.9
47.5°	78.0
50°	53.1
52.5°	36.6
55°	25.2
57.5°	17.0
60°	11.5
62.5°	8.0
65°	5.3
67.5°	2.8
70°	1.8
72.5°	1.7
75°	1.5
77.5°	1.0
80°	0.7
82.5°	0.5
85°	0.3
87.5°	0.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)