

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P758968

Luminaire Tested: LD6D08D010-EU6DR150210IC9040-6LBDP1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P758968
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D08D010-EU6DR150210IC9040-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 796.1 lumens
Efficiency: N/A
Efficacy: 89.4 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P758968

CATALOG NUMBER: LD6D08D010-EU6DR150210IC9040-6LBDP1B

Luminous Intensity Polar Plot

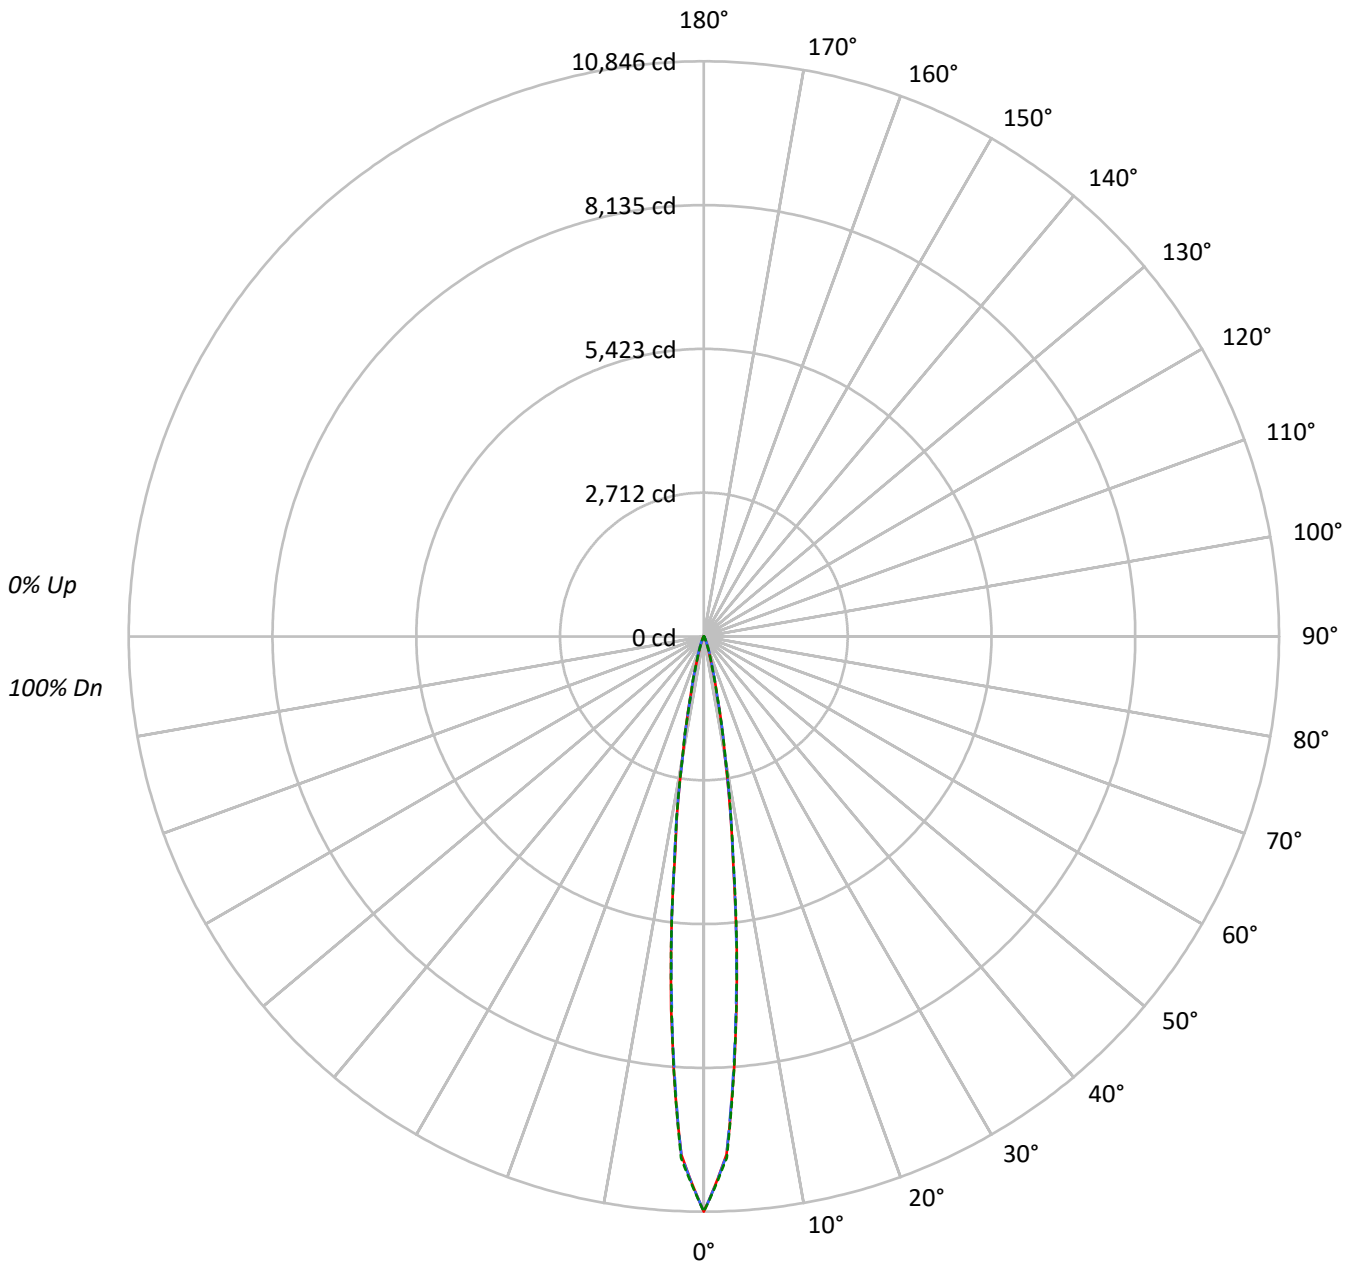



TEST NUMBER: P758968

CATALOG NUMBER: LD6D08D010-EU6DR150210IC9040-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	87	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1220358	1220358	1220358
5°	717134	707855	713455
10°	214029	215531	218834
15°	53235	54277	52601
20°	15931	18443	16266
25°	5617	7151	5687
30°	2059	2718	2097
35°	1031	1169	1002
40°	653	717	653
45°	483	511	483
50°	382	382	382
55°	320	320	320
60°	260	260	260
65°	200	200	200
70°	168	168	168
75°	106	106	136
80°	71	71	71
85°	42	42	42

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 511 cd/sqm



TEST NUMBER: P758968

CATALOG NUMBER: LD6D08D010-EU6DR150210IC9040-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	516.3	64.9
10°-20°	212.4	26.7
20°-30°	42.2	5.3
30°-40°	10.5	1.3
40°-50°	5.5	0.7
50°-60°	4.1	0.5
60°-70°	2.9	0.4
70°-80°	1.6	0.2
80°-90°	0.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	770.8	96.8
0°-40°	781.3	98.2
0°-60°	791.0	99.4
0°-90°	796.1	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	796.1	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	10846	10846	10846	10846	10846	
5°	7056	6984	6965	7013	7020	515
15°	613	624	625	614	606	210
25°	72	82	92	81	73	38
35°	14	15	16	15	14	10
45°	7	7	7	7	7	5
55°	5	5	5	5	5	4
65°	3	3	3	3	3	3
75°	1	1	1	1	2	2
85°	0	0	0	0	0	1
90°	0	0	0	0	0	



TEST NUMBER: P758968

CATALOG NUMBER: LD6D08D010-EU6DR150210IC9040-6LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	10845.7	10845.7	10845.7	10845.7	10845.7
2.5°	9783.2	9791.5	9794.7	9804.3	9840.2
5°	7056.4	6983.9	6965.1	7013.3	7020.2
7.5°	4180.0	4194.6	4248.4	4260.3	4217.1
10°	2293.8	2312.7	2309.9	2326.4	2345.3
12.5°	1173.1	1158.4	1153.8	1172.6	1146.5
15°	612.9	624.4	624.9	613.9	605.6
17.5°	329.7	343.0	365.0	347.1	319.6
20°	194.7	206.6	225.4	210.7	198.8
22.5°	120.3	129.9	143.2	131.8	122.1
25°	72.1	81.7	91.8	81.3	73.0
27.5°	42.7	51.0	57.4	50.5	42.2
30°	27.5	32.1	36.3	31.7	28.0
32.5°	19.3	21.1	23.0	21.1	19.3
35°	14.2	15.2	16.1	15.2	13.8
37.5°	11.0	11.9	12.4	11.5	10.6
40°	9.2	9.6	10.1	9.6	9.2
42.5°	7.8	8.3	8.3	8.3	7.8
45°	6.9	6.9	7.3	6.9	6.9
47.5°	6.0	6.0	6.4	6.0	6.0
50°	5.5	5.5	5.5	5.5	5.5
52.5°	5.1	5.1	5.1	5.1	5.1
55°	4.6	4.6	4.6	4.6	4.6
57.5°	4.1	4.1	4.1	4.1	4.1
60°	3.7	3.7	3.7	3.7	3.7
62.5°	3.2	3.2	3.2	3.2	3.2
65°	2.8	2.8	2.8	2.8	2.8
67.5°	2.8	2.8	2.8	2.8	2.8
70°	2.3	2.3	2.3	2.3	2.3
72.5°	1.8	1.8	1.8	1.8	1.8
75°	1.4	1.4	1.4	1.4	1.8
77.5°	1.4	1.4	1.4	1.4	1.4
80°	0.9	0.9	0.9	0.9	0.9
82.5°	0.9	0.9	0.9	0.9	0.9
85°	0.5	0.5	0.5	0.5	0.5
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)