

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P759050

Luminaire Tested: LD6D08D010-EU6DR200210IC9040-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P759050
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D08D010-EU6DR200210IC9040-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 20° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 880.3 lumens
Efficiency: N/A
Efficacy: 98.9 lumens/watt
Spacing Criteria (0/90/45): 0.34 / 0.34 / 0.36
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P759050
CATALOG NUMBER: LD6D08D010-EU6DR200210IC9040-6LBS1B

Luminous Intensity Polar Plot

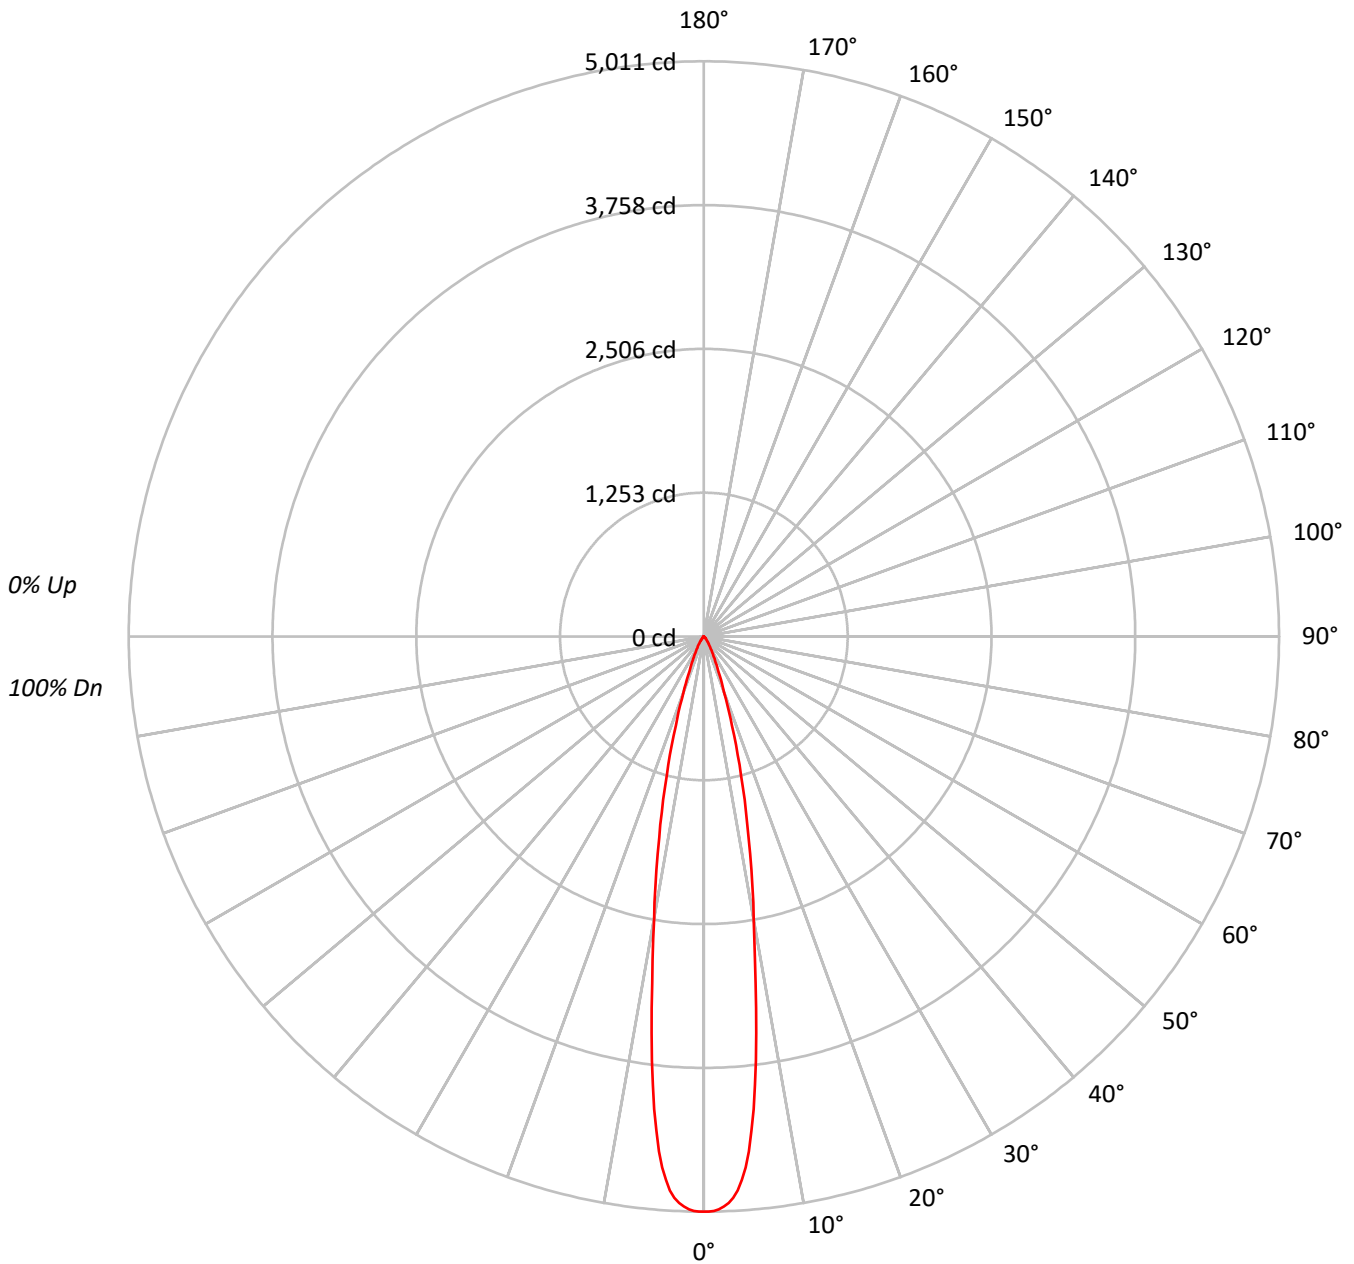



TEST NUMBER: P759050

CATALOG NUMBER: LD6D08D010-EU6DR200210IC9040-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	113	111	109	108	107	106	104	103	102	101	100	99	98	100	99	98	97	98	96	95	94												
2	111	108	105	102	109	106	104	101	103	101	99	100	99	97	98	96	95	98	96	95	94	93	92	91	94												
3	108	103	100	97	106	102	99	96	100	97	95	97	95	93	95	93	92	98	96	95	94	93	92	91	94												
4	105	99	96	93	103	98	95	92	96	93	91	95	92	90	93	91	89	98	96	95	94	93	92	91	88												
5	102	96	92	89	100	95	91	89	94	90	88	92	89	87	91	88	86	98	96	95	94	93	92	91	85												
6	99	93	89	86	98	92	88	86	91	87	85	90	87	84	88	86	84	98	96	95	94	93	92	91	83												
7	96	90	86	83	95	89	86	83	88	85	82	87	84	82	86	84	82	98	96	95	94	93	92	91	81												
8	94	87	83	81	93	87	83	80	86	83	80	85	82	80	84	82	80	98	96	95	94	93	92	91	79												
9	91	85	81	78	91	85	81	78	84	80	78	83	80	78	82	80	78	98	96	95	94	93	92	91	77												
10	89	83	79	76	88	82	79	76	82	78	76	81	78	76	81	78	76	98	96	95	94	93	92	91	75												

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	547484
5°	493924
10°	277221
15°	140919
20°	59660
25°	27547
30°	14584
35°	7856
40°	4193
45°	2488
50°	1445
55°	762
60°	481
65°	336
70°	128
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 2488 cd/sqm



TEST NUMBER: P759050

CATALOG NUMBER: LD6D08D010-EU6DR200210IC9040-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	356.8	40.5
10°-20°	351.3	39.9
20°-30°	114.8	13.0
30°-40°	39.1	4.4
40°-50°	13.1	1.5
50°-60°	4.0	0.4
60°-70°	1.3	0.1
70°-80°	0.1	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	822.8	93.5
0°-40°	861.9	97.9
0°-60°	879.0	99.8
0°-90°	880.3	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	880.3	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	5011	
5°	4503	357
15°	1246	351
25°	228	115
35°	59	39
45°	16	13
55°	4	4
65°	1	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P759050
CATALOG NUMBER: LD6D08D010-EU6DR200210IC9040-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	5010.8
0.5°	5010.8
1°	5004.5
1.5°	4992.0
2°	4969.3
2.5°	4938.9
3°	4896.1
3.5°	4836.3
4°	4747.5
4.5°	4639.5
5°	4503.4
5.5°	4324.5
6°	4141.1
6.5°	3931.0
7°	3725.3
7.5°	3484.3
8°	3269.3
8.5°	3052.9
9°	2853.0
9.5°	2669.6
10°	2498.7
12.5°	1794.2
15°	1245.8
17.5°	813.9
20°	513.1
22.5°	332.4
25°	228.5
27.5°	160.6
30°	115.6
32.5°	83.0
35°	58.9
37.5°	41.0
40°	29.4
42.5°	21.4
45°	16.1
47.5°	12.5
50°	8.5
52.5°	5.4
55°	4.0
57.5°	3.1
60°	2.2
62.5°	1.8
65°	1.3



TEST NUMBER: P759050
CATALOG NUMBER: LD6D08D010-EU6DR200210IC9040-6LBS1B

CANDELA DISTRIBUTION (continued):

	0°
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





67.5°		0.9
70°		0.4

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)