

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P759828

Luminaire Tested: LD6D08D010-EU6DR700210IC9040-6LBDP1LI

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P759828
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D08D010-EU6DR700210IC9040-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 894.0 lumens
Efficiency: N/A
Efficacy: 100.4 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P759828

CATALOG NUMBER: LD6D08D010-EU6DR700210IC9040-6LBDP1LI

Luminous Intensity Polar Plot

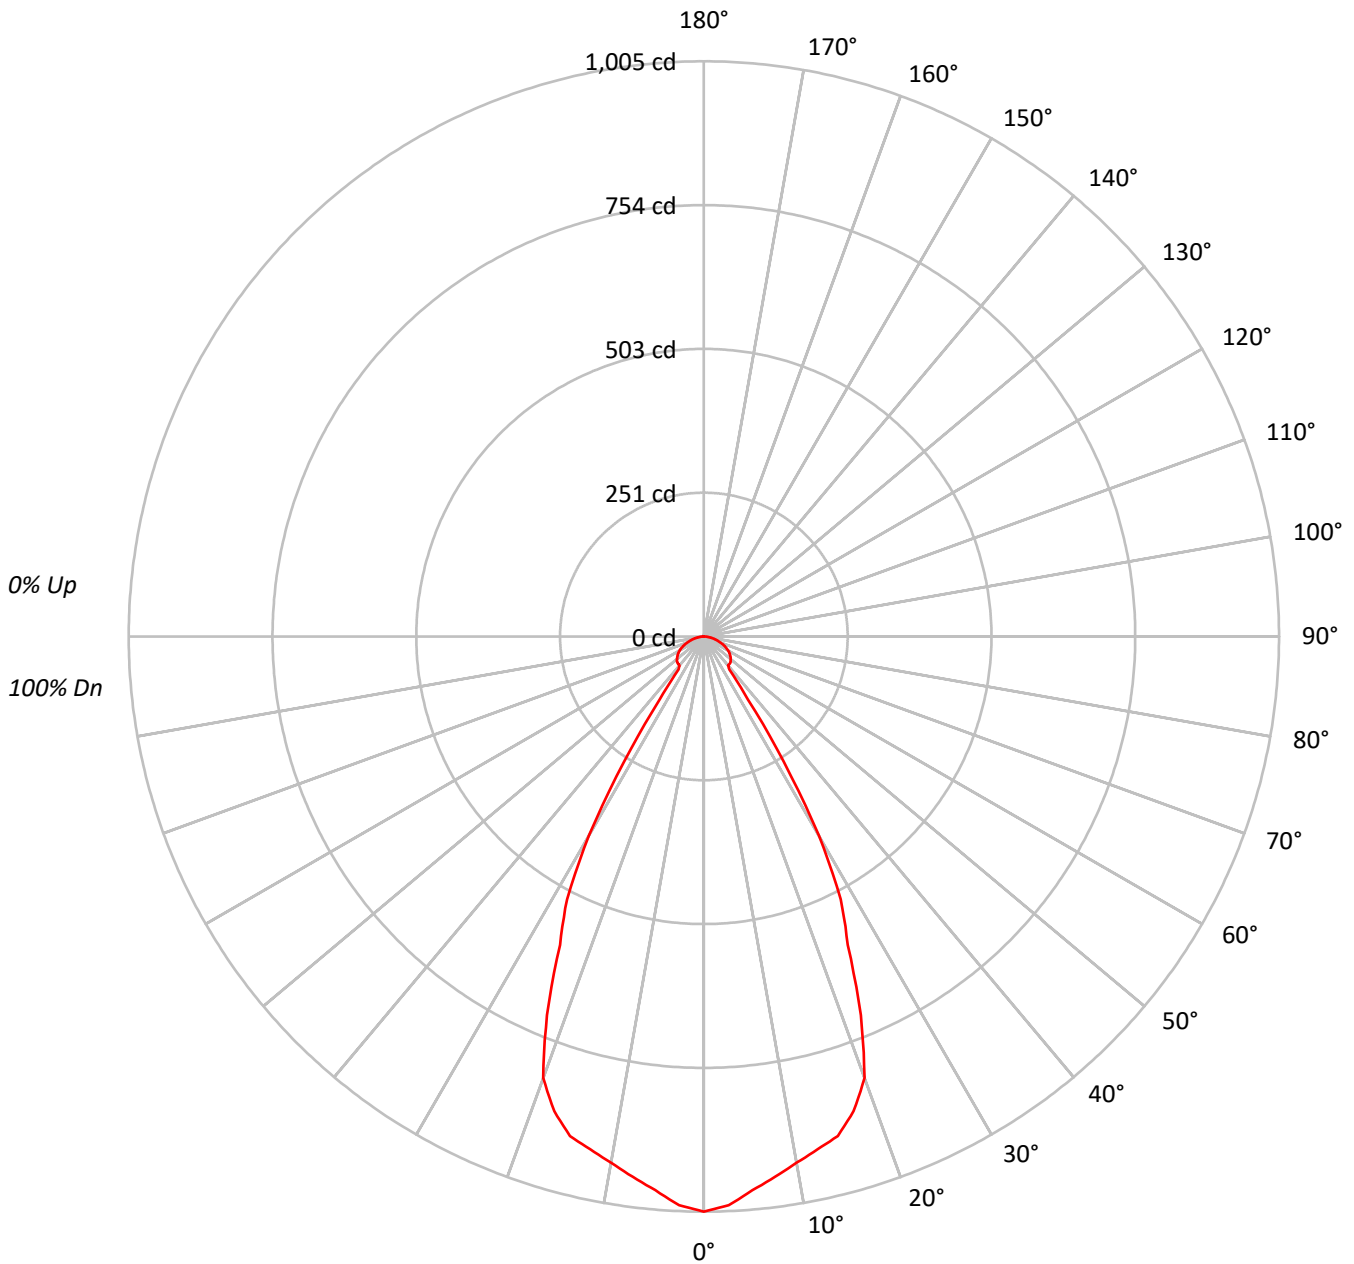



TEST NUMBER: P759828

CATALOG NUMBER: LD6D08D010-EU6DR700210IC9040-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91																			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83																			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76																			
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70																			
5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65																			
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61																			
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57																			
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53																			
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50																			
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	109807
5°	106541
10°	103579
15°	102222
20°	95448
25°	71707
30°	50692
35°	17953
40°	9442
45°	10059
50°	10403
55°	10610
60°	10686
65°	10445
70°	9871
75°	9161
80°	8117
85°	6644

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 60°
 Luminance: 10686 cd/sqm



TEST NUMBER: P759828

CATALOG NUMBER: LD6D08D010-EU6DR700210IC9040-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	91.6	10.2
10°-20°	251.3	28.1
20°-30°	276.8	31.0
30°-40°	105.8	11.8
40°-50°	49.9	5.6
50°-60°	49.7	5.6
60°-70°	39.7	4.4
70°-80°	22.9	2.6
80°-90°	6.2	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	619.8	69.3
0°-40°	725.5	81.2
0°-60°	825.1	92.3
0°-90°	894.0	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	894.0	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1005	
5°	971	92
15°	904	251
25°	595	277
35°	135	106
45°	65	50
55°	56	50
65°	40	40
75°	22	23
85°	5	6
90°	0	



TEST NUMBER: P759828

CATALOG NUMBER: LD6D08D010-EU6DR700210IC9040-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	1005.0
2.5°	994.5
5°	971.4
7.5°	952.2
10°	933.6
12.5°	917.8
15°	903.7
17.5°	869.5
20°	820.9
22.5°	716.2
25°	594.8
27.5°	517.8
30°	401.8
32.5°	259.5
35°	134.6
37.5°	72.7
40°	66.2
42.5°	65.7
45°	65.1
47.5°	63.7
50°	61.2
52.5°	58.6
55°	55.7
57.5°	52.5
60°	48.9
62.5°	44.7
65°	40.4
67.5°	35.6
70°	30.9
72.5°	26.1
75°	21.7
77.5°	17.0
80°	12.9
82.5°	9.1
85°	5.3
87.5°	2.1
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)