

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P759684

Luminaire Tested: LD6D08D010-EU6DR600210IC9050-6LBDP1H

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P759684
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-57)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D08D010-EU6DR600210IC9050-6LBDP1H
Description: 6 INCH ROUND DEEP 45° CUTOFF SEMI-SPECULAR CLEAR TRIM, WITH 60° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 835.8 lumens
Efficiency: N/A
Efficacy: 93.9 lumens/watt
Spacing Criteria (0/90/45): 0.91 / 0.91 / 0.84
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P759684

CATALOG NUMBER: LD6D08D010-EU6DR600210IC9050-6LBDP1H

Luminous Intensity Polar Plot

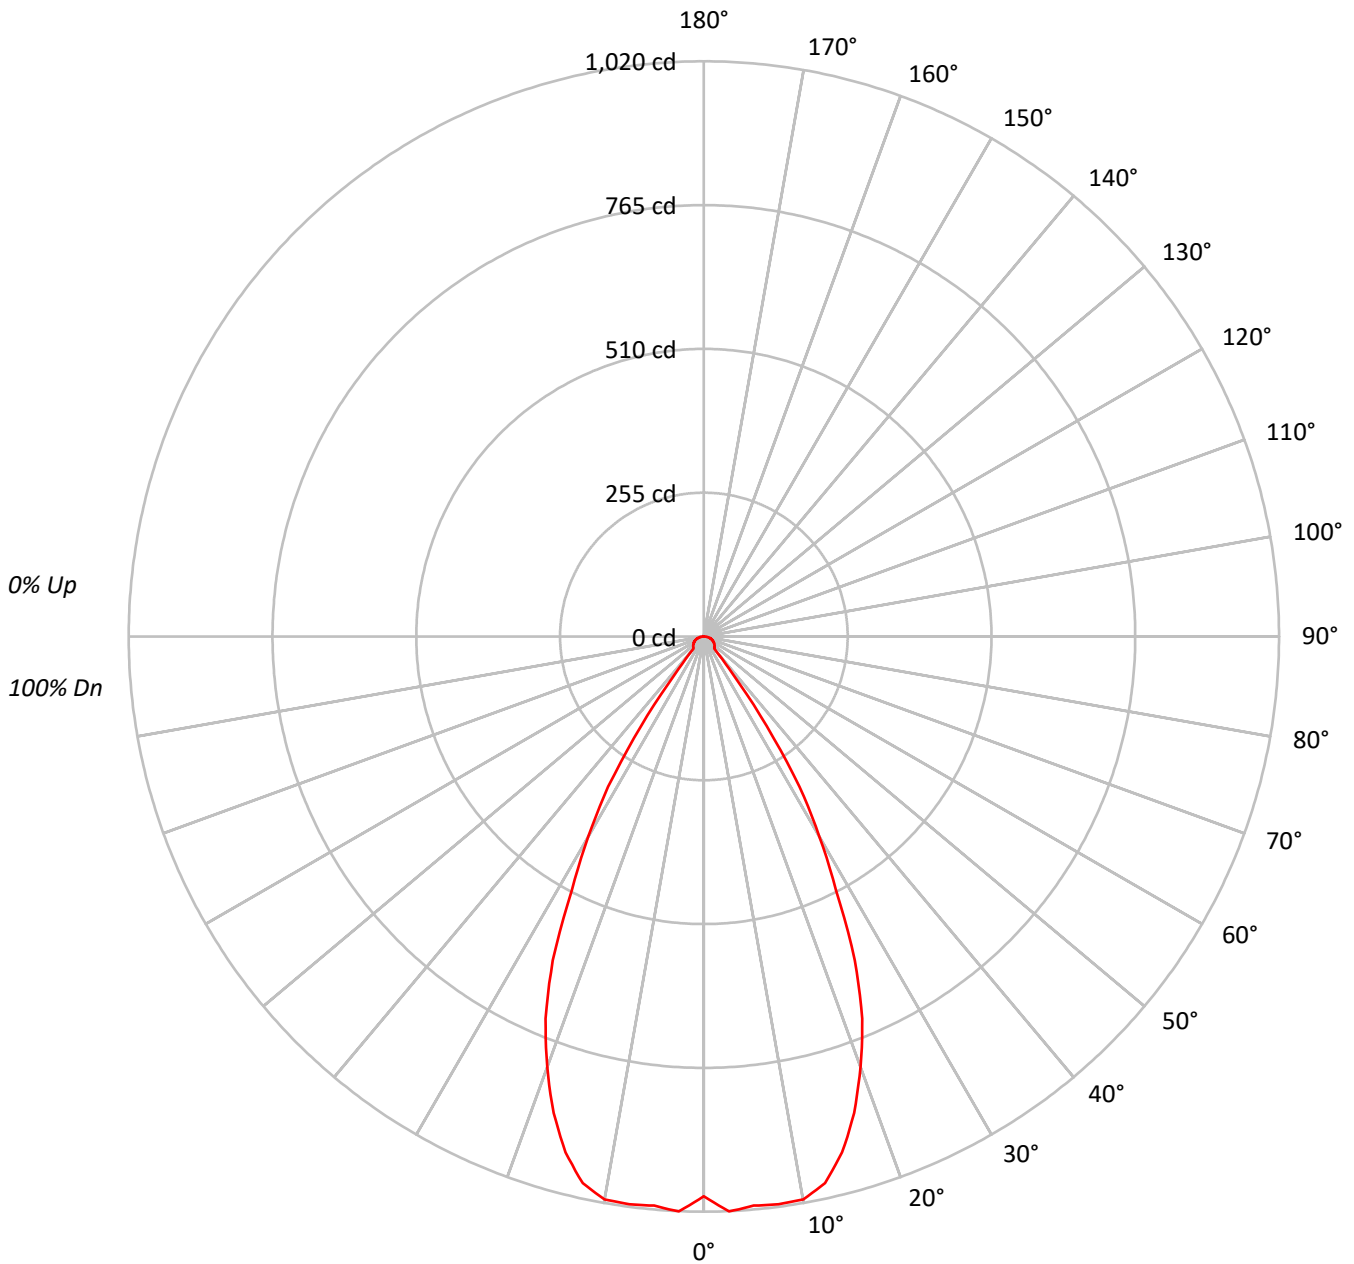



TEST NUMBER: P759684

CATALOG NUMBER: LD6D08D010-EU6DR600210IC9050-6LBDP1H

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	108	105	111	108	106	104	104	102	100	100	99	97	97	96	95	93	93	93	93
2	107	102	98	95	105	101	97	94	97	94	92	94	92	90	92	90	88	86	86	86	86
3	102	96	90	86	100	94	89	86	91	88	84	89	86	83	87	84	82	80	80	80	80
4	97	89	84	80	95	88	83	79	86	82	78	84	80	77	82	79	76	75	75	75	75
5	92	84	78	74	91	83	78	74	81	77	73	80	76	72	78	75	72	70	70	70	70
6	88	79	73	69	87	78	73	69	77	72	68	75	71	68	74	70	67	66	66	66	66
7	84	75	69	65	83	74	68	64	73	68	64	72	67	64	71	67	63	62	62	62	62
8	80	71	65	61	79	70	65	61	69	64	60	68	64	60	67	63	60	59	59	59	59
9	77	67	61	57	75	67	61	57	66	61	57	65	60	57	64	60	57	55	55	55	55
10	73	64	58	54	72	63	58	54	62	58	54	62	57	54	61	57	54	53	53	53	53

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	108452
5°	111126
10°	112466
15°	107143
20°	94460
25°	76408
30°	51689
35°	25903
40°	4193
45°	4110
50°	4198
55°	4248
60°	4370
65°	4473
70°	4568
75°	4644
80°	4467
85°	3761

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 75°
 Luminance: 4644 cd/sqm



TEST NUMBER: P759684

CATALOG NUMBER: LD6D08D010-EU6DR600210IC9050-6LBDP1H

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	96.8	11.6
10°-20°	262.0	31.3
20°-30°	281.9	33.7
30°-40°	122.6	14.7
40°-50°	20.6	2.5
50°-60°	20.0	2.4
60°-70°	17.1	2.0
70°-80°	11.5	1.4
80°-90°	3.4	0.4
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	640.7	76.7
0°-40°	763.3	91.3
0°-60°	803.8	96.2
0°-90°	835.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	835.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	993	
5°	1013	97
15°	947	262
25°	634	282
35°	194	123
45°	27	21
55°	22	20
65°	17	17
75°	11	11
85°	3	3
90°	0	



TEST NUMBER: P759684

CATALOG NUMBER: LD6D08D010-EU6DR600210IC9050-6LBDP1H

CANDELA DISTRIBUTION (FULL):

	0°
0°	992.6
2.5°	1020.5
5°	1013.2
7.5°	1015.5
10°	1013.7
12.5°	992.8
15°	947.2
17.5°	886.0
20°	812.4
22.5°	733.8
25°	633.8
27.5°	506.9
30°	409.7
32.5°	315.8
35°	194.2
37.5°	83.1
40°	29.4
42.5°	27.1
45°	26.6
47.5°	25.7
50°	24.7
52.5°	23.5
55°	22.3
57.5°	21.2
60°	20.0
62.5°	18.7
65°	17.3
67.5°	15.9
70°	14.3
72.5°	12.7
75°	11.0
77.5°	9.1
80°	7.1
82.5°	5.0
85°	3.0
87.5°	1.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)