

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P759765

Luminaire Tested: LD6D08D010-EU6DR650210IC9050-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P759765
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D08D010-EU6DR650210IC9050-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 713.7 lumens
Efficiency: N/A
Efficacy: 80.2 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P759765
CATALOG NUMBER: LD6D08D010-EU6DR650210IC9050-6LBS1B

Luminous Intensity Polar Plot

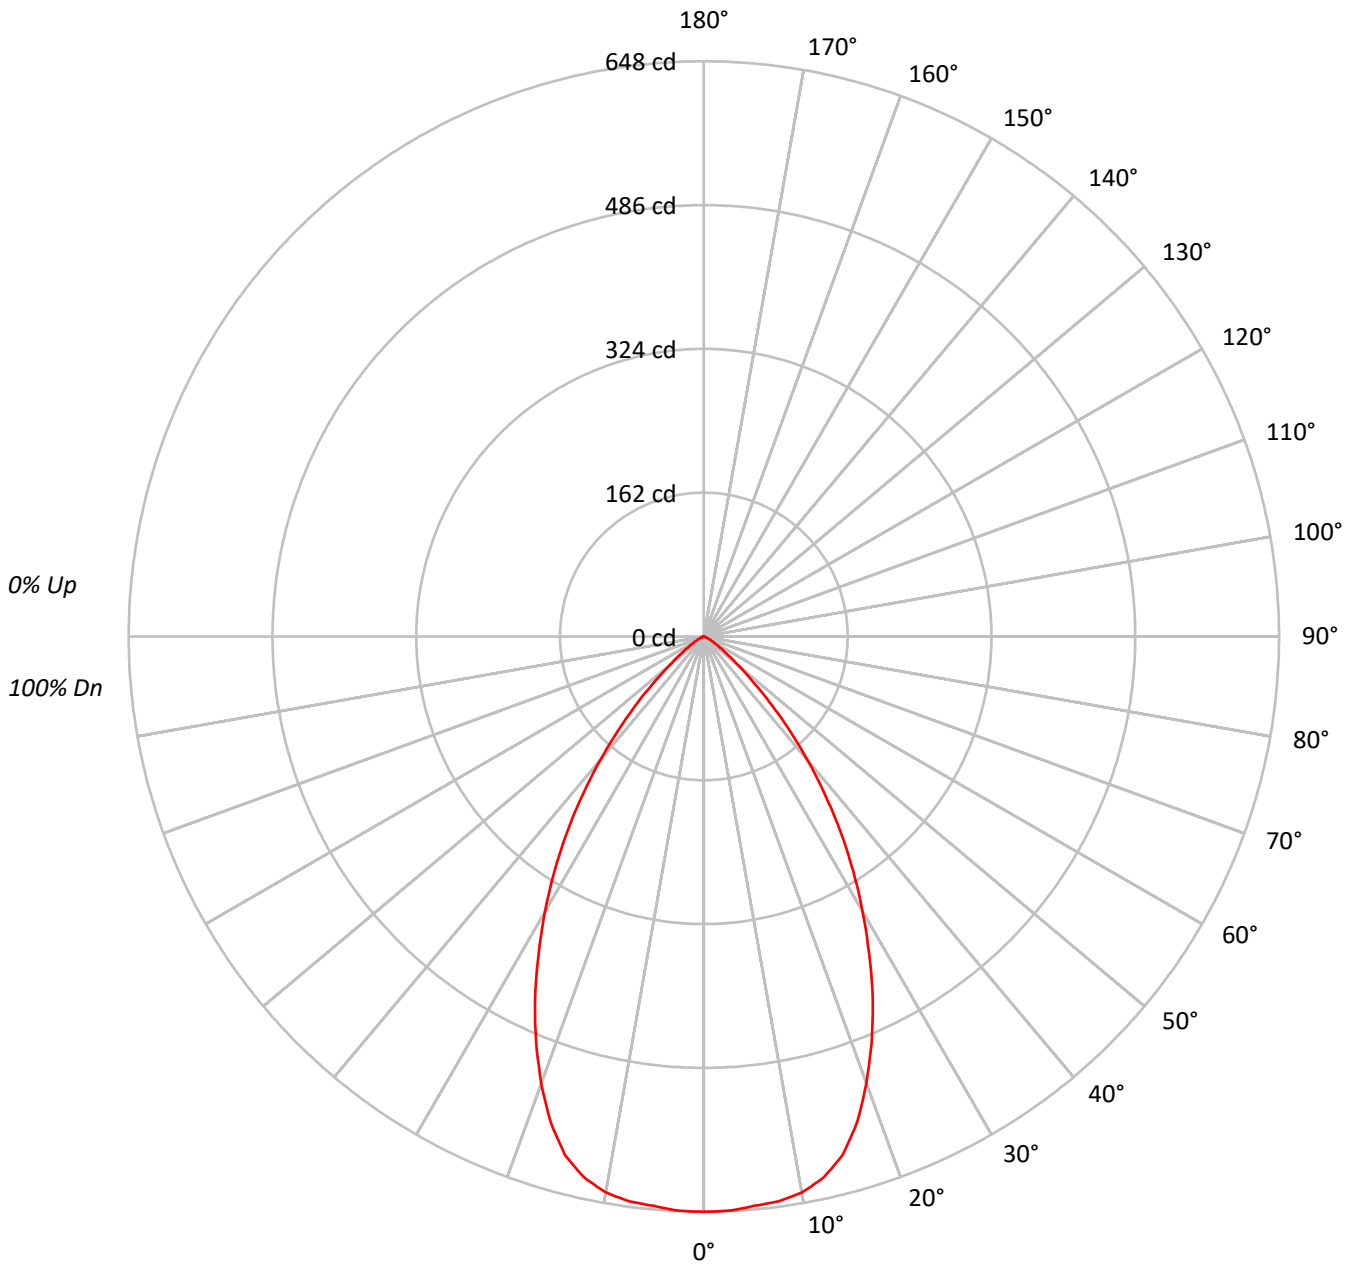



TEST NUMBER: P759765
 CATALOG NUMBER: LD6D08D010-EU6DR650210IC9050-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20					20					20					20					20	
RC	80					70					50					30					10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0	
RCR																						
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100	
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93			93	
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85			85	
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78			78	
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72			72	
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66			66	
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61			61	
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56			56	
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52			52	
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49			49	
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46			46	

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	37852
5°	37756
10°	37724
15°	36557
20°	33282
25°	29005
30°	24123
35°	19115
40°	13792
45°	8714
50°	4543
55°	2413
60°	1262
65°	691
70°	290
75°	316
80°	235
85°	201

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8714 cd/sqm



TEST NUMBER: P759765

CATALOG NUMBER: LD6D08D010-EU6DR650210IC9050-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	61.3	8.6
10°-20°	167.8	23.5
20°-30°	205.1	28.7
30°-40°	166.5	23.3
40°-50°	82.9	11.6
50°-60°	23.1	3.2
60°-70°	5.2	0.7
70°-80°	1.4	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	434.3	60.8
0°-40°	600.7	84.2
0°-60°	706.8	99.0
0°-90°	713.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	713.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	648	
5°	644	61
15°	605	168
25°	450	205
35°	268	166
45°	106	83
55°	24	23
65°	5	5
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P759765

CATALOG NUMBER: LD6D08D010-EU6DR650210IC9050-6LBS1B

CANDELA DISTRIBUTION (FULL):

0°	
0°	648.1
2.5°	647.6
5°	644.0
7.5°	641.9
10°	636.1
12.5°	624.3
15°	604.6
17.5°	574.0
20°	535.5
22.5°	494.0
25°	450.1
27.5°	403.1
30°	357.7
32.5°	312.8
35°	268.1
37.5°	223.5
40°	180.9
42.5°	141.1
45°	105.5
47.5°	73.5
50°	50.0
52.5°	34.5
55°	23.7
57.5°	16.0
60°	10.8
62.5°	7.5
65°	5.0
67.5°	2.6
70°	1.7
72.5°	1.6
75°	1.4
77.5°	1.0
80°	0.7
82.5°	0.5
85°	0.3
87.5°	0.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)