

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P759768

Luminaire Tested: LD6D08D010-EU6DR650210IC9050-6LBS1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P759768
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D08D010-EU6DR650210IC9050-6LBS1MW
Description: 6 INCH ROUND SHALLOW MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 5000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 730.6 lumens
Efficiency: N/A
Efficacy: 82.1 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct

Input Watts (W): 8.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P759768

CATALOG NUMBER: LD6D08D010-EU6DR650210IC9050-6LBS1MW

Luminous Intensity Polar Plot

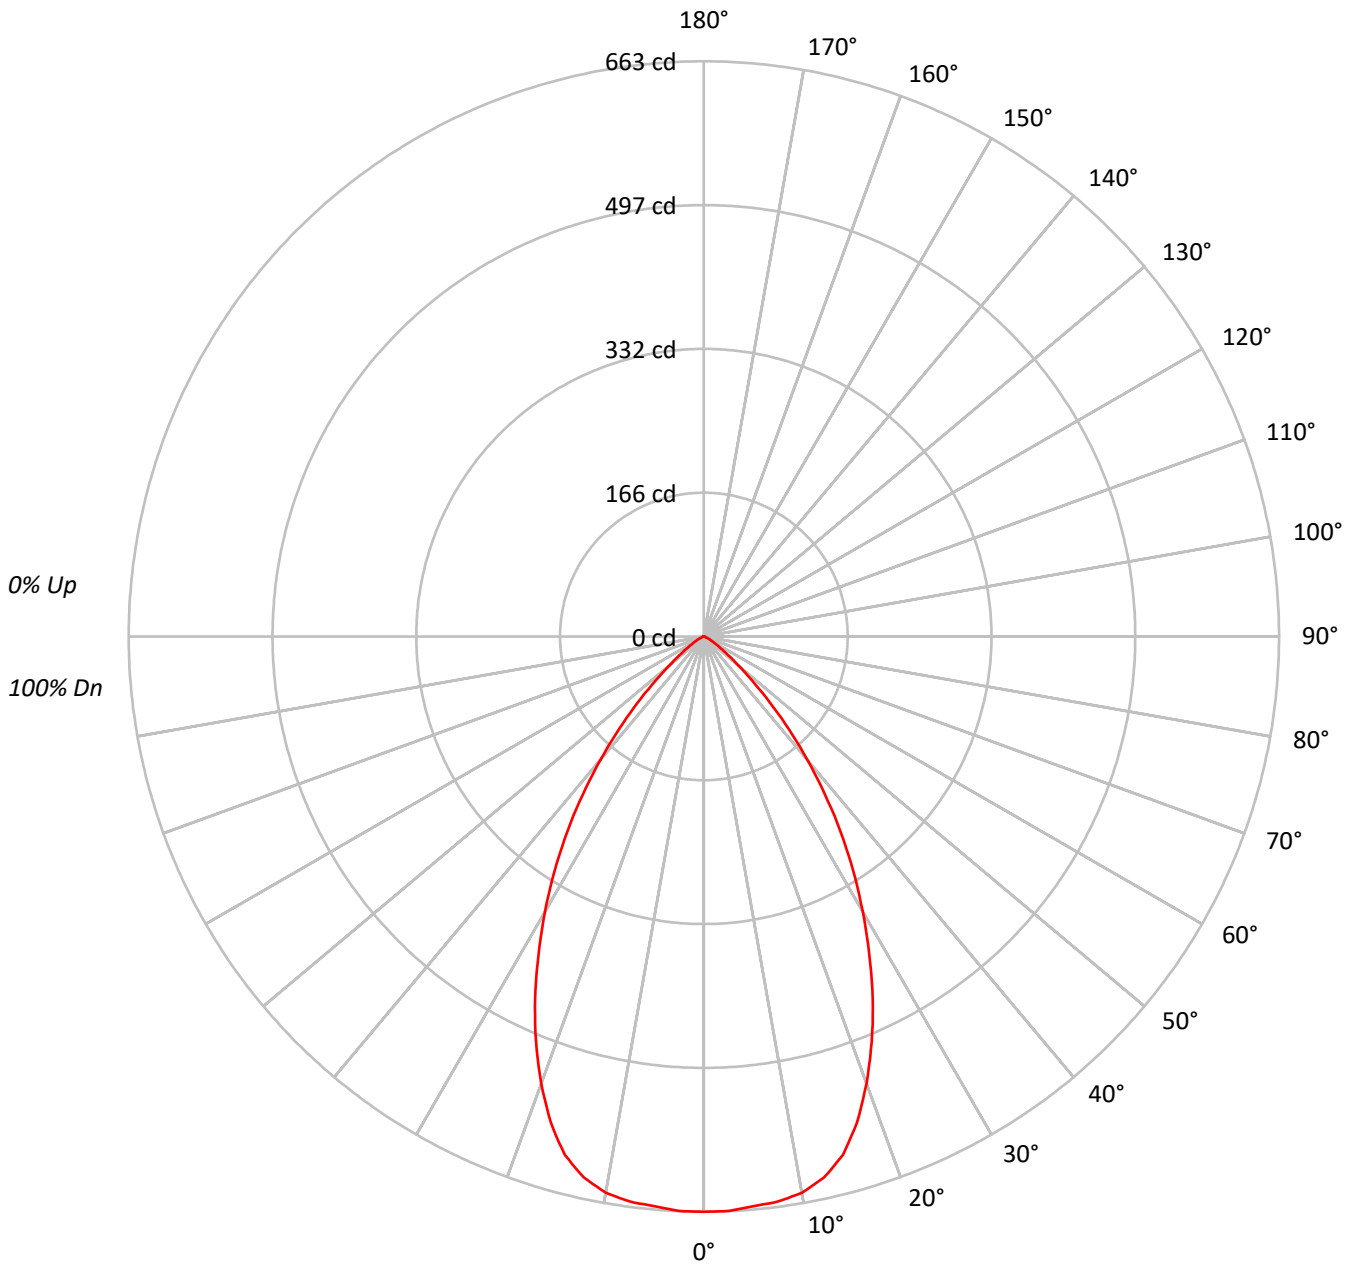



TEST NUMBER: P759768

CATALOG NUMBER: LD6D08D010-EU6DR650210IC9050-6LBS1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100	100	100	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93	93	93	93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85	85	85	85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78	78	78	78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72	72	72	72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	67	66	66	66	66
6	85	75	69	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61	61	61	61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56	56	56	56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52	52	52	52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49	49	49	49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46	46	46	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	38733
5°	38641
10°	38607
15°	37415
20°	34066
25°	29688
30°	24689
35°	19564
40°	14120
45°	8920
50°	4652
55°	2474
60°	1297
65°	719
70°	307
75°	338
80°	235
85°	201

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8920 cd/sqm



TEST NUMBER: P759768

CATALOG NUMBER: LD6D08D010-EU6DR650210IC9050-6LBS1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	62.7	8.6
10°-20°	171.8	23.5
20°-30°	210.0	28.7
30°-40°	170.4	23.3
40°-50°	84.9	11.6
50°-60°	23.7	3.2
60°-70°	5.4	0.7
70°-80°	1.4	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	444.5	60.8
0°-40°	614.8	84.2
0°-60°	723.4	99.0
0°-90°	730.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	730.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	663	
5°	659	63
15°	619	172
25°	461	210
35°	274	170
45°	108	85
55°	24	24
65°	5	5
75°	2	1
85°	0	0
90°	0	



TEST NUMBER: P759768

CATALOG NUMBER: LD6D08D010-EU6DR650210IC9050-6LBS1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	663.2
2.5°	662.8
5°	659.1
7.5°	656.9
10°	651.0
12.5°	638.9
15°	618.8
17.5°	587.4
20°	548.1
22.5°	505.6
25°	460.7
27.5°	412.6
30°	366.1
32.5°	320.2
35°	274.4
37.5°	228.7
40°	185.2
42.5°	144.4
45°	108.0
47.5°	75.2
50°	51.2
52.5°	35.3
55°	24.3
57.5°	16.4
60°	11.1
62.5°	7.7
65°	5.2
67.5°	2.6
70°	1.8
72.5°	1.7
75°	1.5
77.5°	1.0
80°	0.7
82.5°	0.5
85°	0.3
87.5°	0.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)