

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P771871

Luminaire Tested: LD6D80BD010-EU6DR3070959035-6LBDP1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P771871
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-16)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D80BD010-EU6DR3070959035-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 30° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 7678.9 lumens
Efficiency: N/A
Efficacy: 97.3 lumens/watt
Spacing Criteria (0/90/45): 0.52 / 0.52 / 0.49
Luminous Opening: Rectangular (W 0.38' x L: 0.38' x H: 0')
CIE Type: Direct


Input Watts (W): 78.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P771871
CATALOG NUMBER: LD6D80BD010-EU6DR3070959035-6LBDP1B

Luminous Intensity Polar Plot

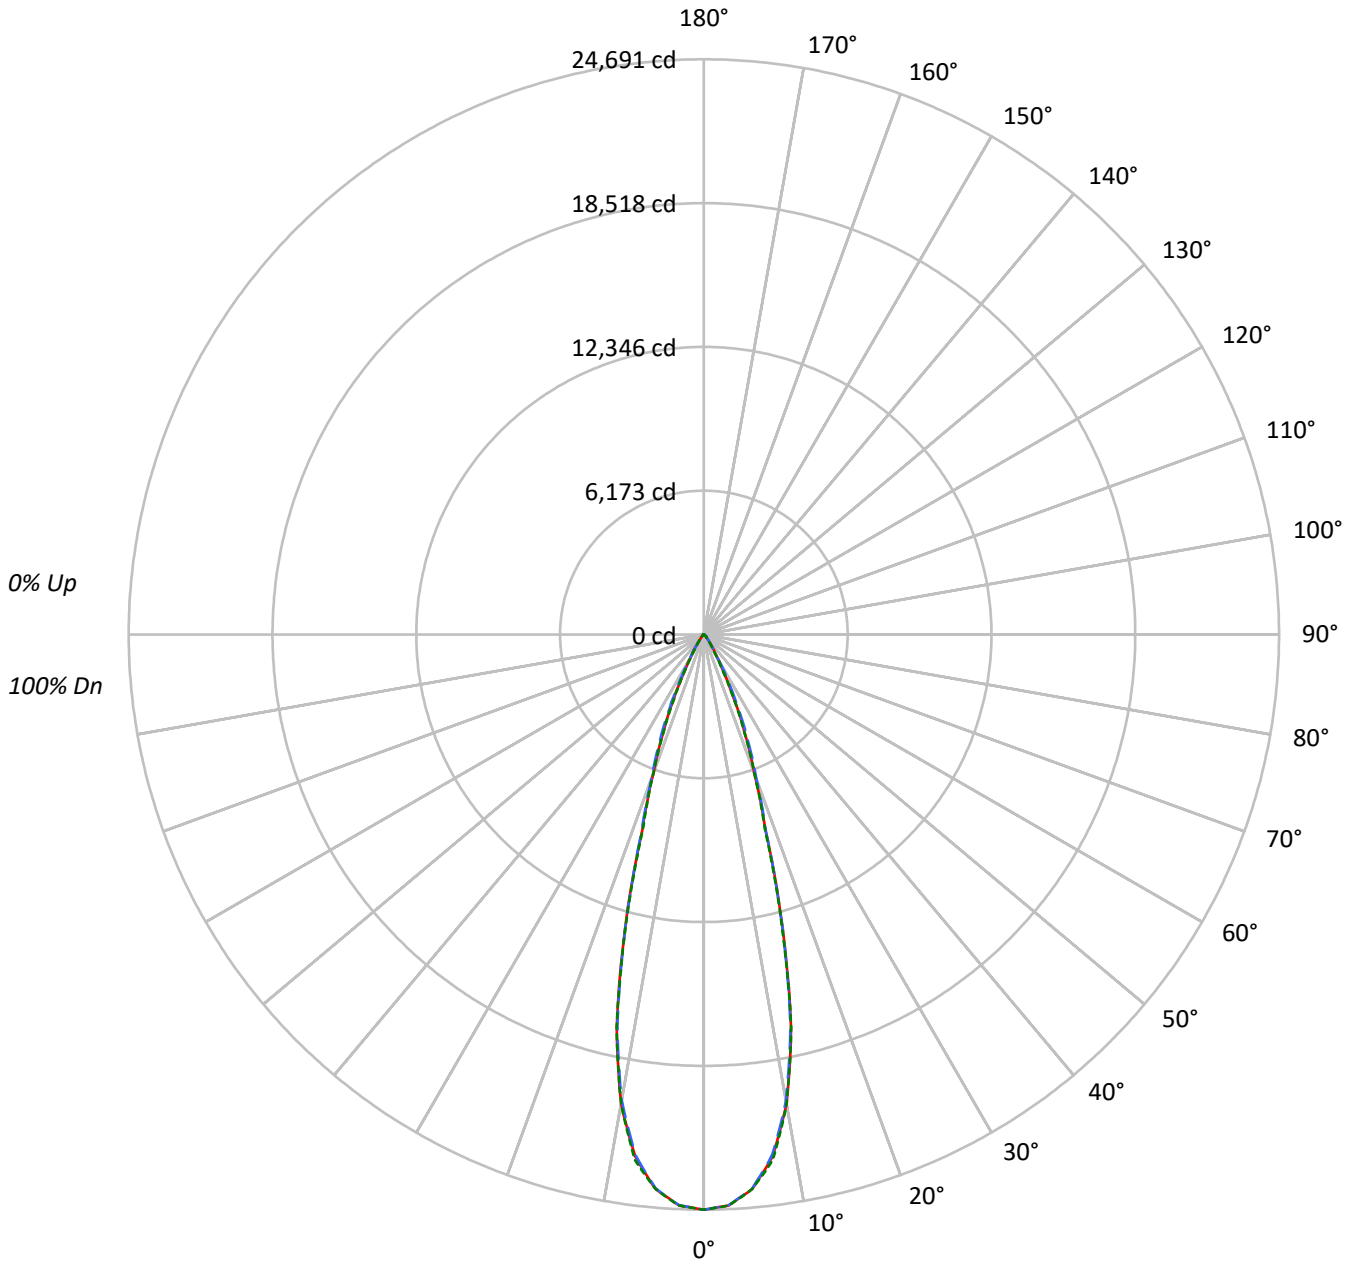



TEST NUMBER: P771871

CATALOG NUMBER: LD6D80BD010-EU6DR3070959035-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	115	113	111	109	112	110	109	107	106	105	104	103	102	101	99	99	98	96						96													
2	111	107	104	101	109	105	102	100	102	100	98	99	97	96	97	95	94	92						92													
3	107	102	98	95	105	101	97	94	98	95	93	96	93	91	94	92	90	89						89													
4	103	98	93	90	102	96	93	90	94	91	89	93	90	88	91	89	87	85						85													
5	100	94	89	86	98	93	89	86	91	88	85	90	86	84	88	86	83	82						82													
6	97	90	85	82	95	89	85	82	88	84	81	87	83	81	85	83	80	79						79													
7	94	87	82	79	92	86	82	79	85	81	78	84	81	78	83	80	78	77						77													
8	91	84	79	76	90	83	79	76	82	78	76	81	78	75	80	77	75	74						74													
9	88	81	76	73	87	80	76	73	80	76	73	79	75	73	78	75	73	72						72													
10	85	78	74	71	85	78	74	71	77	73	71	76	73	71	76	73	70	69						69													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1889964	1889964	1889964
5°	1835707	1833563	1835799
10°	1590004	1578788	1589623
15°	1037401	1031822	1026640
20°	515851	535205	515159
25°	259847	293021	254526
30°	104038	113362	90647
35°	48254	46217	38741
40°	20833	23132	19624
45°	14700	18240	14830
50°	5049	13277	5347
55°	2909	5498	3069
60°	2036	2419	2036
65°	1322	1322	1322
70°	806	537	806
75°	0	355	0
80°	0	0	0
85°	0	0	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 22.5°
 Vertical Angle: 45°
 Luminance: 18240 cd/sqm



TEST NUMBER: P771871

CATALOG NUMBER: LD6D80BD010-EU6DR3070959035-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2171.2	28.3
10°-20°	3496.8	45.5
20°-30°	1511.1	19.7
30°-40°	344.4	4.5
40°-50°	118.3	1.5
50°-60°	28.9	0.4
60°-70°	7.5	0.1
70°-80°	0.8	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	7179.1	93.5
0°-40°	7523.5	98.0
0°-60°	7670.6	99.9
0°-90°	7678.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	7678.9	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	24691	24691	24691	24691	24691	
5°	23891	23868	23863	23913	23892	2173
15°	13091	12934	13021	12978	12956	3505
25°	3077	3193	3470	3112	3014	1473
35°	516	527	495	491	415	350
45°	136	168	168	168	137	96
55°	22	23	41	24	23	21
65°	7	7	7	7	7	7
75°	0	0	1	0	0	1
85°	0	0	0	0	0	0
90°	0	0	0	0	0	0



TEST NUMBER: P771871

CATALOG NUMBER: LD6D80BD010-EU6DR3070959035-6LBDP1B

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	24691.4	24691.4	24691.4	24691.4	24691.4
2.5°	24527.8	24510.8	24520.5	24532.6	24537.5
5°	23891.3	23868.3	23863.4	23913.1	23892.5
7.5°	22607.5	22574.8	22525.1	22637.8	22743.3
10°	20457.0	20420.6	20312.7	20366.1	20452.1
12.5°	17282.1	17164.5	17162.0	17331.8	17308.7
15°	13091.3	12933.7	13020.9	12978.5	12955.5
17.5°	8803.5	8742.9	8859.2	8824.1	8672.5
20°	6332.9	6348.6	6570.5	6458.9	6324.4
22.5°	4621.2	4678.1	4941.2	4653.9	4548.4
25°	3076.7	3193.1	3469.5	3111.9	3013.7
27.5°	1892.3	1945.7	2225.7	1868.1	1814.8
30°	1177.1	1150.4	1282.6	1100.7	1025.6
32.5°	772.2	738.3	780.7	700.7	640.1
35°	516.4	527.3	494.6	491.0	414.6
37.5°	322.5	371.0	327.3	349.1	266.7
40°	208.5	269.1	231.5	255.8	196.4
42.5°	170.9	207.3	190.3	202.4	174.6
45°	135.8	168.5	168.5	168.5	137.0
47.5°	75.2	112.7	144.3	115.2	80.0
50°	42.4	57.0	111.5	59.4	44.9
52.5°	29.1	32.7	76.4	33.9	30.3
55°	21.8	23.0	41.2	24.2	23.0
57.5°	17.0	18.2	21.8	18.2	17.0
60°	13.3	13.3	15.8	14.5	13.3
62.5°	9.7	9.7	10.9	9.7	9.7
65°	7.3	7.3	7.3	7.3	7.3
67.5°	3.6	4.8	4.8	4.8	4.8
70°	3.6	2.4	2.4	2.4	3.6
72.5°	2.4	1.2	1.2	1.2	1.2
75°	0.0	0.0	1.2	0.0	0.0
77.5°	0.0	0.0	0.0	0.0	0.0
80°	0.0	0.0	0.0	0.0	0.0
82.5°	0.0	0.0	0.0	0.0	0.0
85°	0.0	0.0	0.0	0.0	0.0
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)