

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P772042

Luminaire Tested: LD6D80BD010-EU6DR4070959040-6LBDP1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P772042
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-28)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D80BD010-EU6DR4070959040-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 40° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 11206.6 lumens
Efficiency: N/A
Efficacy: 142.0 lumens/watt
Spacing Criteria (0/90/45): 0.68 / 0.68 / 0.6
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 78.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight

TEST NUMBER: P772042

CATALOG NUMBER: LD6D80BD010-EU6DR4070959040-6LBDP1LI

Luminous Intensity Polar Plot

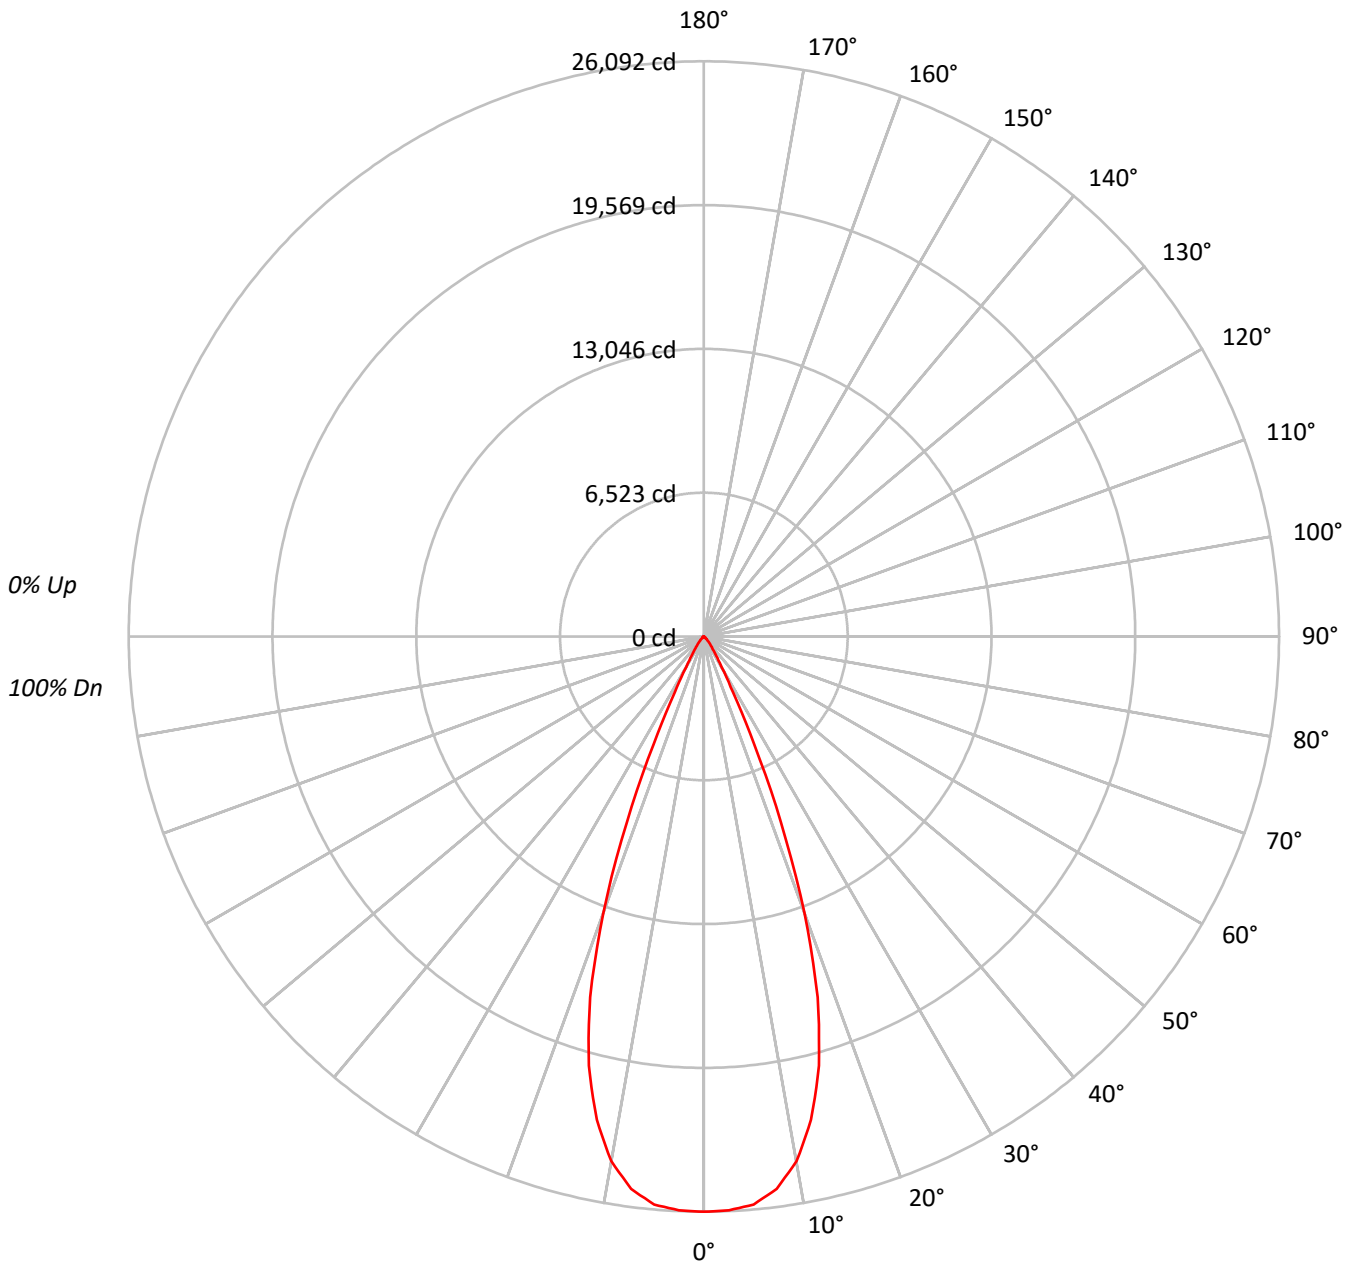



TEST NUMBER: P772042

CATALOG NUMBER: LD6D80BD010-EU6DR4070959040-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			100																
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	97	96			96																
2	110	106	103	100	108	105	102	99	102	99	97	99	97	95	96	95	93	92			92																
3	106	101	97	94	104	100	96	93	97	94	92	95	93	90	93	91	89	88			88																
4	102	97	92	89	101	95	91	88	93	90	87	92	89	86	90	87	85	84			84																
5	99	92	88	84	97	91	87	84	90	86	83	88	85	83	87	84	82	81			81																
6	95	88	84	80	94	88	83	80	86	82	80	85	82	79	84	81	79	77			77																
7	92	85	80	77	91	84	80	77	83	79	76	82	79	76	81	78	76	74			74																
8	89	82	77	74	88	81	77	74	80	76	73	79	76	73	78	75	73	72			72																
9	86	79	74	71	85	78	74	71	77	73	71	76	73	70	76	72	70	69			69																
10	83	76	71	68	82	75	71	68	75	71	68	74	70	68	73	70	68	67			67																

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2850821
5°	2836967
10°	2681560
15°	2279664
20°	1553754
25°	648289
30°	203842
35°	94742
40°	52388
45°	24028
50°	11661
55°	6381
60°	3322
65°	1189
70°	479
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 24028 cd/sqm



TEST NUMBER: P772042

CATALOG NUMBER: LD6D80BD010-EU6DR4070959040-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2415.3	21.6
10°-20°	5410.8	48.3
20°-30°	2708.5	24.2
30°-40°	496.5	4.4
40°-50°	137.0	1.2
50°-60°	32.2	0.3
60°-70°	6.1	0.1
70°-80°	0.2	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	10534.6	94.0
0°-40°	11031.1	98.4
0°-60°	11200.2	99.9
0°-90°	11206.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	11206.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	26092	
5°	25866	###
15°	20154	5411
25°	5378	2708
35°	710	496
45°	156	137
55°	34	32
65°	5	6
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P772042

CATALOG NUMBER: LD6D80BD010-EU6DR4070959040-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

0°	
0°	26091.9
2.5°	26053.8
5°	25866.3
7.5°	25268.8
10°	24169.9
12.5°	22456.6
15°	20153.5
17.5°	17158.4
20°	13363.0
22.5°	9110.4
25°	5377.5
27.5°	2842.7
30°	1615.7
32.5°	1044.1
35°	710.3
37.5°	507.6
40°	367.3
42.5°	251.5
45°	155.5
47.5°	99.1
50°	68.6
52.5°	48.8
55°	33.5
57.5°	21.3
60°	15.2
62.5°	9.1
65°	4.6
67.5°	3.0
70°	1.5
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)