

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P773190

Luminaire Tested: LD6D85BD010-EU6DR6570959030-6LBS1LI

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P773190
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D85BD010-EU6DR6570959030-6LBS1LI
Description: 6 INCH ROUND SHALLOW SPECULAR CLEAR TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9965.2 lumens
Efficiency: N/A
Efficacy: 113.6 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct


Input Watts (W): 87.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P773190
CATALOG NUMBER: LD6D85BD010-EU6DR6570959030-6LBS1LI

Luminous Intensity Polar Plot

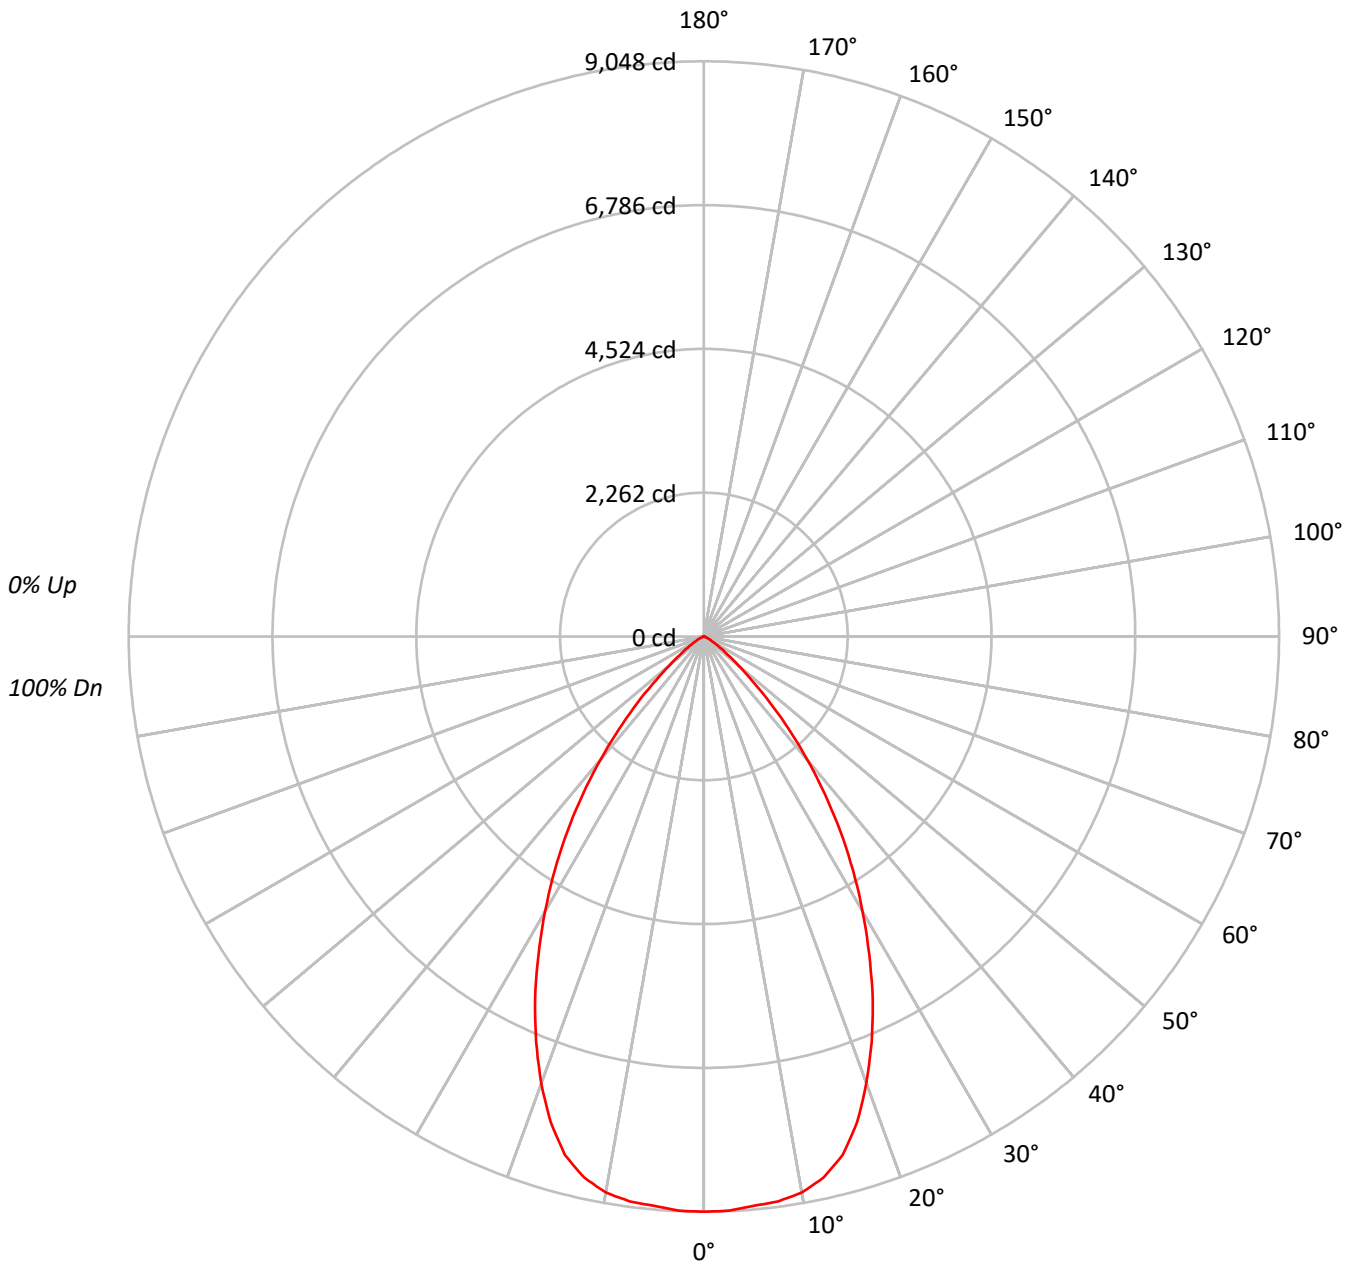



TEST NUMBER: P773190

CATALOG NUMBER: LD6D85BD010-EU6DR6570959030-6LBS1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20	
RC	80				70				50				30				10	0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																		
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	528444
5°	527109
10°	526663
15°	510426
20°	464680
25°	404938
30°	336797
35°	266861
40°	192607
45°	121680
50°	63430
55°	33714
60°	17708
65°	9743
70°	4081
75°	4491
80°	3128
85°	2680

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 121680 cd/sqm



TEST NUMBER: P773190

CATALOG NUMBER: LD6D85BD010-EU6DR6570959030-6LBS1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	855.7	8.6
10°-20°	2343.1	23.5
20°-30°	2864.1	28.7
30°-40°	2323.9	23.3
40°-50°	1158.0	11.6
50°-60°	323.0	3.2
60°-70°	73.4	0.7
70°-80°	19.1	0.2
80°-90°	4.9	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6062.9	60.8
0°-40°	8386.8	84.2
0°-60°	9867.8	99.0
0°-90°	9965.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9965.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	9048	
5°	8991	856
15°	8442	2343
25°	6284	2864
35°	3743	2324
45°	1473	1158
55°	331	323
65°	70	73
75°	20	19
85°	4	5
90°	0	



TEST NUMBER: P773190

CATALOG NUMBER: LD6D85BD010-EU6DR6570959030-6LBS1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	9048.1
2.5°	9041.4
5°	8990.9
7.5°	8961.7
10°	8880.6
12.5°	8715.7
15°	8441.8
17.5°	8013.6
20°	7476.5
22.5°	6896.8
25°	6283.8
27.5°	5628.3
30°	4994.1
32.5°	4367.8
35°	3742.9
37.5°	3119.3
40°	2526.3
42.5°	1970.5
45°	1473.2
47.5°	1026.5
50°	698.1
52.5°	481.3
55°	331.1
57.5°	223.4
60°	151.6
62.5°	105.0
65°	70.5
67.5°	35.9
70°	23.9
72.5°	22.6
75°	19.9
77.5°	13.3
80°	9.3
82.5°	6.6
85°	4.0
87.5°	2.7
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)