

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P773201

Luminaire Tested: LD6D85BD010-EU6DR6570959035-6LBS1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P773201
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-147)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D85BD010-EU6DR6570959035-6LBS1B
Description: 6 INCH ROUND SHALLOW SPECULAR BLACK TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 8904.5 lumens
Efficiency: N/A
Efficacy: 101.5 lumens/watt
Spacing Criteria (0/90/45): 0.95 / 0.95 / 0.96
Luminous Opening: Circular (Dia: 0.48' x H: 0')
CIE Type: Direct


Input Watts (W): 87.7
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P773201
CATALOG NUMBER: LD6D85BD010-EU6DR6570959035-6LBS1B

Luminous Intensity Polar Plot

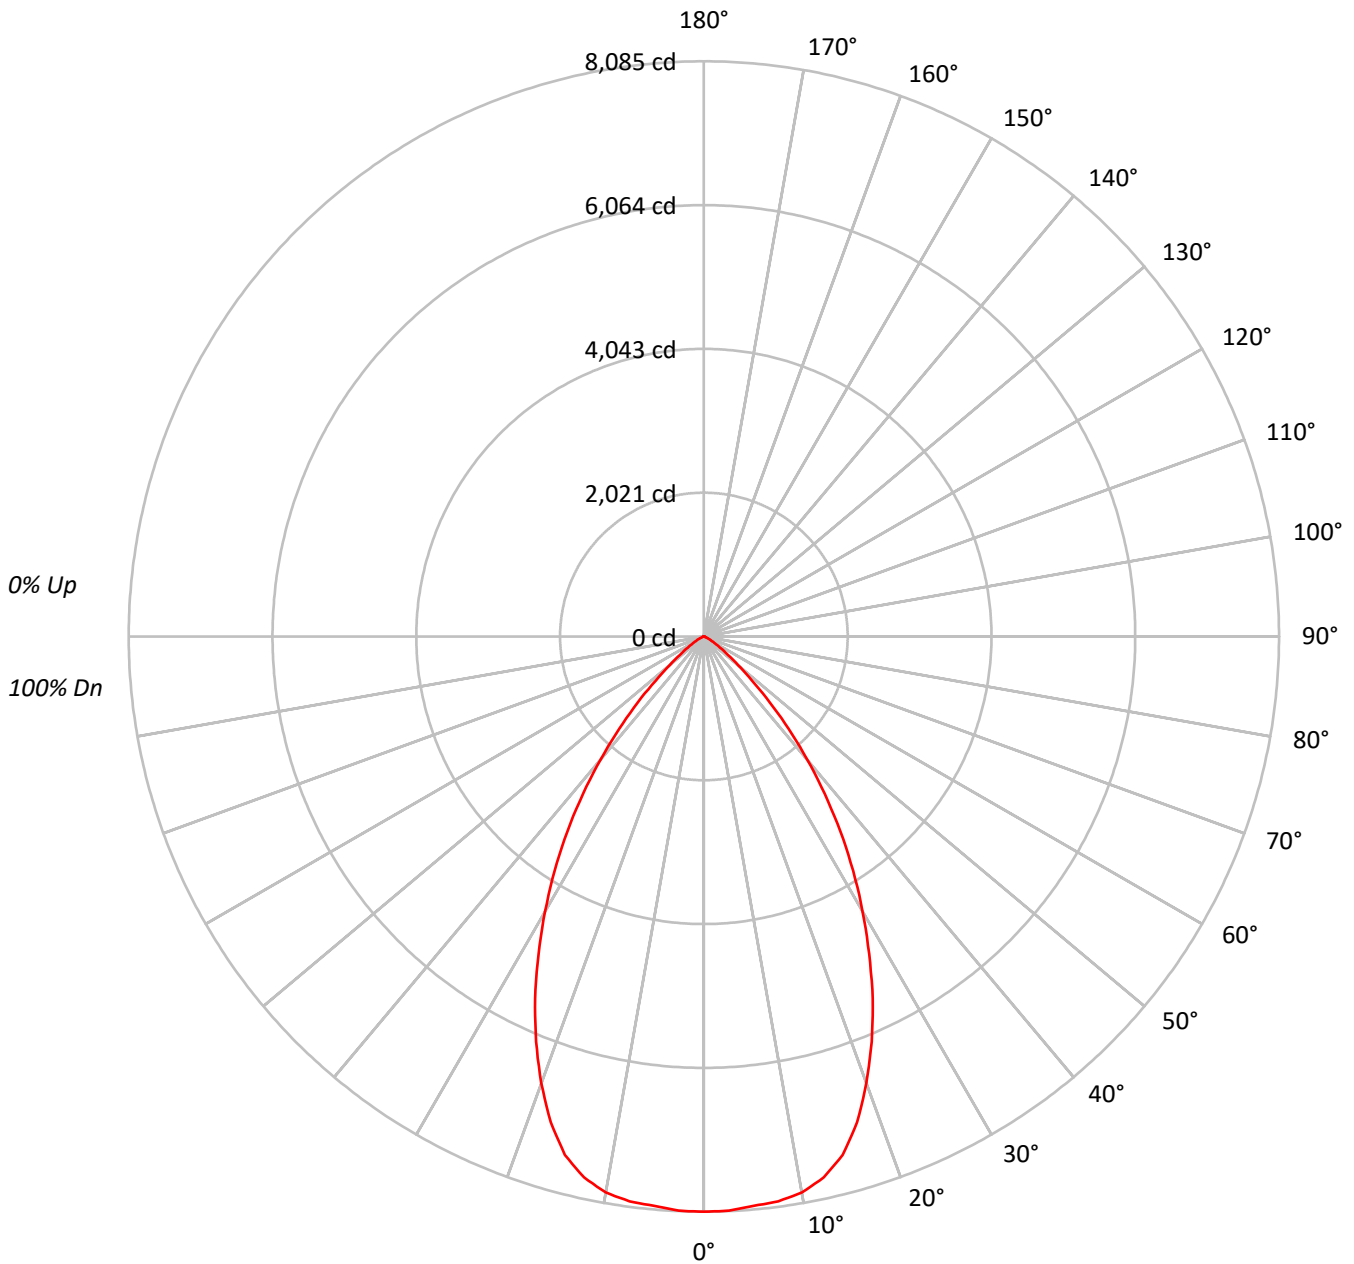



TEST NUMBER: P773201

CATALOG NUMBER: LD6D85BD010-EU6DR6570959035-6LBS1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	113	110	107	105	111	108	105	103	104	102	100	100	99	97	97	95	94	93				93															
2	107	102	97	94	105	100	96	92	97	93	90	94	91	88	91	89	87	85				85															
3	101	94	88	84	99	92	87	83	90	86	82	87	84	81	85	82	80	78				78															
4	95	87	81	76	93	86	80	76	84	79	75	82	77	74	80	76	73	72				72															
5	90	81	74	70	88	80	74	69	78	73	69	76	72	68	75	71	68	66				66															
6	85	75	69	64	83	74	68	64	73	67	63	71	67	63	70	66	62	61				61															
7	80	70	64	59	79	69	63	59	68	63	59	67	62	58	66	61	58	56				56															
8	76	66	59	55	75	65	59	55	64	58	54	63	58	54	62	57	54	52				52															
9	72	61	55	51	71	61	55	51	60	54	51	59	54	50	58	54	50	49				49															
10	68	58	52	47	67	57	51	47	57	51	47	56	51	47	55	50	47	46				46															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	472201
5°	471009
10°	470608
15°	456099
20°	415220
25°	361839
30°	300946
35°	238456
40°	172106
45°	108729
50°	56679
55°	30120
60°	15816
65°	8706
70°	3654
75°	4017
80°	2792
85°	2412

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 108729 cd/sqm



TEST NUMBER: P773201

CATALOG NUMBER: LD6D85BD010-EU6DR6570959035-6LBS1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	764.6	8.6
10°-20°	2093.7	23.5
20°-30°	2559.3	28.7
30°-40°	2076.5	23.3
40°-50°	1034.8	11.6
50°-60°	288.6	3.2
60°-70°	65.6	0.7
70°-80°	17.1	0.2
80°-90°	4.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	5417.6	60.8
0°-40°	7494.1	84.2
0°-60°	8817.5	99.0
0°-90°	8904.5	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	8904.5	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	8085	
5°	8034	765
15°	7543	2094
25°	5615	2559
35°	3344	2077
45°	1316	1035
55°	296	289
65°	63	66
75°	18	17
85°	4	4
90°	0	



TEST NUMBER: P773201

CATALOG NUMBER: LD6D85BD010-EU6DR6570959035-6LBS1B

CANDELA DISTRIBUTION (FULL):

	0°
0°	8085.1
2.5°	8079.1
5°	8034.0
7.5°	8007.8
10°	7935.4
12.5°	7788.0
15°	7543.3
17.5°	7160.7
20°	6680.7
22.5°	6162.7
25°	5615.0
27.5°	5029.2
30°	4462.5
32.5°	3902.9
35°	3344.5
37.5°	2787.3
40°	2257.4
42.5°	1760.8
45°	1316.4
47.5°	917.2
50°	623.8
52.5°	430.1
55°	295.8
57.5°	199.6
60°	135.4
62.5°	93.9
65°	63.0
67.5°	32.1
70°	21.4
72.5°	20.2
75°	17.8
77.5°	11.9
80°	8.3
82.5°	5.9
85°	3.6
87.5°	2.4
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)