

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P774018

Luminaire Tested: LD6D90BD010-EU6DR7070959024-6LBDP1LI

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P774018
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-73)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D90BD010-EU6DR7070959024-6LBDP1LI
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR CLEAR TRIM, WITH 70° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9913.6 lumens
Efficiency: N/A
Efficacy: 100.2 lumens/watt
Spacing Criteria (0/90/45): 0.88 / 0.88 / 0.82
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 98.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P774018
CATALOG NUMBER: LD6D90BD010-EU6DR7070959024-6LBDP1LI

Luminous Intensity Polar Plot

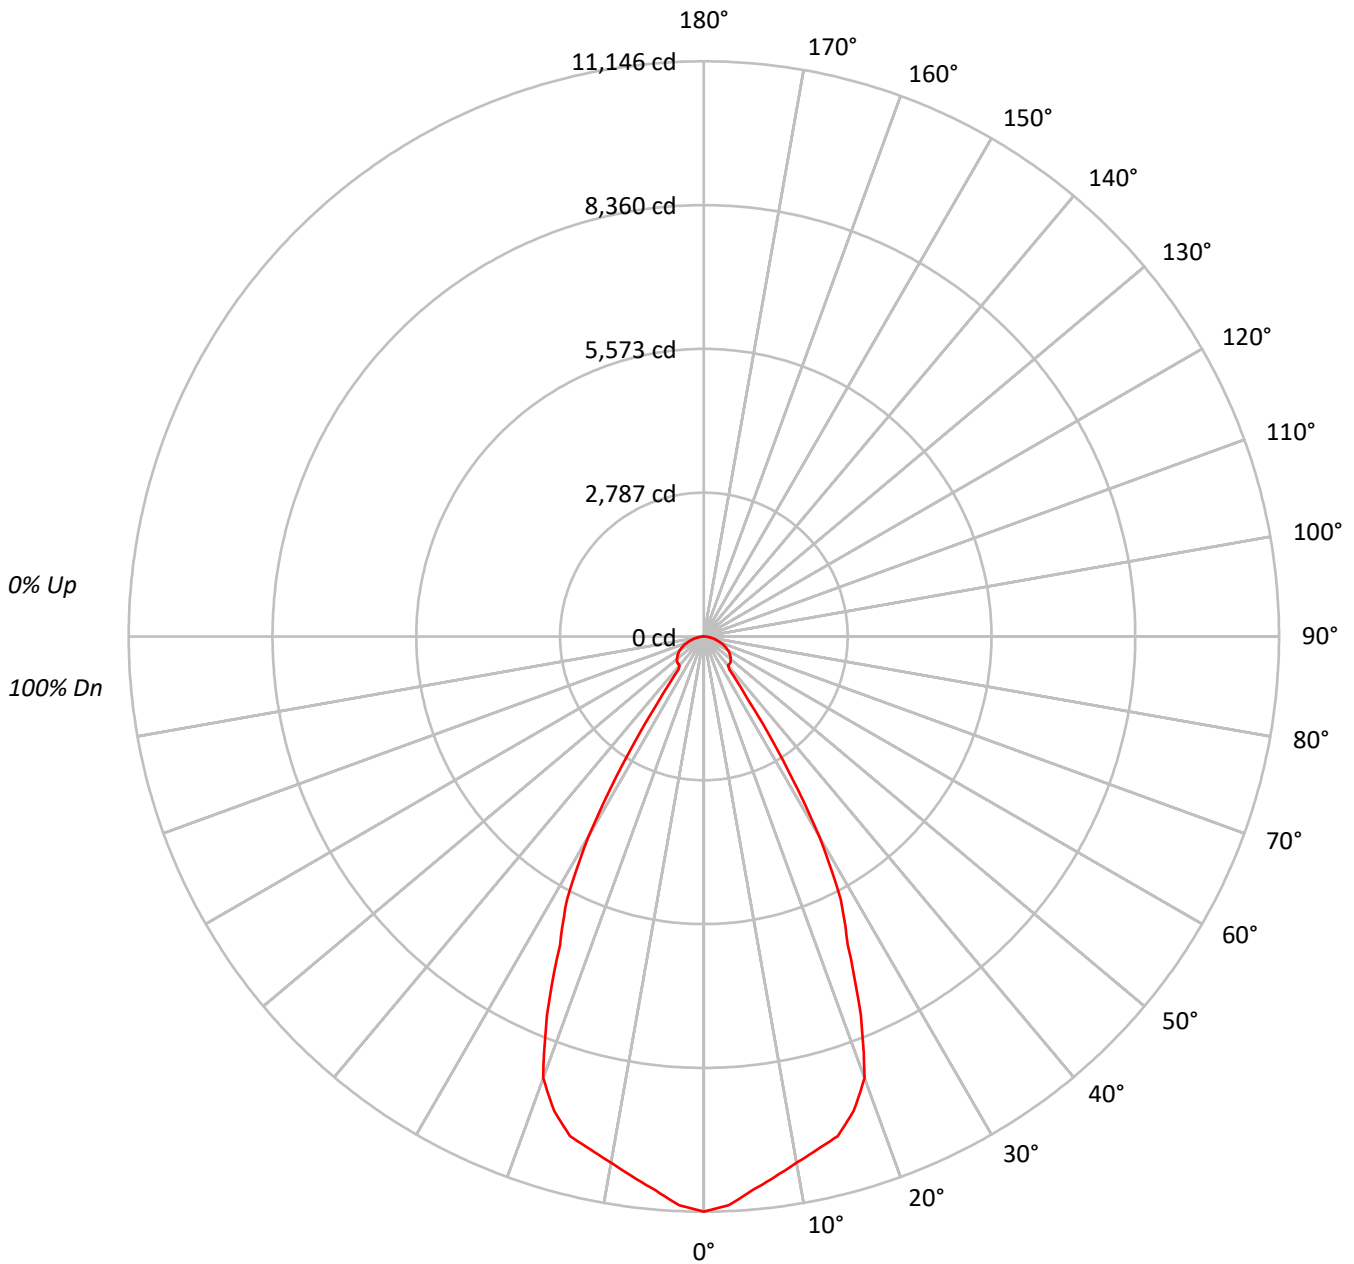



TEST NUMBER: P774018
 CATALOG NUMBER: LD6D90BD010-EU6DR7070959024-6LBDP1LI

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100																			
1	112	109	106	103	110	107	104	102	103	101	99	99	97	96	95	94	93	91																			
2	106	100	95	91	103	98	94	90	95	91	88	92	89	86	89	87	85	83																			
3	100	92	87	82	98	91	86	81	88	84	80	86	82	79	83	80	78	76																			
4	94	86	80	75	92	85	79	74	82	77	73	80	76	73	78	75	72	70																			
5	89	80	74	69	87	79	73	69	77	72	68	75	71	67	74	70	67	65																			
6	85	75	68	64	83	74	68	64	73	67	63	71	66	63	70	66	62	61																			
7	80	70	64	59	79	70	64	59	68	63	59	67	62	59	66	62	58	57																			
8	77	66	60	56	75	66	60	56	65	59	55	64	59	55	63	58	55	53																			
9	73	63	57	52	72	62	56	52	61	56	52	60	55	52	60	55	52	50																			
10	70	59	53	49	69	59	53	49	58	53	49	57	52	49	57	52	49	48																			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	1217799
5°	1181606
10°	1148671
15°	1133605
20°	1058548
25°	795235
30°	562159
35°	199127
40°	104705
45°	111531
50°	115484
55°	117647
60°	118395
65°	115874
70°	109350
75°	101316
80°	89914
85°	72961

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 57.5°
 Luminance: 118412 cd/sqm



TEST NUMBER: P774018

CATALOG NUMBER: LD6D90BD010-EU6DR7070959024-6LBDP1LI

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	1016.2	10.3
10°-20°	2787.3	28.1
20°-30°	3069.8	31.0
30°-40°	1172.9	11.8
40°-50°	553.8	5.6
50°-60°	550.6	5.6
60°-70°	440.8	4.4
70°-80°	253.3	2.6
80°-90°	68.9	0.7
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	6873.3	69.3
0°-40°	8046.2	81.2
0°-60°	9150.6	92.3
0°-90°	9913.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9913.6	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	11146	
5°	10773	###
15°	10022	2787
25°	6596	3070
35°	1493	1173
45°	722	554
55°	618	551
65°	448	441
75°	240	253
85°	58	69
90°	0	



TEST NUMBER: P774018

CATALOG NUMBER: LD6D90BD010-EU6DR7070959024-6LBDP1LI

CANDELA DISTRIBUTION (FULL):

	0°
0°	11145.8
2.5°	11029.3
5°	10773.4
7.5°	10559.9
10°	10353.4
12.5°	10178.7
15°	10021.7
17.5°	9642.3
20°	9104.0
22.5°	7942.9
25°	6596.4
27.5°	5742.3
30°	4455.8
32.5°	2878.2
35°	1492.9
37.5°	806.5
40°	734.1
42.5°	728.8
45°	721.8
47.5°	705.9
50°	679.4
52.5°	649.4
55°	617.6
57.5°	582.3
60°	541.8
62.5°	495.9
65°	448.2
67.5°	395.3
70°	342.3
72.5°	289.4
75°	240.0
77.5°	188.8
80°	142.9
82.5°	100.6
85°	58.2
87.5°	22.9
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)