

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P773522

Luminaire Tested: LD6D90BD010-EU6DR3570959040-6LBDP1B

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P773522
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D90BD010-EU6DR3570959040-6LBDP1B
Description: 6 INCH ROUND DEEP 45° CUTOFF SPECULAR BLACK TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 4000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 9546.2 lumens
Efficiency: N/A
Efficacy: 96.5 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct


Input Watts (W): 98.9
Input Voltage (V): NR
Input Current (A_{in}): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT



Downlight

TEST NUMBER: P773522
CATALOG NUMBER: LD6D90BD010-EU6DR3570959040-6LBDP1B

Luminous Intensity Polar Plot

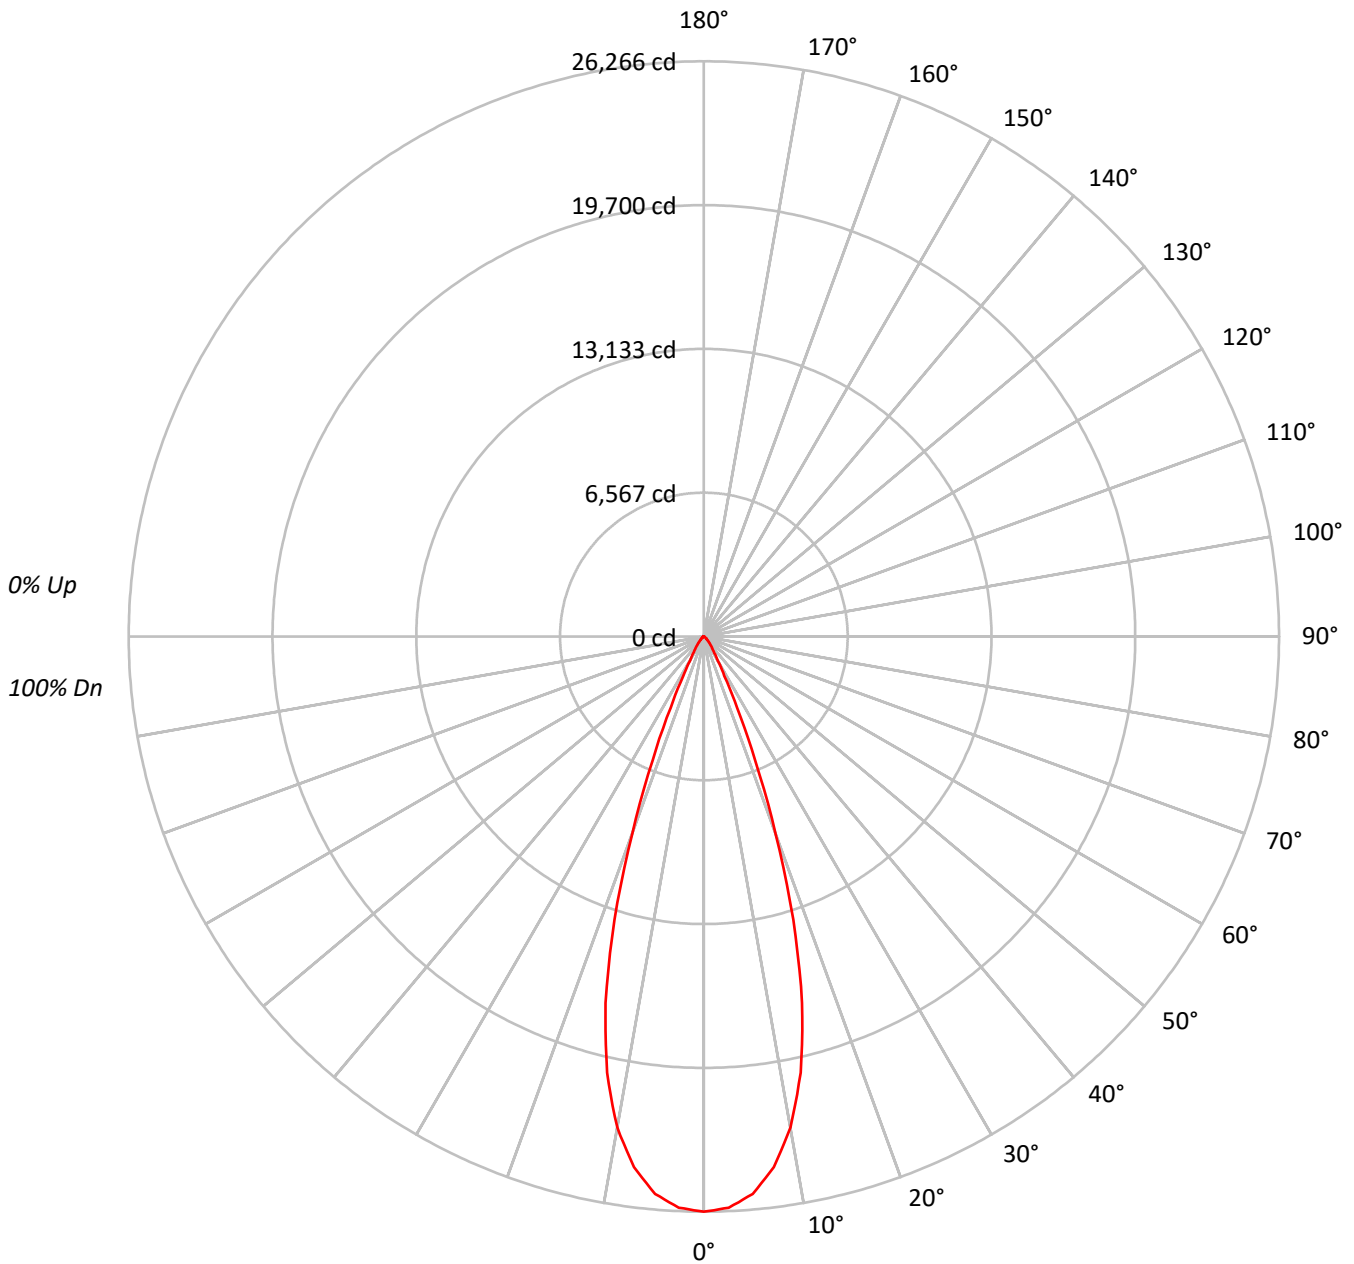



TEST NUMBER: P773522

CATALOG NUMBER: LD6D90BD010-EU6DR3570959040-6LBDP1B

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96				96															
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92				92															
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88				88															
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84				84															
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81				81															
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78				78															
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75				75															
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72				72															
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70				70															
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68				68															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	2869854
5°	2802418
10°	2525725
15°	1960363
20°	1111894
25°	432579
30°	161376
35°	88459
40°	57822
45°	35199
50°	22403
55°	15830
60°	11582
65°	6308
70°	447
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 35199 cd/sqm



TEST NUMBER: P773522

CATALOG NUMBER: LD6D90BD010-EU6DR3570959040-6LBDP1B

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	2350.0	24.6
10°-20°	4588.2	48.1
20°-30°	1871.2	19.6
30°-40°	447.8	4.7
40°-50°	186.6	2.0
50°-60°	77.3	0.8
60°-70°	24.2	0.3
70°-80°	0.5	0.0
80°-90°	0.4	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	8809.3	92.3
0°-40°	9257.1	97.0
0°-60°	9521.0	99.7
0°-90°	9546.2	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	9546.2	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	26266	
5°	25551	###
15°	17331	4588
25°	3588	1871
35°	663	448
45°	228	187
55°	83	77
65°	24	24
75°	0	1
85°	0	0
90°	0	



TEST NUMBER: P773522

CATALOG NUMBER: LD6D90BD010-EU6DR3570959040-6LBDP1B

CANDELA DISTRIBUTION (FULL):

0°	
0°	26266.1
2.5°	26108.5
5°	25551.3
7.5°	24439.8
10°	22765.3
12.5°	20407.5
15°	17330.7
17.5°	13567.8
20°	9562.8
22.5°	6097.8
25°	3588.2
27.5°	2028.3
30°	1279.1
32.5°	898.1
35°	663.2
37.5°	512.8
40°	405.4
42.5°	312.3
45°	227.8
47.5°	170.5
50°	131.8
52.5°	104.6
55°	83.1
57.5°	67.3
60°	53.0
62.5°	38.7
65°	24.4
67.5°	8.6
70°	1.4
72.5°	1.4
75°	0.0
77.5°	0.0
80°	0.0
82.5°	1.4
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)