

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P759939

Luminaire Tested: LD6D10D010-EU6DR150210IC9024-6LBSQW1MW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P759939
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D10D010-EU6DR150210IC9024-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 831.8 lumens
Efficiency: N/A
Efficacy: 71.1 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P759939

CATALOG NUMBER: LD6D10D010-EU6DR150210IC9024-6LBSQW1MW

Luminous Intensity Polar Plot

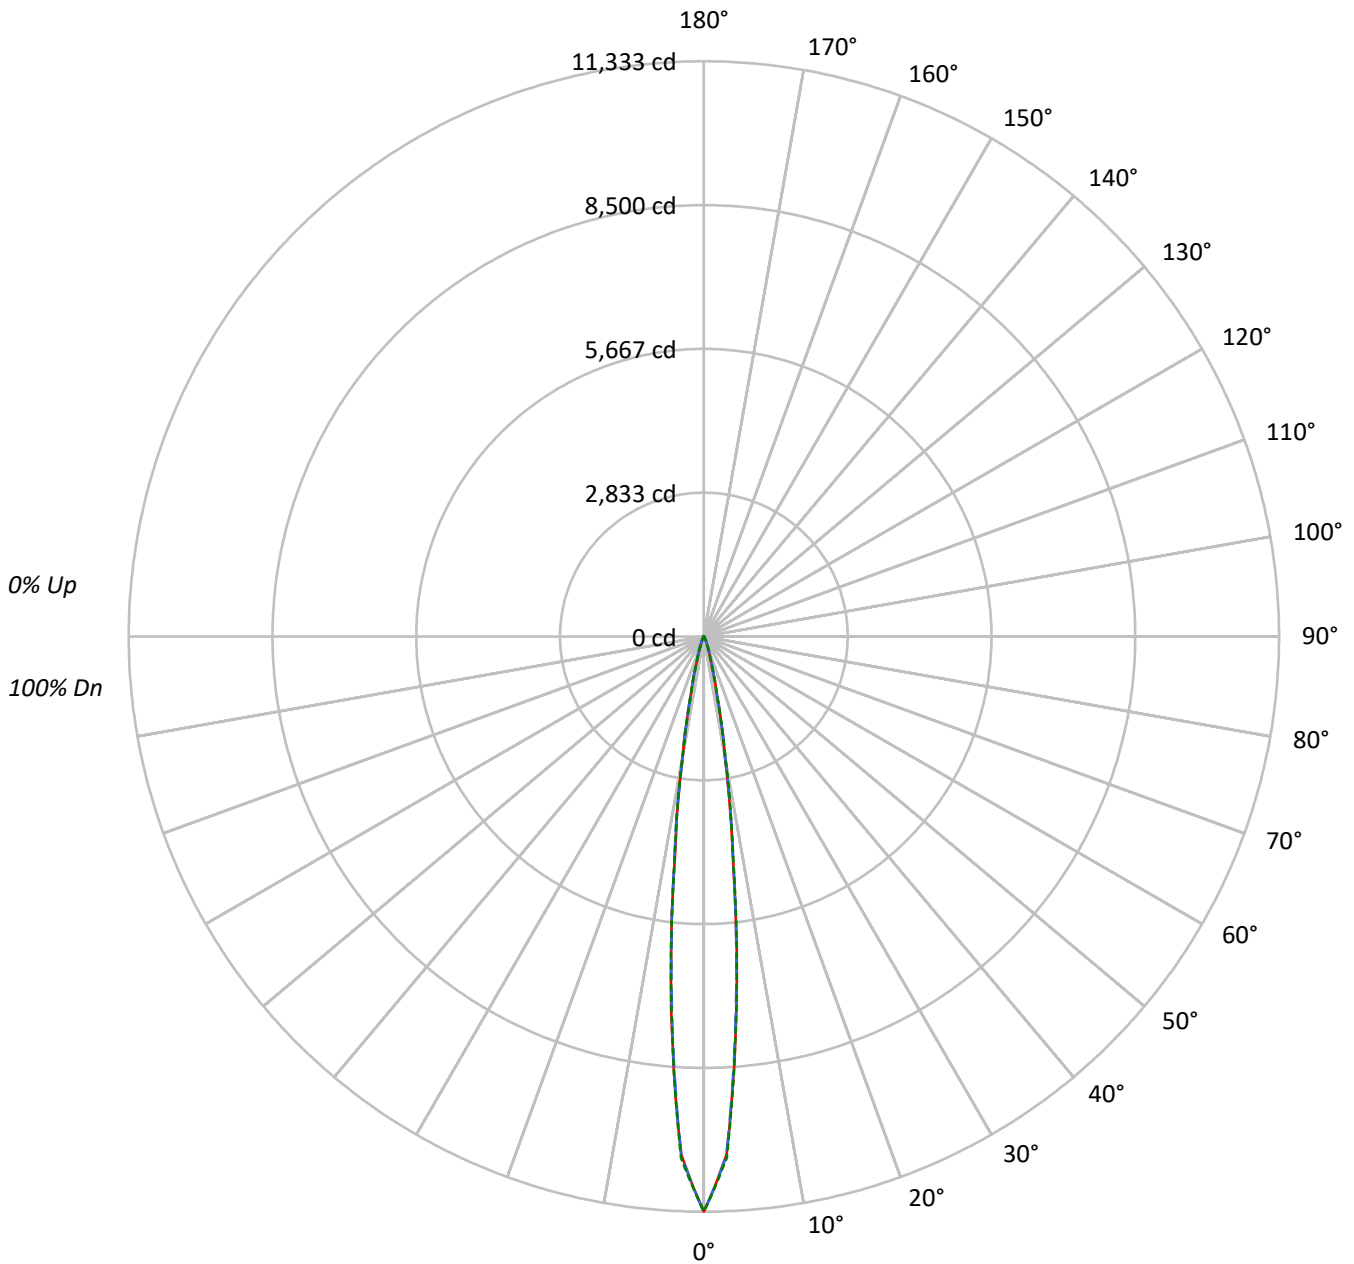



TEST NUMBER: P759939

CATALOG NUMBER: LD6D10D010-EU6DR150210IC9024-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	87	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1275234	1275234	1275234
5°	749381	739686	745529
10°	223658	225226	228669
15°	55632	56718	54963
20°	16643	19277	16995
25°	5866	7478	5944
30°	2157	2838	2194
35°	1082	1220	1046
40°	682	753	682
45°	504	539	504
50°	403	403	403
55°	334	334	334
60°	267	267	267
65°	207	207	207
70°	176	176	176
75°	106	106	144
80°	79	79	79
85°	42	42	42

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 539 cd/sqm



TEST NUMBER: P759939

CATALOG NUMBER: LD6D10D010-EU6DR150210IC9024-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	539.5	64.9
10°-20°	221.9	26.7
20°-30°	44.1	5.3
30°-40°	11.0	1.3
40°-50°	5.8	0.7
50°-60°	4.3	0.5
60°-70°	3.0	0.4
70°-80°	1.7	0.2
80°-90°	0.5	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	805.5	96.8
0°-40°	816.5	98.2
0°-60°	826.6	99.4
0°-90°	831.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	831.8	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	11333	11333	11333	11333	11333	
5°	7374	7298	7278	7329	7336	538
15°	640	652	653	642	633	220
25°	75	85	96	85	76	40
35°	15	16	17	16	14	10
45°	7	7	8	7	7	6
55°	5	5	5	5	5	4
65°	3	3	3	3	3	3
75°	1	1	1	1	2	2
85°	0	0	0	0	0	1
90°	0	0	0	0	0	



TEST NUMBER: P759939

CATALOG NUMBER: LD6D10D010-EU6DR150210IC9024-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	11333.4	11333.4	11333.4	11333.4	11333.4
2.5°	10223.2	10231.8	10235.1	10245.2	10282.6
5°	7373.7	7297.9	7278.3	7328.6	7335.8
7.5°	4367.9	4383.3	4439.4	4451.9	4406.8
10°	2397.0	2416.7	2413.8	2431.0	2450.7
12.5°	1225.8	1210.5	1205.7	1225.4	1198.0
15°	640.5	652.5	653.0	641.5	632.8
17.5°	344.5	358.4	381.4	362.7	333.9
20°	203.4	215.9	235.6	220.2	207.7
22.5°	125.7	135.8	149.7	137.7	127.6
25°	75.3	85.4	96.0	84.9	76.3
27.5°	44.6	53.3	60.0	52.8	44.1
30°	28.8	33.6	37.9	33.1	29.3
32.5°	20.2	22.1	24.0	22.1	20.2
35°	14.9	15.8	16.8	15.8	14.4
37.5°	11.5	12.5	13.0	12.0	11.0
40°	9.6	10.1	10.6	10.1	9.6
42.5°	8.2	8.6	8.6	8.6	8.2
45°	7.2	7.2	7.7	7.2	7.2
47.5°	6.2	6.2	6.7	6.2	6.2
50°	5.8	5.8	5.8	5.8	5.8
52.5°	5.3	5.3	5.3	5.3	5.3
55°	4.8	4.8	4.8	4.8	4.8
57.5°	4.3	4.3	4.3	4.3	4.3
60°	3.8	3.8	3.8	3.8	3.8
62.5°	3.4	3.4	3.4	3.4	3.4
65°	2.9	2.9	2.9	2.9	2.9
67.5°	2.9	2.9	2.9	2.9	2.9
70°	2.4	2.4	2.4	2.4	2.4
72.5°	1.9	1.9	1.9	1.9	1.9
75°	1.4	1.4	1.4	1.4	1.9
77.5°	1.4	1.4	1.4	1.4	1.4
80°	1.0	1.0	1.0	1.0	1.0
82.5°	1.0	1.0	1.0	1.0	1.0
85°	0.5	0.5	0.5	0.5	0.5
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)