

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P760719

Luminaire Tested: LD6D10D010-EU6DR650210IC9024-6LBSQW1MW

Issue Date: 2/5/2024

Test Information

Test Method: LM-79-2019
Report Number: P760719
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-59)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/5/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D10D010-EU6DR650210IC9024-6LBSQW1MW
Description: 6 INCH SQAURE DEEP 45° CUTOFF MATTE WHITE TRIM, WITH 65° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 714.8 lumens
Efficiency: N/A
Efficacy: 61.1 lumens/watt
Spacing Criteria (0/90/45): 0.98 / 0.98 / 0.92
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P760719

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9024-6LBSQW1MW

Luminous Intensity Polar Plot

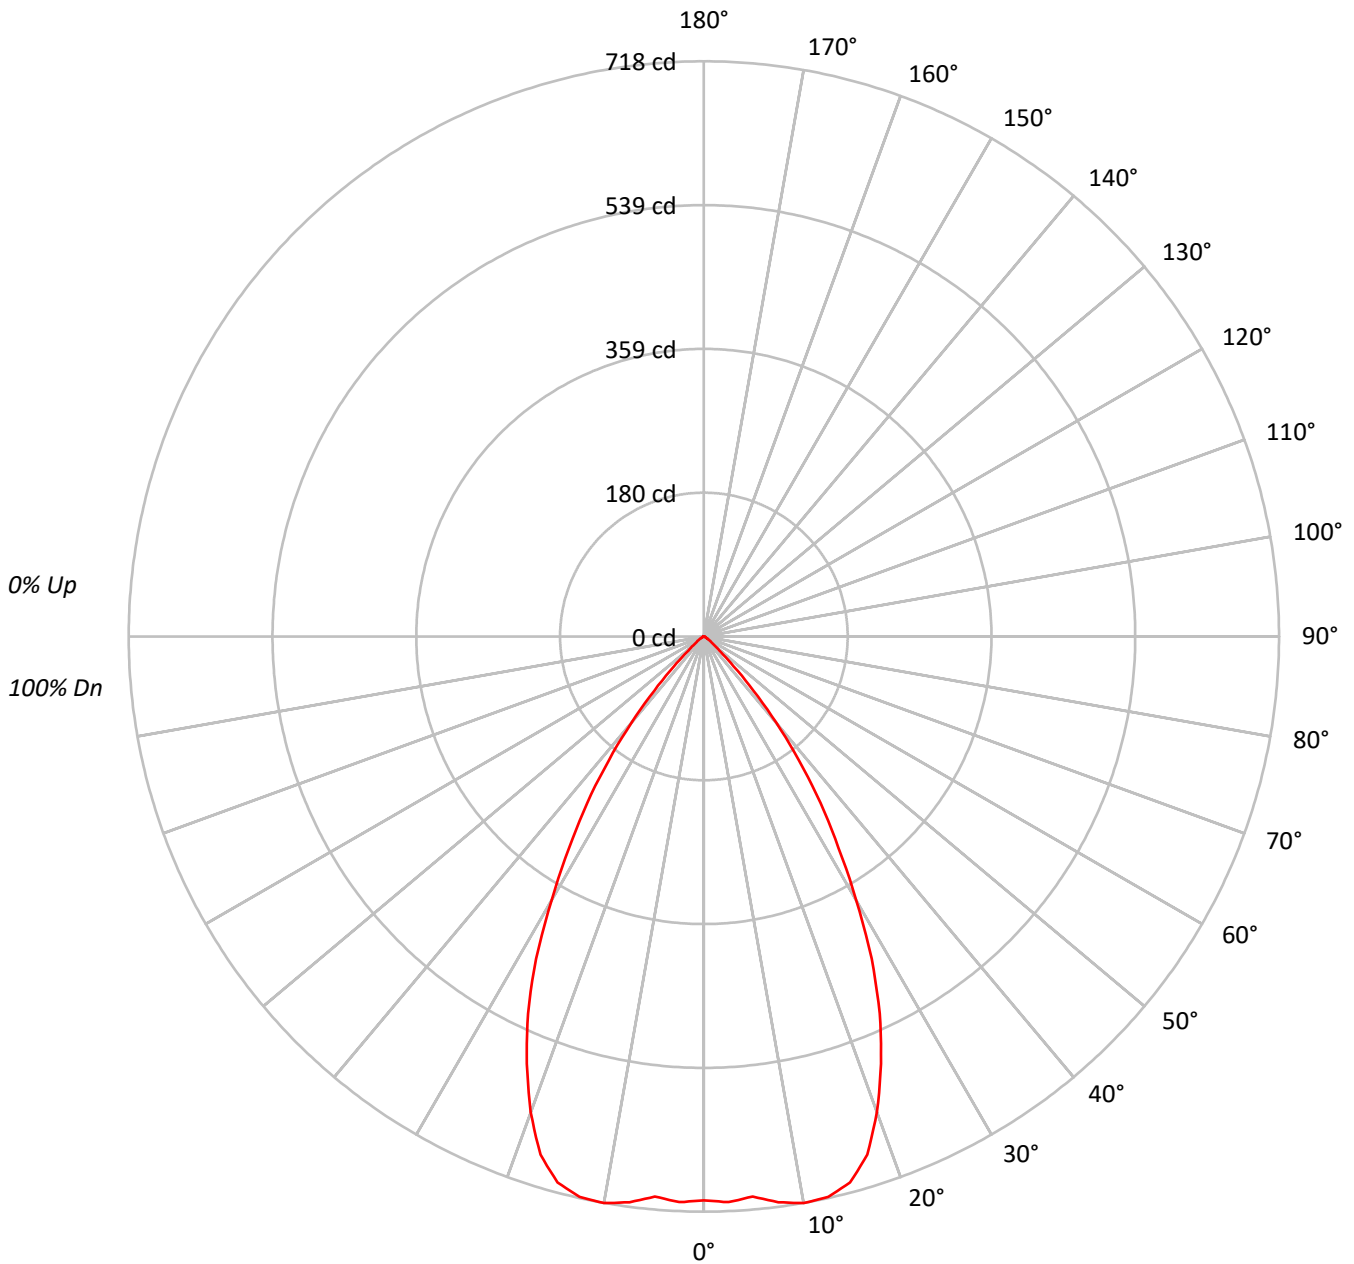



TEST NUMBER: P760719

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9024-6LBSQW1MW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10			0	
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	113	111	108	106	111	108	106	104	104	103	101	101	99	98	97	96	95	93			
2	108	103	99	95	106	101	97	94	98	95	92	95	92	90	92	90	88	87			
3	102	96	91	87	100	94	90	86	92	88	85	89	86	83	87	84	82	80			
4	97	89	84	79	95	88	83	79	86	82	78	84	80	77	82	79	76	75			
5	92	83	78	73	90	83	77	73	81	76	72	79	75	72	77	74	71	69			
6	87	78	72	68	86	77	72	68	76	71	67	74	70	67	73	69	66	65			
7	83	73	67	63	81	73	67	63	71	66	62	70	66	62	69	65	62	60			
8	79	69	63	59	77	68	63	59	67	62	58	66	62	58	65	61	58	57			
9	75	65	59	55	74	65	59	55	64	58	55	63	58	55	62	58	54	53			
10	71	61	56	52	70	61	55	52	60	55	51	59	55	51	59	54	51	50			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	76898
5°	76961
10°	79671
15°	79803
20°	73473
25°	62605
30°	47917
35°	33853
40°	19982
45°	8112
50°	2941
55°	1638
60°	940
65°	517
70°	543
75°	422
80°	440
85°	376

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 8112 cd/sqm



TEST NUMBER: P760719

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9024-6LBSQW1MW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	67.8	9.5
10°-20°	195.5	27.3
20°-30°	234.5	32.8
30°-40°	157.6	22.0
40°-50°	47.2	6.6
50°-60°	8.3	1.2
60°-70°	2.4	0.3
70°-80°	1.2	0.2
80°-90°	0.4	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	497.8	69.6
0°-40°	655.4	91.7
0°-60°	710.9	99.5
0°-90°	714.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	714.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	704	
5°	702	68
15°	706	195
25°	519	235
35°	254	158
45°	52	47
55°	9	8
65°	2	2
75°	1	1
85°	0	0
90°	0	



TEST NUMBER: P760719

CATALOG NUMBER: LD6D10D010-EU6DR650210IC9024-6LBSQW1MW

CANDELA DISTRIBUTION (FULL):

	0°
0°	703.8
2.5°	706.8
5°	701.7
7.5°	712.3
10°	718.1
12.5°	716.6
15°	705.5
17.5°	678.1
20°	631.9
22.5°	577.5
25°	519.3
27.5°	453.5
30°	379.8
32.5°	313.0
35°	253.8
37.5°	195.3
40°	140.1
42.5°	91.5
45°	52.5
47.5°	27.8
50°	17.3
52.5°	12.0
55°	8.6
57.5°	6.2
60°	4.3
62.5°	2.8
65°	2.0
67.5°	1.8
70°	1.7
72.5°	1.3
75°	1.0
77.5°	0.9
80°	0.7
82.5°	0.5
85°	0.3
87.5°	0.2
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)