

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P760422

Luminaire Tested: LD6D10D010-EU6DR450210IC9030-6LBCSSQMMS

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P760422
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-36)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D10D010-EU6DR450210IC9030-6LBCSSQMMS
Description: 6 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 45° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3000K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1020.8 lumens
Efficiency: N/A
Efficacy: 87.2 lumens/watt
Spacing Criteria (0/90/45): 0.75 / 0.75 / 0.69
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P760422
CATALOG NUMBER: LD6D10D010-EU6DR450210IC9030-6LBCSSQMMS

Luminous Intensity Polar Plot

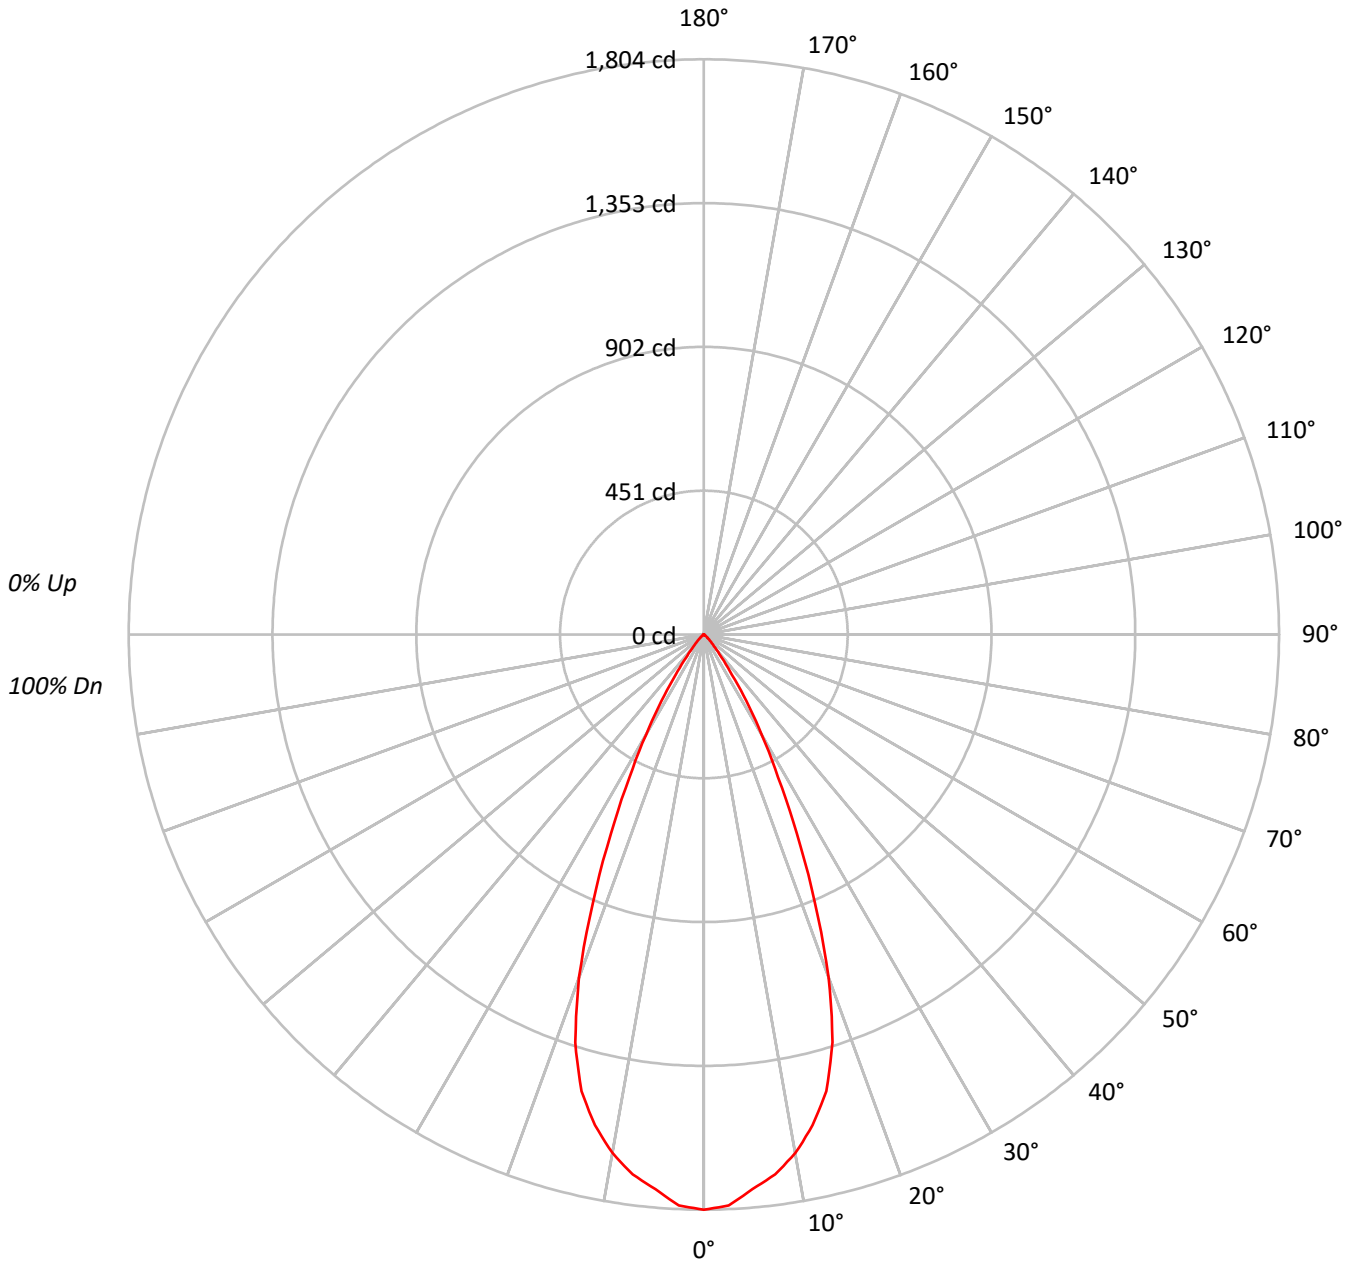



TEST NUMBER: P760422

CATALOG NUMBER: LD6D10D010-EU6DR450210IC9030-6LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20				
RC	80				70				50				30				10		0		
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100			
1	114	112	110	108	112	110	108	106	106	104	103	102	101	100	98	98	97	95			
2	109	105	102	99	107	103	100	98	100	98	95	97	95	93	95	93	91	90			
3	105	99	95	91	103	98	94	91	95	92	89	93	90	88	91	89	87	85			
4	100	94	89	85	99	93	88	85	91	87	84	89	86	83	87	84	82	81			
5	96	89	84	80	95	88	83	80	86	82	79	85	81	79	83	80	78	77			
6	92	85	80	76	91	84	79	76	83	78	75	81	77	75	80	77	74	73			
7	89	81	75	72	87	80	75	72	79	74	71	78	74	71	77	73	71	69			
8	85	77	72	68	84	76	71	68	75	71	68	74	70	67	73	70	67	66			
9	82	73	68	65	81	73	68	65	72	68	65	71	67	64	71	67	64	63			
10	79	70	65	62	78	70	65	62	69	65	62	68	64	61	68	64	61	60			

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	197139
5°	191520
10°	183239
15°	167704
20°	133039
25°	83063
30°	45772
35°	20554
40°	8101
45°	3817
50°	1819
55°	952
60°	459
65°	103
70°	32
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 3817 cd/sqm



TEST NUMBER: P760422

CATALOG NUMBER: LD6D10D010-EU6DR450210IC9030-6LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	164.1	16.1
10°-20°	403.8	39.6
20°-30°	319.8	31.3
30°-40°	106.5	10.4
40°-50°	21.1	2.1
50°-60°	4.8	0.5
60°-70°	0.7	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	887.7	87.0
0°-40°	994.1	97.4
0°-60°	1020.1	99.9
0°-90°	1020.8	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1020.8	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1804	
5°	1746	164
15°	1483	404
25°	689	320
35°	154	106
45°	25	21
55°	5	5
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P760422

CATALOG NUMBER: LD6D10D010-EU6DR450210IC9030-6LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	1804.3
2.5°	1792.5
5°	1746.2
7.5°	1708.0
10°	1651.6
12.5°	1576.4
15°	1482.6
17.5°	1341.5
20°	1144.2
22.5°	909.2
25°	689.0
27.5°	504.5
30°	362.8
32.5°	246.8
35°	154.1
37.5°	91.4
40°	56.8
42.5°	37.3
45°	24.7
47.5°	15.9
50°	10.7
52.5°	7.1
55°	5.0
57.5°	3.3
60°	2.1
62.5°	1.1
65°	0.4
67.5°	0.1
70°	0.1
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)