

Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P760590

Luminaire Tested: LD6D10D010-EU6DR550210IC9035-6LBCSSQMB

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P760590
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-52)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D10D010-EU6DR550210IC9035-6LBCSSQMB
Description: 6 INCH SQAURE SHALLOW CAST MATTE BLACK TRIM, WITH 55° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 3500K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1102.7 lumens
Efficiency: N/A
Efficacy: 94.3 lumens/watt
Spacing Criteria (0/90/45): 0.89 / 0.89 / 0.87
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 11.7
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P760590

CATALOG NUMBER: LD6D10D010-EU6DR550210IC9035-6LBCSSQMB

Luminous Intensity Polar Plot

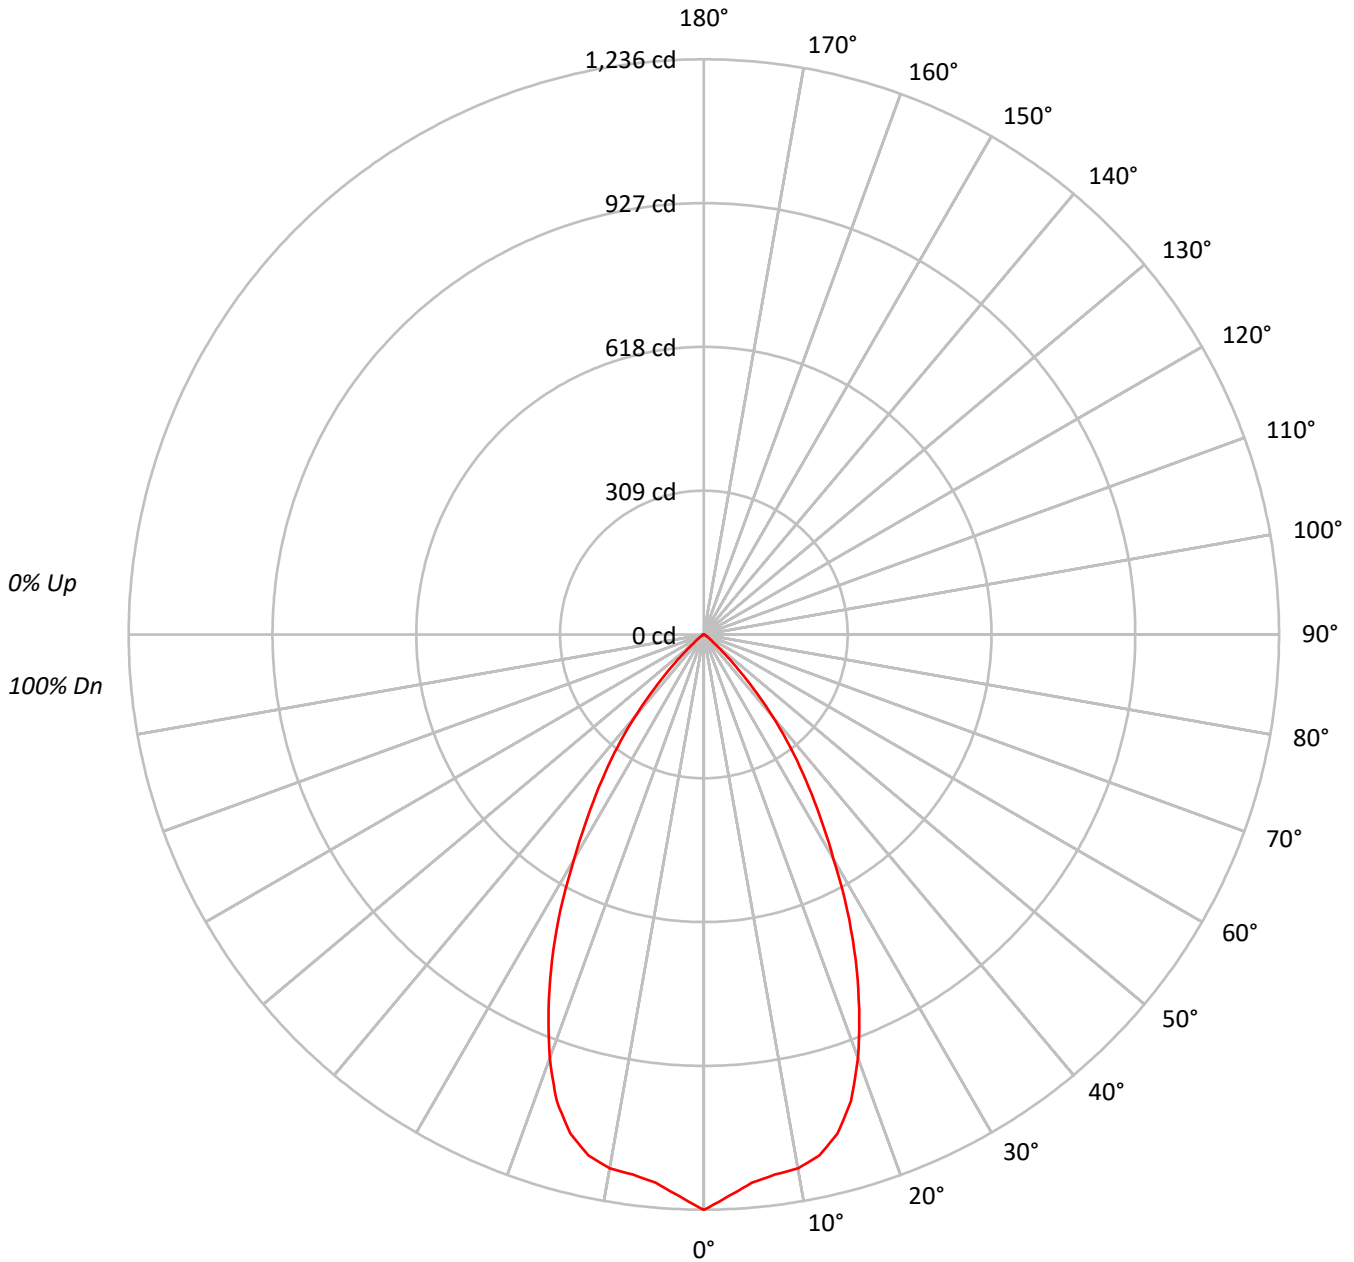



TEST NUMBER: P760590

CATALOG NUMBER: LD6D10D010-EU6DR550210IC9035-6LBCSSQMB

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20				20				20				20				20			
RC	80				70				50				30				10			0
RW	70	50	30	10	70	50	30	10	50	30	10		50	30	10		50	30	10	0
RCR																				
0	119	119	119	119	116	116	116	116	111	111	111		106	106	106		102	102	102	100
1	114	111	108	106	111	109	106	104	105	103	101		101	99	98		97	96	95	94
2	108	103	99	96	106	101	98	95	98	95	92		95	93	90		92	90	89	87
3	102	96	91	87	100	95	90	86	92	88	85		90	86	84		87	85	82	81
4	97	90	84	80	95	88	83	79	86	82	78		84	81	78		82	79	77	75
5	92	84	78	74	91	83	77	73	81	76	73		79	75	72		78	74	71	70
6	88	79	73	68	86	78	72	68	76	71	68		75	70	67		74	70	67	65
7	83	74	68	64	82	73	67	63	72	67	63		71	66	63		70	65	62	61
8	79	69	63	59	78	69	63	59	68	63	59		67	62	59		66	62	58	57
9	75	66	60	56	74	65	59	55	64	59	55		63	58	55		62	58	55	54
10	72	62	56	52	71	61	56	52	61	56	52		60	55	52		59	55	52	50

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	135101
5°	129738
10°	129252
15°	125535
20°	112564
25°	93033
30°	70273
35°	50952
40°	32605
45°	14896
50°	4861
55°	2114
60°	896
65°	129
70°	0
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 14896 cd/sqm



TEST NUMBER: P760590

CATALOG NUMBER: LD6D10D010-EU6DR550210IC9035-6LBCSSQMB

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	112.6	10.2
10°-20°	307.2	27.9
20°-30°	350.1	31.7
30°-40°	238.3	21.6
40°-50°	82.1	7.4
50°-60°	11.3	1.0
60°-70°	1.1	0.1
70°-80°	0.0	0.0
80°-90°	0.0	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	769.8	69.8
0°-40°	1008.2	91.4
0°-60°	1101.6	99.9
0°-90°	1102.7	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1102.7	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	1236	
5°	1183	113
15°	1110	307
25°	772	350
35°	382	238
45°	96	82
55°	11	11
65°	0	1
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P760590

CATALOG NUMBER: LD6D10D010-EU6DR550210IC9035-6LBCSSQMB

CANDELA DISTRIBUTION (FULL):

	0°
0°	1236.5
2.5°	1208.2
5°	1182.9
7.5°	1170.5
10°	1165.0
12.5°	1146.6
15°	1109.8
17.5°	1051.4
20°	968.1
22.5°	871.9
25°	771.7
27.5°	667.3
30°	557.0
32.5°	463.5
35°	382.0
37.5°	304.5
40°	228.6
42.5°	158.4
45°	96.4
47.5°	52.0
50°	28.6
52.5°	17.0
55°	11.1
57.5°	7.0
60°	4.1
62.5°	1.8
65°	0.5
67.5°	0.2
70°	0.0
72.5°	0.0
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.0
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)