

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P761244

Luminaire Tested: LD6D15D010-EU6DR350215IC9024-6LBCSSQMMS

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P761244
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2307-078-20)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D15D010-EU6DR350215IC9024-6LBCSSQMMS
Description: 6 INCH SQAURE SHALLOW CAST MATTE METALLIC SILVER TRIM, WITH 35° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2400K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1119.9 lumens
Efficiency: N/A
Efficacy: 70.9 lumens/watt
Spacing Criteria (0/90/45): 0.6 / 0.6 / 0.54
Luminous Opening: Circular (Dia: 0.35' x H: 0')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P761244
CATALOG NUMBER: LD6D15D010-EU6DR350215IC9024-6LBCSSQMMS

Luminous Intensity Polar Plot

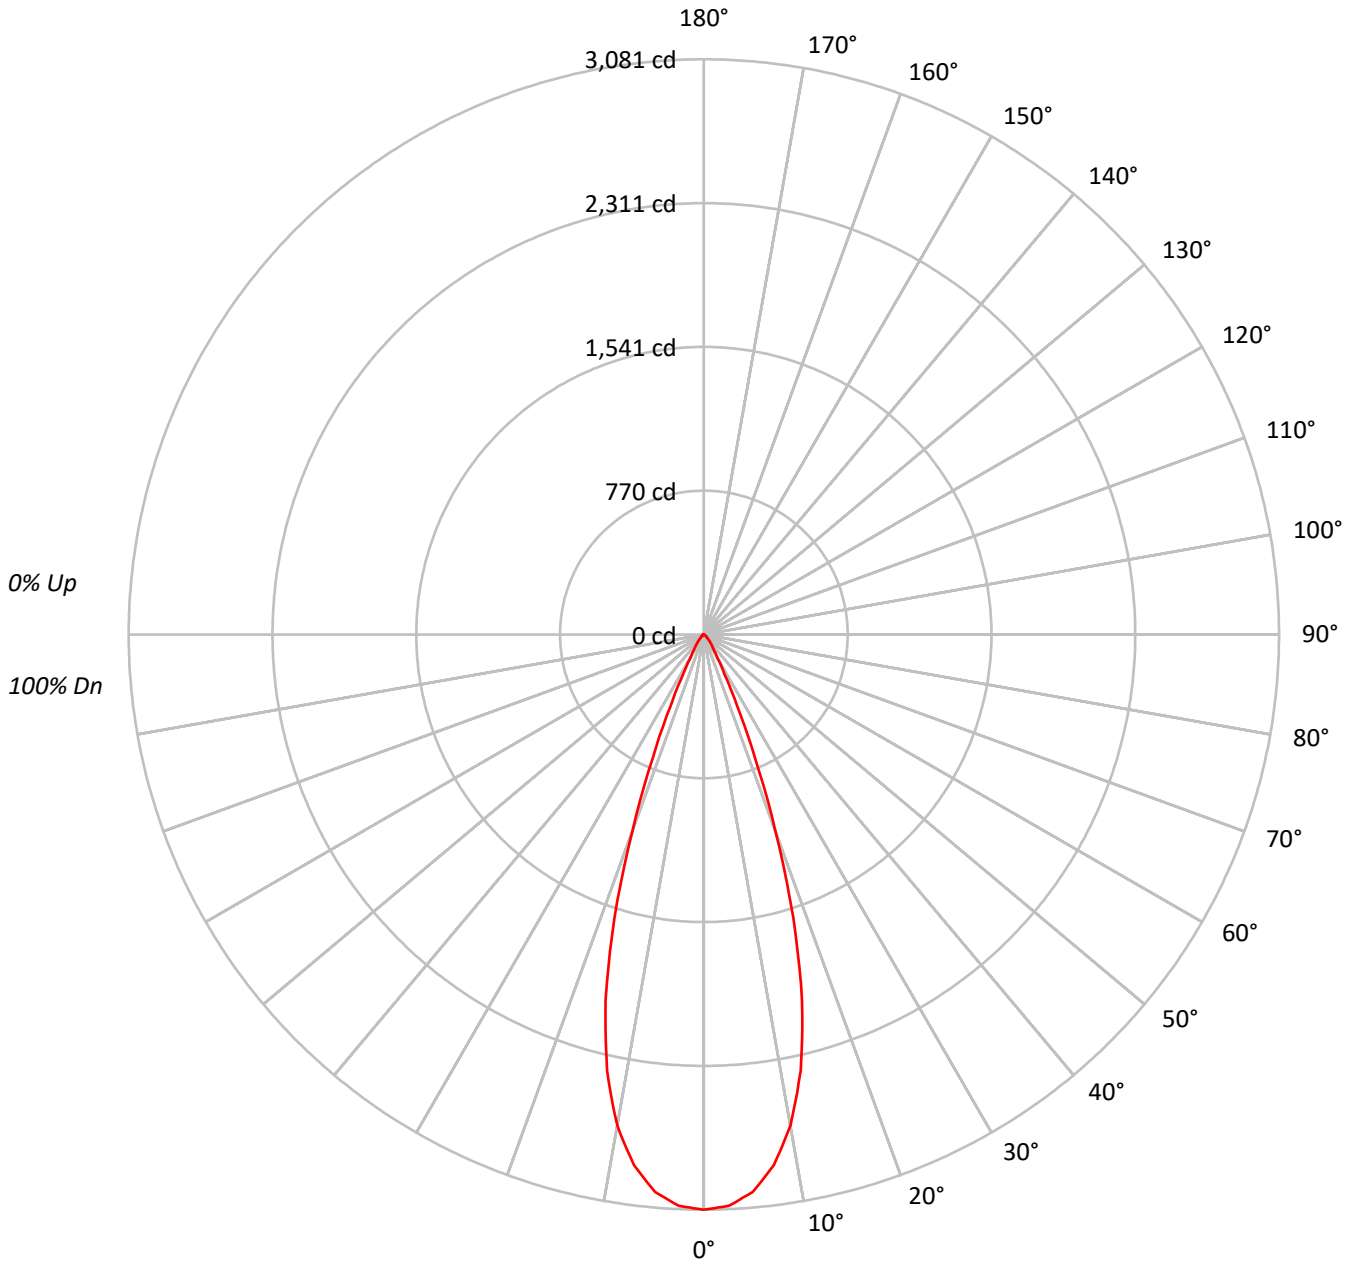



TEST NUMBER: P761244

CATALOG NUMBER: LD6D15D010-EU6DR350215IC9024-6LBCSSQMMS

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0																
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100				100															
1	115	112	110	108	112	110	108	107	106	105	103	103	101	100	99	98	98	96				96															
2	110	106	103	101	108	105	102	99	102	99	97	99	97	95	96	95	93	92				92															
3	106	101	97	94	105	100	96	93	97	95	92	95	93	91	93	91	89	88				88															
4	103	97	92	89	101	96	92	89	94	90	88	92	89	87	90	88	86	84				84															
5	99	93	88	85	98	92	87	84	90	86	84	89	85	83	87	84	82	81				81															
6	96	89	84	81	94	88	84	81	87	83	80	85	82	80	84	81	79	78				78															
7	93	85	81	78	91	85	80	77	84	80	77	83	79	77	82	79	76	75				75															
8	90	82	78	74	88	82	77	74	81	77	74	80	76	74	79	76	73	72				72															
9	87	79	75	72	86	79	75	72	78	74	71	77	74	71	77	73	71	70				70															
10	84	77	72	69	83	76	72	69	76	72	69	75	71	69	74	71	69	68				68															

AVERAGE LUMINANCE (cd/sqm):

	0°
0°	336665
5°	328760
10°	296293
15°	229974
20°	130435
25°	50742
30°	18937
35°	10377
40°	6789
45°	4126
50°	2635
55°	1848
60°	1355
65°	750
70°	64
75°	0
80°	0
85°	0

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 0°
 Vertical Angle: 45°
 Luminance: 4126 cd/sqm



TEST NUMBER: P761244

CATALOG NUMBER: LD6D15D010-EU6DR350215IC9024-6LBCSSQMMS

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	275.7	24.6
10°-20°	538.2	48.1
20°-30°	219.5	19.6
30°-40°	52.6	4.7
40°-50°	21.9	2.0
50°-60°	9.1	0.8
60°-70°	2.8	0.3
70°-80°	0.1	0.0
80°-90°	0.1	0.0
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1033.4	92.3
0°-40°	1086.0	97.0
0°-60°	1116.9	99.7
0°-90°	1119.9	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1119.9	100.0

CANDELA DISTRIBUTION:

	0°	Flux
0°	3081	
5°	2998	276
15°	2033	538
25°	421	220
35°	78	53
45°	27	22
55°	10	9
65°	3	3
75°	0	0
85°	0	0
90°	0	



TEST NUMBER: P761244

CATALOG NUMBER: LD6D15D010-EU6DR350215IC9024-6LBCSSQMMS

CANDELA DISTRIBUTION (FULL):

	0°
0°	3081.3
2.5°	3062.9
5°	2997.5
7.5°	2867.1
10°	2670.6
12.5°	2394.1
15°	2033.1
17.5°	1591.7
20°	1121.8
22.5°	715.3
25°	420.9
27.5°	237.9
30°	150.1
32.5°	105.4
35°	77.8
37.5°	60.2
40°	47.6
42.5°	36.6
45°	26.7
47.5°	20.0
50°	15.5
52.5°	12.3
55°	9.7
57.5°	7.9
60°	6.2
62.5°	4.5
65°	2.9
67.5°	1.0
70°	0.2
72.5°	0.2
75°	0.0
77.5°	0.0
80°	0.0
82.5°	0.2
85°	0.0
87.5°	0.0
90°	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



— 0°-180°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)