

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269



Scaled data based on original data using
LM-79-2019 Approved Method: Electrical and Photometric Measurements of Solid-
State Lighting Products

Test Report Prepared for

Cooper Lighting Solutions

Brand: PORTFOLIO

Report Number: P760954

Luminaire Tested: LD6D15D010-EU6DR1515309027-6LBCSSQMW

Issue Date: 2/2/2024

Test Information

Test Method: LM-79-2019
Report Number: P760954
TEST IS SCALED FROM IESNA LM-79-08 TEST DATA (G1-2310-195-21)
Test Lab: COOPER LIGHTING SOLUTIONS
Issue Date: 2/2/2024
Manufacturer: COOPER LIGHTING SOLUTIONS
Product Line: PORTFOLIO
Catalog Number: LD6D15D010-EU6DR1515309027-6LBCSSQMW
Description: 6 INCH SQAURE SHALLOW CAST MATTE WHITE TRIM, WITH 15° OPTIC
Light Source: (1) HIGH LUMEN LED 90CRI / 2700K CCT
Ballast/Driver: -

Summary

Lumens per Lamp: N/A
Luminaire Lumens: 1286.6 lumens
Efficiency: N/A
Efficacy: 81.4 lumens/watt
Spacing Criteria (0/90/45): 0.22 / 0.22 / 0.23
Luminous Opening: Vertical Cylinder (Dia: 0.35' x H: 0.35')
CIE Type: Direct

Input Watts (W): 15.8
Input Voltage (V): NR
Input Current (Ain): NR
Voltage Rise (V): NR
Power Factor: NR
Total Harmonic Distortion (THDi): NR
Frequency (hertz): 60
Stabilization Time: NR
Operation Time: NR
Ambient Temperature (°C): NR
Test Distance: 24 FT




Downlight



TEST NUMBER: P760954

CATALOG NUMBER: LD6D15D010-EU6DR1515309027-6LBCSSQMW

Luminous Intensity Polar Plot

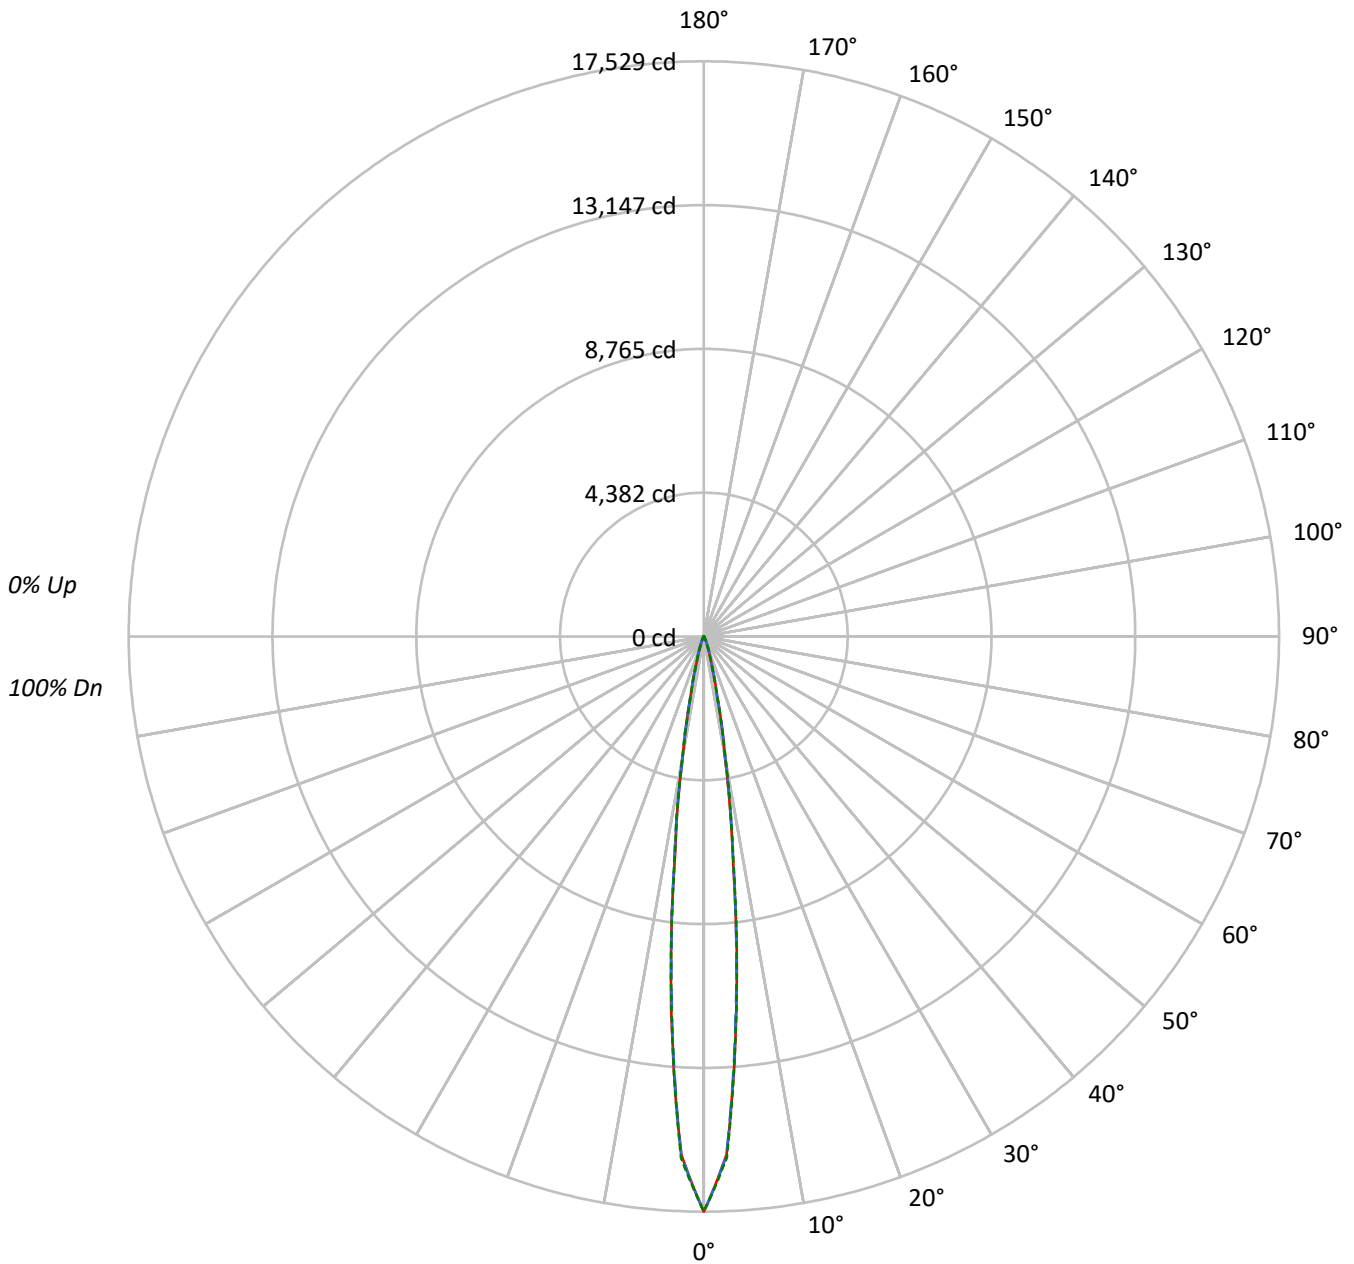



TEST NUMBER: P760954

CATALOG NUMBER: LD6D15D010-EU6DR1515309027-6LBCSSQMW

COEFFICIENT OF UTILIZATION - ZONAL CAVITY METHOD:

RF	20									20									20									20									
RC	80									50									30									10									0
RW	70	50	30	10	70	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0													
RCR																																					
0	119	119	119	119	116	116	116	116	111	111	111	106	106	106	102	102	102	100						100													
1	116	114	112	111	113	112	110	109	108	107	106	104	103	103	101	100	100	98						98													
2	113	110	107	105	111	108	106	104	105	103	102	102	101	100	100	98	98	96						96													
3	110	106	103	101	108	105	102	100	103	100	99	100	99	97	98	97	96	94						94													
4	108	103	100	98	106	102	99	97	100	98	96	99	97	95	97	95	94	93						93													
5	106	101	98	95	104	100	97	95	98	96	94	97	95	93	96	94	92	92						92													
6	104	99	95	93	102	98	95	93	97	94	92	96	93	92	95	93	91	90						90													
7	102	97	94	91	101	96	93	91	95	93	91	94	92	90	93	91	90	89						89													
8	100	95	92	90	99	95	92	90	94	91	89	93	91	89	92	90	89	88						88													
9	99	93	90	88	98	93	90	88	92	90	88	92	89	88	91	89	88	87						87													
10	97	92	89	87	96	92	89	87	91	89	87	91	88	87	90	88	86	86						86													

AVERAGE LUMINANCE (cd/sqm):

	0°	45°	90°
0°	1972385	1972385	1972385
5°	1159067	1144057	1153112
10°	345929	348355	353682
15°	86049	87725	85015
20°	25741	29816	26290
25°	9075	11560	9192
30°	3332	4388	3392
35°	1670	1888	1619
40°	1051	1158	1051
45°	777	833	777
50°	619	619	619
55°	515	515	515
60°	414	414	414
65°	321	321	321
70°	271	271	271
75°	166	166	227
80°	118	118	118
85°	58	58	58

MAXIMUM LUMINANCE 45°-90°:

Horizontal Angle: 45°

Vertical Angle: 45°

Luminance: 833 cd/sqm



TEST NUMBER: P760954

CATALOG NUMBER: LD6D15D010-EU6DR1515309027-6LBCSSQMW

ZONAL LUMENS:

Zone	Lumens	% Fixture
0°-10°	834.4	64.9
10°-20°	343.2	26.7
20°-30°	68.2	5.3
30°-40°	17.0	1.3
40°-50°	8.9	0.7
50°-60°	6.6	0.5
60°-70°	4.7	0.4
70°-80°	2.7	0.2
80°-90°	0.8	0.1
90°-100°	0.0	0.0
100°-110°	0.0	0.0
110°-120°	0.0	0.0
120°-130°	0.0	0.0
130°-140°	0.0	0.0
140°-150°	0.0	0.0
150°-160°	0.0	0.0
160°-170°	0.0	0.0
170°-180°	0.0	0.0
0°-30°	1245.8	96.8
0°-40°	1262.8	98.2
0°-60°	1278.4	99.4
0°-90°	1286.6	100.0
90°-120°	0.0	0.0
90°-150°	0.0	0.0
90°-180°	0.0	0.0
0°-180°	1286.6	100.0

CANDELA DISTRIBUTION:

	0°	22.5°	45°	67.5°	90°	Flux
0°	17529	17529	17529	17529	17529	
5°	11405	11288	11257	11335	11346	833
15°	991	1009	1010	992	979	340
25°	116	132	148	131	118	61
35°	23	24	26	24	22	16
45°	11	11	12	11	11	9
55°	7	7	7	7	7	7
65°	4	4	4	4	4	5
75°	2	2	2	2	3	3
85°	1	1	1	1	1	1
90°	0	0	0	0	0	



TEST NUMBER: P760954

CATALOG NUMBER: LD6D15D010-EU6DR1515309027-6LBCSSQMW

CANDELA DISTRIBUTION (FULL):

	0°	22.5°	45°	67.5°	90°
0°	17529.2	17529.2	17529.2	17529.2	17529.2
2.5°	15812.0	15825.4	15830.6	15846.2	15904.1
5°	11404.9	11287.6	11257.2	11335.1	11346.3
7.5°	6755.8	6779.6	6866.4	6885.7	6815.9
10°	3707.4	3737.8	3733.4	3760.1	3790.5
12.5°	1896.0	1872.2	1864.8	1895.2	1853.0
15°	990.7	1009.2	1010.0	992.1	978.8
17.5°	532.8	554.3	589.9	561.0	516.5
20°	314.6	333.9	364.4	340.6	321.3
22.5°	194.4	210.0	231.5	213.0	197.4
25°	116.5	132.1	148.4	131.3	118.0
27.5°	69.0	82.4	92.8	81.6	68.3
30°	44.5	51.9	58.6	51.2	45.3
32.5°	31.2	34.1	37.1	34.1	31.2
35°	23.0	24.5	26.0	24.5	22.3
37.5°	17.8	19.3	20.0	18.6	17.1
40°	14.8	15.6	16.3	15.6	14.8
42.5°	12.6	13.4	13.4	13.4	12.6
45°	11.1	11.1	11.9	11.1	11.1
47.5°	9.6	9.6	10.4	9.6	9.6
50°	8.9	8.9	8.9	8.9	8.9
52.5°	8.2	8.2	8.2	8.2	8.2
55°	7.4	7.4	7.4	7.4	7.4
57.5°	6.7	6.7	6.7	6.7	6.7
60°	5.9	5.9	5.9	5.9	5.9
62.5°	5.2	5.2	5.2	5.2	5.2
65°	4.5	4.5	4.5	4.5	4.5
67.5°	4.5	4.5	4.5	4.5	4.5
70°	3.7	3.7	3.7	3.7	3.7
72.5°	3.0	3.0	3.0	3.0	3.0
75°	2.2	2.2	2.2	2.2	3.0
77.5°	2.2	2.2	2.2	2.2	2.2
80°	1.5	1.5	1.5	1.5	1.5
82.5°	1.5	1.5	1.5	1.5	1.5
85°	0.7	0.7	0.7	0.7	0.7
87.5°	0.0	0.0	0.0	0.0	0.0
90°	0.0	0.0	0.0	0.0	0.0

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Report Generated By 670245859 / DESKTOP-T8S5UU9

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report





— 0°-180° - - 45°-225° - - - - 90°-270°

Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



Signify Classified - Internal
Cooper Lighting Solutions Photometric Lab
1121 Highway 74 South
Peachtree City, GA 30269

Scaled Data Report



(END OF REPORT)